

PROPOSAL SUBMITTED BY:

GERARDI, Sewer Water Co.

Contractor's Name

1785 Armitage Court

Street

P.O. Box

Addison


ILLINOIS

60101

City

State

Zip Code



CITY OF AURORA
KANE COUNTY
STATE OF ILLINOIS


PROPOSAL AND SPECIFICATIONS FOR

San Souci Water Main Improvements

AURORA, ILLINOIS

June, 2021
Bid Number 21-34

PREPARED BY
CITY OF AURORA
Engineering Division
77 S. Broadway Avenue
AURORA, ILLINOIS 60507

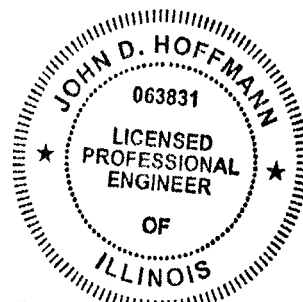

John D. Hoffmann 5-26-21
Exp. 11/30/21

TABLE OF CONTENTS

TITLE PAGE

TABLE OF CONTENTS

NOTICE TO BIDDERS

SPECIAL PROVISIONS

STATE OF ILLINOIS LABOR REQUIREMENTS

CITY OF AURORA GENERAL SPECIFICATIONS

BID BOND FORM

PROPOSAL

SCHEDULE OF PRICES

SIGNATURE SHEET

BIDDER'S CERTIFICATIONS

APPRENTICESHIP OR TRAINING PROGRAM CERTIFICATION

BIDDER'S TAX CERTIFICATION

LOCAL VENDOR PREFERENCE APPLICATION

**City of Aurora
Bid 21-34**

NOTICE TO BIDDERS

Time and Place of Opening of Bids

Sealed proposals for the improvement described below will be received at the office of the Purchasing Division, 44 E. Downer Place, First Floor, Aurora, IL 60507 until 2:00 P.M., Wednesday, June 9, 2021. Proposals will be opened and read publicly via a non-mandatory teleconferenced and live streamed bid opening at 2:00 P.M., Wednesday, June 9, 2021, access details to be provided to all plan holders.

Description of Work

Name: San Souci Water Main Improvements

Location: San Souci Subdivision west of Orchard Road including Coach & Surrey Ln, Lake View Dr, Lake View Ct, Wyckwood Ct, North & Middle Queensberry Ct and Surrey Ct.

Proposed Improvement: Installation of 6,600 LF of 8" water main and other miscellaneous appurtenances all in accordance with the plans and specifications.

Bidder Instructions

1. Plans, specifications, and proposal forms will be available on Tuesday, May 25th, 2021 and may be obtained at online at: <https://www.aurora-il.org/bids.aspx>. Contact Person: John Hoffmann (630) 256-3244.
2. Prequalification of Bidders as contained in Check Sheet LRS6 in the "Supplemental Specifications and Recurring Special Provisions" is required on this project. All proposals must be accompanied by a proposal guaranty as outlined in the Proposal form.
3. The Awarding Authority reserves the right to waive technicalities and to reject any or all proposals as provided in Standard Provisions for Bidding Requirements and Conditions for Contract Proposals contained in the "Supplemental Specifications and Recurring Special Provisions".
4. Any bidder who owes the City money may be disqualified at the City's discretion.
5. The City encourages minority business firms to submit proposals and encourages the successful contract bidder to utilize minority businesses as subcontractors for supplies, equipment, services, and construction.
6. Submission of a bid shall be conclusive assurance and warranty the bidder has examined the plans and understands all requirements for the performance of work. The bidder will be responsible for all errors in the proposal resulting from failure or neglect to conduct an in depth examination. The Awarding Authority will, in no case be responsible for any costs, expenses, losses or changes in anticipated profits resulting from such failure or neglect of the bidder.
7. The City of Aurora has a local preference ordinance that would apply to this contract.

By Order of
City Clerk
City of Aurora

INDEX TO SPECIAL PROVISIONS

Provision *Title*
Number

ADMINISTRATION

SP A.1 – ALTERATIONS TO PROJECT BY ENGINEER
SP A.2 – ITEMS ORDERED BY ENGINEER
SP A.3 – RESPONSIBILITY OF WORK
SP A.4 – PUBLIC SAFETY AND CONVENIENCE
SP A.5 – COMPLETION DATE
SP A.6 – PERFORMANCE GUARANTEE OF WORK
SP A.7 – WORK DAYS AND HOURS
SP A.8 – INCIDENTAL WORK
SP A.9 – PRE-CONSTRUCTION MEETING
SP A.10 – NOTIFICATION
SP A.11 – CONTROL OF MATERIALS

SAFETY

SP S.1 – TRAFFIC CONTROL AND PROTECTION
SP S.2 – RESPONSIBILITY FOR CONSTRUCTION SAFETY, SHORING AND CONSTRUCTION METHODS
SP S.3 – LOCATION OF UTILITIES

HOUSEKEEPING/SOIL EROSION & SEDIMENT CONTROL

SP H.1 – SOIL EROSION CONTROL
SP H.2 – DUST CONTROL AND DIRT ON PAVEMENT
SP H.3 – CLEANING ALL STRUCTURES
SP H.4 – HEAVY CLEANING OF SEWERS
SP H.5 – DISPOSAL OF DEBRIS AND EXCAVATED MATERIAL

GENERAL

SP G.1 – MOBILIZATION
SP G.2 – WATER FOR CONSTRUCTION PURPOSES
SP G.3 – SURFACE RESTORATION
SP G.4 – REMOVAL / ABANDONING OF SEWERS AND/OR WATER MAINS
SP G.5 – STORM, SANITARY AND WATER STRUCTURES TO BE ABANDONED
SP G.6 – TRENCH BACKFILL, PIPE BEDDING, AND COVER
SP G.7 – COMPACTION REQUIREMENTS
SP G.8 – TRENCHLESS PIPE INSTALLATION
SP G.9 – PIPE AND PRE-CAST CONCRETE STRUCTURES MATERIAL TESTS
~~SP G.10 – STRUCTURE TAPS~~
SP G.11 – MAILBOX REMOVAL AND REINSTALLATION
~~SP G.12 – FIBER OPTIC CONDUIT~~
SP G.13 – EXPLORATORY EXCAVATION
~~SP G.14 – REMOVE AND PLUG ABANDONED WATER SERVICES~~
SP G.15 – TREE TRIMMING
SP G.16 – TREE ROOT PRUNING

INDEX TO SPECIAL PROVISIONS

Provision *Title*
Number

SANITARY SEWERS

SP SN.1 – PVC PIPE MATERIAL AND TESTING
~~SP SN.2 – CUT PROTRUDING TAP IN SANITARY SEWER~~
SP SN.3 – CURED IN PLACE SANITARY SEWER LINING
~~SP SN.4 – SANITARY SEWER~~
SP SN.5 – SANITARY SERVICE CROSSINGS
SP SN.6 – SANITARY SERVICES AND TEE REPLACEMENT
~~SP SN.7 – SANITARY MANHOLES~~
~~SP SN.8 – TESTING OF SANITARY MANHOLES~~
~~SP SN.9 – CEMENT LINING OF INTERIOR WALLS~~
~~SP SN.10 – CHIMNEY REHABILITATION IN PAVEMENT~~
~~SP SN.11 – CHIMNEY REHABILITATION, NON PAVEMENT~~
~~SP SN.12 – CHIMNEY REPAIR~~
~~SP SN.13 – LID REPLACEMENT~~
~~SP SN.14 – FURNISH NEW FRAME AND LID~~
~~SP SN.15 – RESET EXISTING FRAME~~
~~SP SN.16 – REMOVE AND REPLACE MANHOLE BENCH~~
~~SP SN.17 – MANHOLE RECONSTRUCTION IN PAVEMENT~~
~~SP SN.18 – MANHOLE RECONSTRUCTION, NON PAVEMENT~~
SP SN.19 – CLOSED CIRCUIT T.V. INSPECTION
~~SP SN.20 – BYPASS PUMPING~~
~~SP SN.21 – PRESSURE TESTING SANITARY SEWER JOINTS~~
~~SP SN.22 – LOCATE AND TELEWISE SEWER LATERAL~~

WATER MAIN

SP W.1 – WATER MAIN INSTALLATION
SP W.2 – WATER SERVICE/WATER SERVICE RELOCATION
SP W.3 – WATER MAIN AND WATER SERVICE CROSSINGS
SP W.4 – WATER MAIN LOWERING
SP W.5 – GATE VALVE AND VALVE BOX FOR WATER MAINS
SP W.6 – VALVE IN VALVE VAULT
SP W.7 – CONNECTIONS TO EXISTING WATER MAINS
SP W.8 – FIRE HYDRANT ASSEMBLY
SP W.9 – FIRE HYDRANT RELOCATE
SP W.10 – FIRE HYDRANT REMOVAL
SP W.11 – PRESSURE TESTING WATER MAINS
SP W.12 – PROTECTION AGAINST CORROSION

INDEX TO SPECIAL PROVISIONS

<i>Provision Number</i>	<i>Title</i>
-----------------------------	--------------

WATER MAIN (CONTINUED)

SP W.13 – FLUSHING OF WATER MAINS

SP W.14 – REQUIREMENTS OF CHLORINE

SP W.15 – LINE STOP

SP W.16 – DIRECTIONAL DRILLING WATER MAIN INSTALLATION

SP W.17 – CURED IN PLACE WATER MAIN LINING

RESTORATION

SP R.1 – SAW CUTTING

SP R.2 – TEMPORARY DRIVEWAY SURFACE, AND TEMPORARY PAVEMENT SURFACE

SP R.3 – HOT MIX ASPHALT PAVEMENT REMOVAL AND REPLACEMENT

SP R.4 – HOT-MIX ASPHALT PAVEMENT SURFACE COURSE

SP R.5 – PCC DRIVEWAY PAVEMENT REMOVAL AND REPLACEMENT

SP R.6 – HOT MIX ASPHALT DRIVEWAY PAVEMENT REMOVAL AND REPLACEMENT

SP R.7 – COMBINATION P.C.C. CURB AND GUTTER

SP R.8 – PCC SIDEWALK REMOVAL AND REPLACEMENT, 5” AND DETECTABLE WARNINGS

SP R.9 – ~~AGGREGATE SHOULDER~~

SP R.10 – SEEDING – AURORA MIX

CITY OF AURORA SPECIAL PROVISIONS

Revised 12/2020

The following Special Provisions supplement the General Specifications, the Illinois Department of Transportation's Standard Specifications For Road and Bridge Construction (herein after called the Standard Specifications), the City of Aurora's Standard Specifications for Improvements, the Supplemental Specifications and Recurring Special Provisions, the Standard Specifications for Water And Sewer Main Construction in Illinois, Seventh Edition, the Standard Specifications for Traffic Control Items, Part 890 of the Illinois Plumbing Code (77 IL Admin Code 890.1150) and the latest edition of the Manual on Uniform Traffic Control Devices for Streets and Highways and the Illinois Supplement to the National Manual on Uniform Traffic Control Devices in effect on the date of invitation for proposals. These special provisions apply to and govern the proposed improvement designated as the **San Souci Water Main Improvements, Bid 21-34** and in case of conflict with any part or parts of said specifications; these Special Provisions shall take precedence and shall govern.

DESCRIPTION OF PROJECT:

Water main improvements in the San Souci Subdivision west of Orchard Road consisting of a Base Bid and an Alternate Bid.

The Base Bid shall be comprised of the installation of 5,810 LF of 8" ductile iron water main and 920 LF of 8" NSF 61 water main lining and other miscellaneous appurtenances all in accordance with the plans and specifications. Lakeview Court and North Queensbury Court will be lined in the Base Bid with the ends of these courts being open cut.

The Alternate Bid shall be comprised of the installation of 740 LF of 8" ductile iron water main and 6,120 LF of 8" NSF 61 water main lining and other miscellaneous appurtenances all in accordance with the plans and specifications. All locations will be lined with the exception of the ends of courts, water main connections and eliminating 90-degree bends at a few court entrance locations.

The start date for lining is anticipated to be September 13th to allow for cooler weather for temporary water services. If the Base Bid is awarded, construction may begin in August. The bid is scheduled to be awarded at the July 13th City Council Meeting.

The City of Aurora reserves the right to award the bid for either the Base Bid or Alternate Bid based on the best interests of the City which may not be the lowest bid option.

All questions shall be received by June 4th, 2021 so that an addendum can be issued by June 7th, 2021. No questions will be answered after June 4th, 2021.

SP A.1 – ALTERATIONS TO PROJECT BY ENGINEER

The Engineer reserves the right to alter the plans and details, extend or shorten the improvement, add such work as may be necessary, increase or decrease the quantities of work to be performed, and/or eliminate entire pay items all in accordance with Section 104 of the Standard Specifications, except that the Contractor shall not be entitled to additional compensation or lost profits in the event that quantities are reduced below the original contract quantities, or in the event pay items are deleted entirely.

SP A.2 – ITEMS ORDERED BY ENGINEER

When additional work not included in the contract, is requested in writing by the Engineer, this additional work
Bid Number 21-34

shall be measured and paid for in accordance with Sections 104 and 109 of the IDOT Standard Specifications, as modified by these special provisions.

Payment for all additional work ordered by the Engineer in writing, which is deemed by the Engineer to be eligible for payment and is not covered by the contract, shall be made from the allowance included in the contract under ITEMS ORDERED BY ENGINEER. The Contractor shall not be entitled to any additional compensation in the event that utilization of this allowance, either in whole or in part, is not required to complete the work.

SP A.3 – RESPONSIBILITY OF WORK

During the progress of the work the Contractor shall assume total risk and liability, and will be responsible for any and all damages to the work, or to persons, or to public or private property caused by, or in any way resulting from doing the work, including actions of Subcontractors or Material Suppliers.

SP A.4 – PUBLIC SAFETY AND CONVENIENCE

The Contractor shall maintain drives, entrances, and side roads along the proposed improvement to allow emergency and local vehicle access to all adjacent properties. This access should not allow the passage of non-local vehicular traffic, which should abide by the approved traffic control plan. Interference with traffic movements and inconvenience to abutting property owners and the public shall be kept to a minimum. The Contractor shall maintain at least one lane open to traffic at all times for emergency vehicles on all streets affected by the construction of these improvements. Adequate use of flaggers and other traffic control devices shall be used to permit such arrangements during working hours. The Contractor shall remove and reinstall all street signs in conflict with the proposed improvements. All signage required for the proper control of traffic (i.e.: stop signs, yield signs, etc.) must be maintained on a temporary basis until the permanent sign can be reinstalled. **If the project is located in a business district, then business open signs shall be posted and maintained during construction.**

This work shall not be paid for separately, but shall be considered incidental to TRAFFIC CONTROL AND PROTECTION.

SP A.5 – COMPLETION DATE

The Contractor agrees to execute a contract and a contract bond satisfactory to and in the form prescribed by the City in the penal sum of the full amount of the contract, guaranteeing the faithful performance of the work in accordance with the terms of the contract within **fifteen (15)** days after notice of award of the contract.

The Contractor further agrees to begin work not later than **ten (10)** calendar days after the execution and approval of the contract and contract bond, unless otherwise provided, and to prosecute the work in such a manner and with sufficient materials, equipment, and labor as will ensure its completion within the time limit specified herein, it being understood and agreed that the completion within the time limit is an essential part of the contract.

The Contractor shall schedule their construction operations in such a manner so as to meet the following completion deadlines:

- **Obtain Substantial completion of the entire project by November 5th, 2021.**
- **Obtain Final completion of the entire project by November 19th, 2021.**

Substantially complete shall mean the completion of all work except for the installation of the final HMA surface and minor punch list items.

Final completion shall be obtained when all the work in all respects has been completed; including the final HMA

surface course, punch list work, and landscaping.

Special attention is called to Article 108.10 of the Standard Specifications for Road and Bridge Construction and shall be strictly adhered to, in the event the Contractor fails to complete the project by the above-mentioned guidelines. Liquidated damages shall be assessed per **Working Day** for failure to meet the above deadlines.

The Contractor shall not discontinue progress towards the completion of the work until “Final Completion” has been obtained. This provision will be strictly enforced whether or not the abovementioned completion deadlines are being met. The Contractor shall be assessed liquidated damages for every working day that work is not being performed on the project.

Underground utilities shall not be installed between October 31st and April 1st the following year.

Deadline extensions shall not affect the underground utility shutdown dates. Underground work to be performed after October 31st shall be postponed until April 1st the following year. Restoration pertinent to utilities installed prior to October 31st shall be completed November 15th of the same year.

SP A.6 – PERFORMANCE GUARANTEE OF WORK

If after the approval of final payment for each class of work and prior to the expiration of 1 year after the date of approval of said final payment, or such longer period of time as may be prescribed by law or by terms of any applicable special guarantee required by the Contract Documents, any work is found to be defective, the Contractor shall promptly, without cost to the Owner and in accordance with written directions of the Owner, remove it from the site and replace it with non-defective work to the satisfaction of the Engineer.

Failure of the Contractor to complete or to remedy defective work within a reasonable time (not to exceed 30 days of notice to Contractor in any event) shall be deemed a default and the Owner may take steps as it deems necessary to complete or remedy said work and charge the cost thereof to the Contractor.

SP A.7 – WORK DAYS AND HOURS

The allowed hours of work are between 7:00 AM and 7:00 PM, Monday through Friday, and between 8:00 AM and 5:00 PM on Saturdays. No work shall be done on Sundays or Holidays.

Equipment shall not be started before 6:45 AM.

SP A.8 – INCIDENTAL WORK

All work required to install the improvements shown or called for on the plans and in the specifications, shall be incidental to the various bid items in the proposal even though a specific item is not shown, and no additional compensation shall be made to the Contractor, unless it is indicated that additional payment will be allowed or a unit price is provided for said work in the contract.

SP A.9 – PRE-CONSTRUCTION MEETING

A pre-construction meeting shall be held prior to start of construction after execution of the contract documents. The Engineer shall establish the time and place of the pre-construction meeting. At this time, the Contractor shall be required to furnish and/or discuss the following:

- Written progress schedule/Completion Deadline.
- Names of Subcontractors and Material Suppliers.

- Names of Project Manager and/or Field Supervisor, including the name and phone number of a responsible individual who can be reached twenty-four (24) hours per day, seven (7) days per week.
- Notifications
 - Notify the Engineer 72 hours prior to the start of the project.
 - Notify Water and Sewer Maintenance Division 48 hours prior to any water main shutdown.
- General cleanup of the work site at the end of each day. The Contractor must have a water meter and hoses, or water truck on site prior to the start of excavation. Contractors and their sub-contractors will not be allowed to obtain water from private property.
- Granular trench backfill, method and equipment used for compaction.
- CCDD requirements/tickets
- Protection of existing pavement and placement of cold patch. The Contractor must be prepared to place temporary pavement within the same day of removing the existing pavement.
- Driveway access
- Landscape restoration
- A J.U.L.I.E status for the project site, scheduled by the Contractor, prior to commencement of any work.

Upon receipt of the notice of the award, the Contractor shall prepare a traffic control plan and project schedule setting forth the hours and days of operation for each task required by the contract. The project schedule shall be reviewed, and revised as required, and submitted with each payment request and/or request for extension of time.

SP A.10 – NOTIFICATION

The Contractor shall notify the Engineer a minimum of three (3) working days (72 hours) prior to starting the project, and a minimum of two (2) working days (48 hours) prior to starting each different type of work.

Parking

The Contractor shall supply and post "No Parking" signs on thirty-six inch (36") high lath or mounted on barricades every fifty feet (50'), two feet (2') from the back of curb or edge of pavement, at least two (2) working days (48 hours) prior to work in the affected area. The Contractor shall contact the City of Aurora Police Department (630-256-5000) prior to placing "No Parking" signs. "No Parking" signs only need to be installed in areas of existing parking.

The supply and posting of "No Parking" signs and all other notifications to various local agencies, residents, or businesses shall not be paid for separately, but shall be considered incidental to the project.

Roadway

The Contractor shall notify the ENGINEER twenty-four (24) hours prior to the closure of any road so that the Aurora Police and Fire Departments, the appropriate School District, and the Pace Bus Service can be notified appropriately.

Water

Should it be necessary, the Contractor shall notify the ENGINEER to request a shut-down of existing water supply a minimum of forty eight (48) hours in advance.

The Contractor shall hand deliver written notice to all residences and/or businesses a minimum of twenty-four (24) hours prior to shutting down water mains or affecting continuous water supply.

The Contractor shall notify the ENGINEER a minimum of twenty four (24) hours in advance of exposing or disturbing any potential lead water service lines to allow the ENGINEER to obtain the required risk notification

paperwork.

Sanitary

The Contractor shall make every effort to maintain sewer service usage throughout the duration of the project. In the event that a connection will be out of service, the longest period of no service shall be 8 hours. A public notification program shall be implemented, and shall at a minimum, require the Contractor to be responsible for contacting each home or business connected to the sanitary sewer and informing them of the work to be conducted, and when the sewer will be off-line. The Contractor shall also provide the following:

1. Written notice to be delivered to each home or business at least 48 hours prior to the beginning of work being conducted on the section, and a local telephone number of the Contractor they can call to discuss the project or any potential problems.
2. Personal contact with any home or business, which cannot be reconnected within the time stated in the written notice.

SP A.11 – CONTROL OF MATERIALS

All material used shall meet the requirements of the Illinois Department of Transportation, the Standard Specifications for Water and Sewer Main Construction in Illinois, the City of Aurora Standard Specifications for Improvements, and as outlined in these specifications.

All materials will be inspected, tested, and approved by the Engineer before incorporation into the work. The Contractor shall provide the City with letters of certification from each supplier when requested.

Any work in which untested and unacceptable materials are used without approval or written permission from the Engineer shall be performed at the Contractor's risk and may be considered as unacceptable and unauthorized and will not be paid for.

SP S.1 – TRAFFIC CONTROL AND PROTECTION

Traffic control shall be in accordance with the applicable sections of the Standard Specifications for Road and Bridge Construction, the Recurring Special Provisions and Supplemental Specifications, the Manual on Uniform Traffic Control Devices for Streets and Highways and the Illinois Supplement to the National Manual on Uniform Traffic Control Devices, and any special details and Highway Standards contained herein and in the Traffic Specifications or Highway Specifications. Special attention is called to Article 107.09 of the Standard Specifications for Road and Bridge Construction.

The Contractor shall submit to the Engineer a Traffic Control Plan for approval by the Engineer. The Contractor shall adhere to the approved Traffic Control Plan. The Contractor shall obtain written approval from the Engineer forty-eight (48) hours in advance of the implementation of any and all alterations or deviations from the Traffic Control Plan.

All orange signs used shall be fluorescent orange in color. Deteriorated, damaged, or signs with non-original material on the front surface will not be allowed.

Prior to the start of work the Contractor shall have a sufficient number of barricades, signs, and flagmen at the jobsite for the scheduled work. If satisfactory traffic control as determined by the Engineer is not in place, the Engineer shall order the work to be halted. Traffic control devices shall not be removed without prior written notice and approval of the Engineer.

The Contractor shall obtain, erect, maintain, and remove all signs, barricades, flagmen, and other traffic control

devices as may be necessary for the purposes of regulating, warning, or guiding traffic. The supplying, installation, and maintenance of traffic control and protection shall be paid for at the contract unit price per LUMP SUM (LS) for TRAFFIC CONTROL AND PROTECTION.

Pavement marking removal may be included in the contract. The Contractor shall coordinate pavement marking removal with the Engineer. Pavement marking removal shall be paid for at the contract unit price per SQUARE FOOT (SF) for PAVEMENT MARKING REMOVAL.

Temporary pavement marking may be included in the contract. The Contractor shall coordinate temporary pavement marking with the Engineer. Temporary pavement marking shall be 4-inches wide and paid for at the contract unit price per FOOT (FT) for TEMPORARY PAVEMENT MARKING – YELLOW, or TEMPORARY PAVEMENT MARKING – WHITE. Temporary pavement marking for words and symbols shall conform to the sizes and dimensions specified in the Manual on Uniform Traffic Control Devices standards and shall be paid for at the contract unit price per SQUARE FOOT (SF) for TEMPORARY PAVEMENT MARKING – LETTERS AND SYMBOLS.

SP S.2 – RESPONSIBILITY FOR CONSTRUCTION SAFETY, SHORING AND CONSTRUCTION METHODS

The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions for the safety of; and shall provide the necessary protection to prevent damage, injury or loss to:

- (a) All employees on the work and other persons who may be affected thereby.
- (b) All work and materials or equipment to be incorporated therein, whether in storage on or off the site.
- (c) Other property at the site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.

The Contractor shall be responsible for complying with all applicable laws, ordinances, rules, regulations, and orders of any public body having jurisdiction for the safety of persons or property or to protect them from damage, injury, or loss. The Contractor shall be responsible for erecting and maintaining, as required by the conditions and progress of the work, all necessary safeguards for its safety and protection, including tight sheeting or shoring of the trench. He shall notify owners of adjacent utilities when prosecution of the work may affect them. All damage, injury, or loss to any property referred to in paragraph (a) or (b) caused, directly or indirectly, in whole or in part, by any Contractor or Subcontractor or anyone directly or indirectly employed by any of them, or anyone for whose acts any of them may be liable, shall be remedied by the Contractor. The Contractor's duties and responsibilities for the safety and protection of all work shall continue until such time as all the work is completed and acceptable. Any damages shall be repaired in a timely manner. Any and all interruptions of essential utilities such as water, electricity, or gas shall be corrected that same day and before the foreman leaves the site. (See Guarantee & Maintenance of Work for time of acceptance.)

The Contractor shall be responsible for coordinating with utility companies regarding the bracing or relocating of utility poles, and the relocation of any underground facilities.

The Engineer shall not be responsible for determining the Contractor's construction means or methods.

SP S.3 – LOCATION OF UTILITIES

The Bidder, before submitting a Bid, shall carefully examine the Proposal, Plans, Details, Specifications, and Special Provisions. The successful Bidder shall inspect in detail the site of the proposed work and be familiar with all the local conditions affecting the proposal and the detailed requirements of construction.

When existing structures, services, utilities, pipelines and improvements (both above and below ground) are shown on the plans, the locations shown are approximate only and are not guaranteed. Obstructions and improvements in addition to those shown on the plans may also be encountered in carrying out the work. The Contractor shall be responsible for carrying out all work under this contract without additional compensation for whatever condition is found above or below ground.

The Contractor shall notify all utility companies including the City of Aurora Electrical Department (630) 892-1415, Water and Sewer Department (630) 256-3710, local electric companies, local telephone and communications companies, local natural gas companies, and local cable TV companies, and appropriate school districts, a minimum of two (2) working days (forty-eight hours) prior to beginning any construction or preliminary borings. The Contractor shall have the responsibility to determine from the public utility companies and the City of Aurora Departments the locations of underground pipes, conduits, cables, or other surface or subsurface improvements adjoining or crossing the construction area.

The depth and alignment of the existing water mains and sewers are approximate and may vary in both alignment and depth between manholes and valves. The Contractor shall not be due any additional compensation in the event that the alignment of the sewers and water mains vary from what is shown on the plans. The call outs shown on the plans for the existing water mains are approximate and not guaranteed.

The Contractor shall be responsible for coordinating with utility companies regarding the bracing or relocating of utility poles, and the relocation of any underground facilities.

SP H.1 – SOIL EROSION CONTROL

If the size of the project warrants a Storm Water Pollution Prevention Plan (SWPPP), then the Contractor and their Subcontractors shall sign the necessary certification forms and follow the requirements of the SWPPP. The Contractor shall coordinate with the Engineer on correcting any deficiencies identified during inspections or Incidents of Non-compliance, and shall notify the Engineer of any changes to the SWPPP's erosion control plans.

This work shall consist of the supply and installation of soil erosion and sedimentation control devices in accordance with Article 280 of the Standard Specification for Road and Bridge Construction, the City of Aurora's Standard Specifications for Improvements, the Kane-DuPage Soil and Water Conservation District, the Illinois Environmental Protection Agency – Division of Water Pollution Control's NPDES Permit No. ILR10, and with the details within the construction drawings.

Prior to starting any excavation the Contractor shall be required to place ENGINEER approved inlet protection such as an inlet basket sized to fit that particular frame, or equal, in all curb structures in accordance with the Soil Erosion and Sediment Control Plan.

Silt fence shall be installed as shown on the plans in accordance with the details provided.

In the event that ground water is encountered during excavation, the Contractor shall provide dewatering filtration bags for each pump discharge line. The filtration bags shall be as manufactured by Dandy Products or approved equal.

Erosion and Sedimentation Control shall not be paid for separately, but shall be considered incidental to the contract. The supply and installation of inlet baskets shall be paid for at the contract unit price for EACH for INLET PROTECTION. The supply and installation of a filtration bag shall be paid for at the contract unit price per EACH for DEWATERING BAG. The supply, installation, and maintenance of silt fence according to the details included in the improvement plans shall be paid for at the contract unit price per LINEAL FOOT (LF) for SILT FENCE. All material used for erosion and sedimentation control shall be disposed of off-site along with all debris collected within the control devices. Disposal shall not be paid for separately and shall be considered incidental to the unit prices above.

SP H.2 – DUST CONTROL & DIRT ON PAVEMENT

The Contractor shall at all times be responsible for maintaining dust-free conditions. The Contractor shall clean the pavement of all dirt and debris **at the end of each day's operations**, and at other times as directed by the Engineer by means of high pressure washing or by mechanical sweeping. The Contractor shall provide for the control of dust as specified in Section 24 of the Standard Specifications for Water and Sewer Construction in Illinois, or by the uniform application of a dust control agent approved by the Engineer.

If City water is used for dust control, the Contractor must have a water meter and hoses on site prior to the start of any excavation.

If the Contractor does not meet the requirement of controlling dust and/or cleaning the pavement, within three (3) hours of notification by the Owner, the Owner shall make the necessary arrangements to control the dust and clean the pavement(s). The cost of such action will be deducted from any monies due or to become due to the Contractor. **Additionally, the City will deduct \$500.00 per day from monies due, or to become due, for each day that the Contractor fails to comply with this special provision. In addition, the Contractor will pay any penalties resulting from any Illinois Environmental Protection Agency, NPDES for Construction violations issued to the Owner.** Such sum to be charged not as a penalty but as liquidated damages. The parties agreeing that actual damages to the City of Aurora would be uncertain and difficult to calculate and the amount of such liquidated damages is a reasonable estimate of the supervision costs likely to be incurred by the City of Aurora as a result of the Contractor's failure to control dust and clean the pavement(s) as required.

Dust control and pavement cleaning shall be considered incidental to the cost of the contract and will not be paid for separately.

SP H.3 – CLEANING ALL STRUCTURES

Before final acceptance, all structures and staging areas that were occupied by the Contractor in connection with this work shall be cleaned of all rubbish, excess materials, and other foreign materials deposited or accumulated on or in the structures and areas. Cleaning all structures shall be considered incidental to the cost of the contract and will not be paid for separately.

SP H.4 – HEAVY CLEANING OF SEWERS

Heavy cleaning consists of using heavy cleaning equipment to remove large deposits of debris, root growth, mineral deposits, bricks, grease and others. Bucket machines, scrapers, augers and 120 gpm and higher jetting equipment can be utilized in this heavy duty cleaning. Where bucket machines and buckets are to be used, caution should be taken that a proper sized flexible cable be used so that breakage will not occur hanging the cleaning equipment up within the sewer lines.

Contractor shall be responsible for disposing all septic material removed from the heavy cleaning procedure to a permitted disposal facility. In no circumstance shall passing material from manhole to manhole be left unattended in the invert of the sewer. Such material must be removed immediately.

Contractor shall take all necessary precautions of not reducing the flow capacity of the sewers during the bucketing procedures. This can be accomplished by by-passing flows to downstream manholes.

The Contractor shall advise the Engineer 48 hours prior to starting the heavy cleaning. If this work is subcontracted to others, the City will require approval of said Subcontractor.

The cost of heavy cleaning, which includes debris removal and disposal, bucketing, root removal and disposal, and all necessary and appurtenant work shall be included in the contract unit price per LINEAL FOOT (LF) for

HEAVY CLEANING OF SEWERS, and measured from centerline manhole to centerline manhole. The size of the sewers may vary from 8-inch to 24-inch diameter.

SP H.5 – DISPOSAL OF DEBRIS AND EXCAVATED MATERIAL

The Contractor shall be responsible for removal and disposal of all waste material, asphalt, grindings, concrete, stone, dirt or debris generated in the course of the work to a facility permitted to accept such waste. The Contractor shall load the removed pieces of curb and gutter, sidewalk, street pavement, trench excavation, etc. directly onto trucks, haul it away and dispose of it.

The temporary storing of excavated materials on the parkway and/or street and re-handling them later for disposal may be allowed on a limited basis with prior approval by the Engineer. Erosion control measures will be required when rain events are anticipated. This will not be eligible for payment as temporary staging and shall be included in the cost of the project.

Clean Construction and Demolition Debris

In addition to the requirements of Articles 107.01 and 669 of the Standard Specifications, the Contractor shall be responsible for the proper removal and disposal of excavated materials from the project site. The Contractor shall meet all the requirements set forth by the IEPA in regards to Clean Construction and Demolition Debris. The City of Aurora will provide all investigative work and testing required to meet the current CCDD requirements. The City of Aurora will provide the Contractor with signed IEPA forms for disposal.

This project is eligible for free CCDD disposal at the Heartland Recycling Facility at 213 Mettel Road, Aurora, IL (Heartland). As such, the Contractor shall be required to meet Heartland's requirements. In general, the guidelines are as follows:

- *PCC and HMA shall be in segments no larger than two foot in any one dimension*
- *PCC and HMA shall be transported separately from one another and from any other material to facilitate recycling operations at the facility*
- *Topsoil shall be separated from other materials to facilitate recycling*
- *Grass or other organic matter shall not compose a percentage of the load that exceeds current CCDD limits*
- *Excessively wet loads shall be mixed onsite prior to transport to the facility, or shall be stockpiled at an area designated by the City to sufficiently dry*
- *Any spoils containing a bentonite slurry are not CCDD approved; if such loads are required for the operations in this contract, the disposal of that material shall be considered included in the cost of that specific operation*

In addition to these requirements, the bidder is encouraged to complete their own investigation during the bidding process to determine if any additional requirements have recently been added by the facility; the awarded Contractor will be fully responsible for meeting all of Heartland's requirements. Failure to comply with the material acceptance procedures at Heartland will result in the assessment of "hard to handle" fees; the Contractor will not be compensated for any such fees should they be assessed. At any time, the Contractor may elect to use a different facility, provided it is an approved IEPA CCDD facility. The City will provide the Contractor with the necessary IEPA documents to facilitate this, however, no additional compensation will be provided should another facility be used during the course of this project for the disposal of CCDD eligible materials.

*Prior to commencement of construction, any exclusion zones that were identified during the PESA process shall be discussed, along with a procedure for addressing any potentially impacted materials. At no time is material within an exclusion zone, to be transported to Heartland. Further, the Contractor should immediately alert the City if potentially impacted material is encountered outside of any identified exclusion zones. All potentially impacted material, or material rejected by Heartland shall be stockpiled in an area designated by the City; that area will be within 5 miles from the project site. **THE INITIAL TRANSPORT OF MATERIAL, EITHER TO THE***

CCDD FACILITY OR TEMPORARY STAGING SITE SHALL BE CONSIDERED INCLUDED IN THE COST OF THE OPERATION GENERATING THE SPOILS.

Material taken to the temporary staging facility will be further tested by the City to determine the appropriate disposal process. After such testing is completed, the Contractor will be compensated as follows:

- **Temporary Staging** – The Contractor will be paid by the cubic yard to transport the material to Heartland. This material is generally classified as material that has been stockpiled temporarily, but based on additional testing meets the requirements for disposal at Heartland. Should the Contractor elect to work on a day when the Heartland Facility is closed, any temporary staging shall not be paid for, but shall be considered included in the cost of the item generating the spoil material.
- **Non-Special Waste Disposal** – Based on the results of additional testing, the Contractor will be paid per ton (based on tickets as provided by the receiving facility) to transport the material and pay any fees assessed by the receiving facility; this dollar amount shall be as contained within the contract, or as otherwise established utilizing an AUP or on a Time and Material Force Account basis.
- **Special Waste Disposal** – Based on the results of additional testing, the Contractor will be paid per ton (based on tickets as provided by the receiving facility) to transport the material and pay any fees assessed by the receiving facility; this dollar amount shall be as contained within the contract, or as otherwise established utilizing an AUP or on a Time and Material Force Account basis.

The bidders shall take note of exclusion zones that may be limited to certain depths. If exclusion zones only compose a certain range of depth within an excavation, the awarded Contractor will be required to excavate the material such that only the excluded material is taken to the temporary staging area and only the approved material is taken to Heartland.

To expedite the process for utilizing Heartland and avoid any tipping fees, the City has developed a process with Heartland, as follows:

City Voucher Program at Heartland Recycling

After award, the City will provide information regarding the awarded Contractor to Heartland. It will be the sole responsibility of the Contractor to contact Heartland to provide a certificate of insurance and to complete any additional registration.

The City will provide vouchers for use at Heartland that expire at the end of that day; the vouchers will be stamped and sealed by the Engineer. Only vouchers that are signed and have the current date will be accepted by Heartland; trucks without a voucher or trucks with outdated vouchers will be turned away and will not be permitted to dump until they return with a valid voucher.

Heartland continually monitors all incoming loads to ensure the origin of the material and will work with the City to identify any potential misuse of the vouchers. Contractors that are found to misuse the vouchers will be subject to penalties as assessed by Heartland, up to and including being banned from using the facility. **Should a potential bidder not have the right to utilize Heartland due to an existing ban and they wish to obtain additional work within the City, no additional compensation will be provided for dump fees at another CCDD facility. Additionally, should any voucher misuse occur during a project resulting in a ban of that Contractor, no compensation will be provided if a different CCDD facility is utilized for the disposal of the remaining material for the project.**

SP G.1 – MOBILIZATION

This item consists of transportation and set up of various equipment necessary to any and all locations for the project, as well as the break down and removal of the same equipment.

This item shall be considered incidental to the contract and will not be paid for separately.

SP G.2 – WATER FOR CONSTRUCTION PURPOSES

City water for construction purposes will be available to the Contractor at his cost according to the prevailing rates in effect at the time. Contractors and their sub-contractors will not be allowed to obtain water from private property. The Contractor shall secure a city water meter by presenting a deposit for \$1,600.00 in the form of a certified check made out to The City of Aurora to the Water Billing Department on the First Floor of 44 E. Downer Place, Aurora, Illinois. The name of the Contractor and their Tax ID number will be required. The Contractor will take the resulting forms to the Water & Sewer Maintenance Division located at 649 S. River Street where the city water meter shall be provided. The Contractor and/or sub-contractor will be fined, according to ordinance, which will be deducted from moneys due, for each unauthorized use of City water regardless of the amount of water used or the reason for unauthorized use.

SP G.3 – SURFACE RESTORATION

The Contractor shall be responsible for performing any surface restoration required due to damages caused by storing material and/or equipment outside the areas to be excavated. The surface restoration shall be performed in accordance with the plans and specifications or as directed by the Engineer and shall be at the Contractor's expense.

SP G.4 – REMOVAL / ABANDONING OF SEWERS AND/OR WATER MAINS

This work shall consist of abandoning existing sewers and water mains at the locations shown on the Plans or as directed by the Engineer in the field. Existing sewers and structures shall be removed at the location of conflict with new construction and removed at the point of connection with the existing sewer or manhole that is to remain. The Contractor shall not be required to excavate and remove sewers and water mains that are to be abandoned that fall outside the limits of excavation for the new improvements.

Ends of the abandoned pipes and openings in the existing sewers and manholes to remain shall be plugged with brick and mortar. At locations where the sewers are to be disconnected from manholes that are to remain in place, the Contractor shall plug the sewer from the inside of the manhole with brick and non-shrink mortar a minimum of 12" thick. The plugging of pipe openings to be abandoned within the vicinity of manholes to remain in place as identified on the plans shall be paid for at the contract unit price per EACH as MANHOLE INVERTS TO BE BRICK AND MORTARED.

For pipes that are to be disconnected from existing sewers that are to remain, the Contractor shall abandon the existing connection by one of the methods below:

- The Contractor shall excavate and disconnect the sewer to be abandoned from the sewer to remain. The Contractor shall excavate and remove the pipe and/or tee at the location of the pipe to be disconnected and replace in accordance with the Sanitary Sewer Removal and Replacement special provisions.
- The Contractor shall install a cured in place internal pipe liner to cover the existing opening to be abandoned. The internal pipe liner shall be installed in accordance with these specifications.

For services and tees being disconnected from existing brick sewers, the Contractor shall abandon the existing connection by removing the pipe and/or tee at the location of the connection and shall patch the opening in the existing sewer to remain with brick and non-shrink grout. When the limits of the disconnection fall outside the limits of the excavation for new improvements the Contractor shall be paid at the contract unit price as specified below.

For water mains that are to be disconnected from existing water mains that are to remain, the Contractor shall excavate and disconnect the pipe to be abandoned. If the pipe to be abandoned is connected to the water main to remain via a tee, the tee shall be removed along with a minimum of 2 feet of pipe and replaced with class 52,

cement lined DIP along with ductile iron sleeves of the same diameter as the existing piping. If the water main to be removed is connected to the water main to remain via a cross, the pipe shall be removed from the cross and replaced with a DIP plug.

The plugging and/or removal of existing sewers and water mains and connections within manholes or within areas identified in the plans for excavation shall not be paid for separately, but shall be considered incidental to the contract. The removal and disposal of existing sewers and water mains in order to facilitate the installation of new improvements, shall not be paid for separately, but shall be considered incidental to the contract.

The plugging and/or removal of existing sewer and water mains and connections not within the vicinity of manholes or planned excavated areas as identified on the plans shall be paid for at the contract unit price per EACH as ABANDON EXISTING SEWER PIPE CONNECTION or ABANDON WATER MAIN CONNECTION as appropriate, and shall include all equipment, labor, material, and select granular trench backfill necessary to complete the work. The removal and disposal of existing sewers and water mains in order to facilitate this pay item shall not be paid for separately, but shall be considered incidental to the contract. Surface restoration shall be paid for separately.

If any sewer or water main is called out on the plans or directed by the Engineer in the field to be filled with Controlled Low Strength Material (CLSM), the work shall be paid for at the contract unit price per CUBIC YARD (CY) for FILLING EXISTING SEWER OR WATER MAIN WITH CLSM.

SP G.5 – STORM, SANITARY, AND WATER STRUCTURES TO BE ABANDONED

This work shall consist of all work necessary to abandon existing manholes, valve vaults, valve boxes and structures as shown on the Plans or as directed by the Engineer in the field.

All valve boxes on water mains to be abandoned shall be removed by the Contractor.

In the case where the existing structure is to be removed and replaced or is in-line with the trench of the proposed infrastructure, the existing structure shall be completely removed. If the existing structure is deeper than the proposed infrastructure, then the extra excavation volume will be compensated by using the Unsuitable Soil Removal and Replacement pay item. Otherwise, the cost for removal of this existing structure shall be considered incidental to the installation cost of the proposed infrastructure.

The abandonment of a structure shall include removal of the casting and cone section and proper disposal offsite. All pipe connections shall be securely sealed water tight with concrete bricks and mortar 12" thick and the structure shall be filled with selected CA-7 granular trench backfill and mechanically compacted or jetted. Restoration of abandonment surface shall be paid for separately.

This work shall be paid for at the contract unit price per EACH for STORM, SANITARY, AND WATER STRUCTURES TO BE ABANDONED, which shall include payment in full for removal and disposal of the structure, and supplying and installing selected granular trench backfill.

SP G.6 – TRENCH BACKFILL, PIPE BEDDING, AND COVER

All select granular material shall meet IDOT gradation specifications and shall be either crushed limestone, crushed concrete or crushed gravel. Material excavated as part of this project may be processed on site for re-use with approval from the Engineer at an agreed upon unit price.

Pipe Bedding

Pipe bedding shall consist of over-excavation of the trench bottom and refilling to proper grade in accordance with the trench backfill details included in the plans.

The cost of supplying and installing the aggregate bedding shall not be paid for separately, but shall be considered incidental to the project.

Haunching

Pipe Haunching shall consist of compacted aggregate for the full width of the trench to the spring line for the reinforced concrete pipe or ductile iron pipe and to one foot (1') above the top of the pipe for PVC pipe in accordance with the details included in these plans.

The cost of supplying and installing the aggregate haunching shall not be paid for separately, but shall be considered incidental to the cost of the pipe.

Trench Backfill

Trench backfill shall be placed in accordance with the Standard Specifications for Water and Sewer Main Construction in Illinois and the Trench Backfill Detail as shown on the plans.

Place Trench Backfill material to required elevations, for each area classification listed below:

Under grassed areas:

Satisfactory excavated or borrow material, approved by the Engineer.

Under pavements:

Select Trench Backfill of compacted CA-6 crushed limestone or CA-6 crushed gravel.

Place backfill materials evenly adjacent to structures or piping to required elevations. Take care to prevent wedging action of backfill against structures or displacement of piping by carrying material uniformly around structure of piping to approximately same elevation in each lift.

Compaction Jetting and Water Soaking

The holes through which the water is injected in the backfill shall be placed in a grid pattern at intervals of not more than four feet (4'). Additional holes shall be provided if deemed necessary by the Engineer to ensure adequate settlement. All holes shall be jetted and shall be carried to a point one foot (1') above the top of the pipe. Drilling the holes by means of augers or other mechanical means will not be permitted. Care shall be taken in jetting to prevent contact with or other disturbance to the pipe.

The water shall be injected at a pressure and rate sufficient to sink the holes at a moderate rate. After a hole has been jetted to the required depth, the water shall be injected until it begins to overflow the surface.

If the Contractor requests and receives approval to perform mechanical compaction in place of jetting all trenches, they shall be responsible for hiring and compensating a third party testing agency to verify that the minimum compaction requirements listed in the Standard Specifications for Water and Sewer Construction in Illinois and the Compaction Requirements special provision shall be met. Mechanical compaction shall be performed in accordance with the Standard Specifications for Water and Sewer Construction in Illinois.

Surface depressions resulting from backfill subsidence caused by compaction shall be filled and re-compacted by tamping or rolling to the satisfaction of the Engineer.

Measurement and Payment

The cost of supplying and installing the aggregate bedding and haunching shall not be paid for separately, but shall be considered incidental to the contract.

The cost of supplying and installing the initial and final Select Granular Trench Backfill shall be paid for at the contract unit price per CUBIC YARD (CY) for SELECT GRANULAR TRENCH BACKFILL. Section 20 of the Standard Specifications for Water and Sewer Main Construction in Illinois shall be used to determine the quantity of Select Trench Backfill that will be eligible for payment. The depth used for the purposes of calculating the quantity of trench backfill that is eligible for payment shall be from the top of the haunching to the bottom of the

bituminous pavement patch.

SP G.7 – COMPACTION REQUIREMENTS

The Contractor shall control soil compaction during construction in order to provide the minimum percentage of maximum or relative density as specified for each area of classification indicated below:

Percentage of Maximum Density Requirements

Compact soil to not less than the following percentages of maximum density for soils which exhibit a well-defined moisture density relationship (cohesive soils) determined in accordance with ASTM D 1557; and not less than the following percentages of relative density, determined in accordance with ASTM D 2049, for soils which will not exhibit a well-defined moisture-density relationship (cohesionless soils).

Pavement, Drives, and Sidewalks

Compact the top twelve inches (12") of sub-grade and each layer of backfill material at 95% of the materials maximum density at optimum moisture content as determined by the modified proctor test.

Lawn or Unpaved Areas

Compact the top six inches (6") of sub-grade and each layer of backfill material at 85% maximum density for cohesive soils and 90% relative density for cohesionless soils.

Moisture Control

Where sub-grade and each layer of soil material must be moisture conditioned before compaction, uniformly apply water to surface of sub-grade, or layer of soil material, to prevent free water appearing on surface during or subsequent to compaction operations.

SP G.8 – TRENCHLESS PIPE INSTALLATION

This work shall consist of installing pipe via trenchless techniques. The Contractor shall be responsible for determining the most efficient and effective method for the trenchless installation of the proposed improvements. The work shall include all labor, material, equipment, excavation, hauling and disposal of spoils, sheeting, shoring, dewatering, concrete barrier wall around jacking pit, casing pipe if called out on the plans or if required by the installation method chosen by the Contractor, carrier pipe, and casing spacers required to perform the trenchless installation of the pipe in accordance with the plans and specifications.

The Contractor shall submit a detailed description of the method(s) to be used to perform the trenchless installation of the improvements. The method(s) to be proposed by the Contractor must take into account the presence of existing utilities, soil conditions, ground water, space constraints, existing manmade improvements both below and above ground, such as vaults, building foundations, transformers, utility poles, traffic control devices, underground utilities, the proposed line and grade of the pipe, and other unique characteristics of the proposed work and work site.

The Contractor shall be responsible for excavating and exposing all private utility, sanitary and water service crossings to inspect the crossing and the state of the service after it has been crossed. The cost of this action will be incidental to the cost of the trenchless pipe installation.

The Contractor shall be responsible for placing concrete barrier walls around the jacking pit.

The steel carrier pipe shall have a minimum 0.312 inch wall thickness and have a coal tar epoxy coating applied to the exterior or as specified in the plans.

This work shall be paid for at the contract unit price per FOOT (FT) for TRENCHLESS PIPE INSTALLATION of the type and size specified.

Bid Number 21-34

SP G.9 – PIPE AND PRE-CAST CONCRETE STRUCTURES MATERIAL TESTS

All pipe and pre-cast concrete structures shall be tested and inspected for compliance with the appropriate A.S.A., A.S.T.M., and Manufacturer's Specifications by a reputable Testing Company approved by the Engineer. Prior to delivering pipe and pre-cast concrete structures to the job site, all approved pipe and pre-cast concrete structures shall be marked by the testing company and two (2) copies of the satisfactory test reports shall be provided to the Engineer if requested. Any pipe or pre-cast concrete structure delivered to the site without proper markings or without test reports in the possession of the Engineer will be rejected for use.

SP G.11 – MAILBOX REMOVAL AND REINSTALLATION

This work shall consist of removing mailboxes which will conflict with proposed improvements, reinstalling them temporarily on the same day that they are removed in a location that will not conflict with the construction activities, and reinstalling the mailboxes in their original locations once the construction activities have ended.

The Contractor shall take due care to avoid damaging mailboxes when removing the mailboxes and reinstalling them in the temporary and permanent location. The Contractor shall supply and install new mail box posts when reinstalling the mail box back in its original location. The Contractor shall replace damaged mailboxes at his expense.

This work shall be paid for at the contract unit price per EACH for MAILBOX REMOVAL AND REINSTALLATION, which shall include the material and labor necessary to reinstall the existing mail box on a new mailbox post if the post was deemed damaged during removal.

SP G.13 – EXPLORATORY EXCAVATION

This work shall consist of excavating exploratory trenches in pavement for the purpose of ascertaining the horizontal and vertical alignment of existing underground utilities within the construction limits of the proposed improvements. A symbol may be shown on the Plans to identify the approximate location of the exploration trench. The Engineer may require the Contractor to perform exploration trenches not shown on the Plans.

The work shall be done a minimum of one (1) week prior to the start of the construction of the proposed improvement. The trench shall be of sufficient length and depth to obtain the horizontal and vertical location and size of the underground utility. After the hole has been inspected by the Engineer, the Contractor shall backfill the hole with selected granular trench backfill and shall place temporary pavement.

This work shall be paid for at the contract unit price per FOOT (FT) for EXPLORATORY EXCAVATION of the depth specified. This unit price shall include all necessary saw cutting, pavement removal, excavation, removal of spoil off-site, backfilling, and placement of temporary pavement if necessary.

SP G.15 – TREE TRIMMING

Tree trimming may be required to allow room for construction equipment to move and swing overhead. In the event tree trimming is needed, the homeowner where the tree is located shall be notified that their tree will require trimming and the date that the trimming is scheduled to occur. **Tree trimming required for construction shall not be paid for separately, but shall be considered incidental to contract.**

SP G.16 – TREE ROOT PRUNING

All work, materials and equipment shall conform to Section 201.06 (a) of the Standard Specifications for Road and Bridge Construction except as modified herein.

Fertilizer nutrients and supplemental watering after root pruning is performed shall not be required. Root pruning shall be paid for at the contract unit price per FOOT for TREE ROOT PRUNING and shall conform to Section 201 of the Standard Specifications for Road and Bridge Construction.

SP SN.1 – PVC PIPE MATERIAL AND TESTING

All PVC plastic pipe shall meet Fox Metro Water Reclamation District provisions and shall be installed and tested as follows:

Laboratory Test

Contractor shall submit certified copies of all reports of tests conducted by an independent laboratory before installation of PVC Plastic Pipe. Tests shall be conducted in accordance with Standard Method of Test for External Loading Properties of Plastic Pipe by Parallel-Plate Loading, ASTM Standard D2412. Tests shall also be conducted in accordance with ASTM D 3212 to demonstrate joint performance at 5% maximum diametric deflection of the spigot, as specified in Article 7.4 of ASTM D 3212.

Straightness

Maximum allowable ordinate as measured from the concave side of the pipe shall not exceed 1/16 inch per foot of length.

Internal Diameter

Pipe shall be so constructed that the initial internal vertical diameter does not decrease by more than 5% in order to provide the complete hydraulic carrying capacity conceived by the design engineer, and to obtain the joint performance at 5% maximum diametric deflection as specified in Article 7.4 of ASTM D 3212.

Pipe Installation and Field Testing

Pipe shall be installed in full compliance with the Recommended Practice for Underground Installation of Flexible Thermoplastic Sewer Pipe, ASTM Standard D2321. All pipes constructed of polyvinyl chloride (PVC) shall be subject to air exfiltration, deflection, vacuum and televising test. In addition to the construction and testing procedures outlined in other sections of the specifications, the Contractor shall be required to install the pipe in such a manner so that the diametric deflection of the pipe shall not exceed 5% and the materials surrounding the pipe shall be compacted to the required Standard Proctor Densities outlined in D 2321. The area requiring compaction shall include the bedding and haunching material and also the material placed above the pipe for a distance of 12 inches over the top of the pipe. The Engineer may require up to 10 random compaction tests to be completed by an independent laboratory. If any of these tests indicate that the material has not been compacted to the required density, the Contractor shall re-compact said material at no additional cost to the Owner, and the Engineer shall then have the right to require additional compaction tests to ensure that this or other material is compacted to the proper density without any additional cost to the Owner.

Final Acceptance

All pipelines constructed of flexible materials shall be measured for vertical ring deflection at least 30 days after completion of the backfill. Maximum ring deflection of the pipeline under load shall be limited to 5 percent of the vertical internal pipe diameter. All pipe exceeding this deflection shall be considered to have reached the limits of their serviceability and shall be re-laid or replaced by the Contractor at no additional cost to the Owner.

The cost of all deflection testing shall be borne by the Contractor and shall be accomplished by using a deflectometer, which will produce a continuous record of pipe deflection, or by pulling a mandrel, sphere, or pin-type go/no-go device through the pipeline. The diameter of the go/no-go device shall be 95 percent of the undeflected inside diameter of the flexible pipe.

Deflection testing shall not be required for PVC pipe installed as part of a spot repair. Deflection testing will be incidental but only required in the event that the sewer installation extends from manhole to manhole.

SP SN.3 – CURED IN PLACE SANITARY SEWER LINING

The Contractor shall be responsible for any and all damage to dwellings as a result of this work. This includes, but is not limited to, sanitary service backups and/or flooding as a result of jetting, light and heavy cleaning, and/or lining process.

This work shall consist of installing a cured in place pipe (CIPP) within sanitary sewers of various diameters at locations listed in the plans, and as may be directed by the Engineer. It is the intent of this section to provide for the reconstruction of pipelines and conduits by the installation of a resin-impregnated flexible tube that is inverted into the original pipeline/conduit and expanded to fit tightly against said pipeline/conduit. The resin system shall then be cured by steam pressure within the tube to a sufficient enough level for the initiators in the resin to effect a thermosetting reaction. The CIPP shall be continuous and tight fitting. This work shall include all required material and labor for all related aspects of work including but not limited to: by-pass pumping, public notification, traffic control, pre-cleaning, sewer televising pre-installation and post installation, testing, etc.

This Special Provision references American Society for Testing and Materials (ASTM) Standard Specifications F1216, D5813 and D790 and D2990 which are made a part hereof by such reference and shall be the latest edition and revision thereof. In case of conflicting requirements between this Special Provision and these referenced documents, this Special Provision shall govern.

The City has televised the sewers to be rehabilitated. The DVD and reports are included with this bid package. Bidders can examine this information for whatever value they consider it worth. However this information is not guaranteed (nor may it represent the current condition) and bidders are encouraged to perform their own investigations regarding the current condition of the sewers to be lined, location of services, and verify whether the services are active or inactive.

Cured-in-place pipe (CIPP): A hollow cylinder consisting of one or more layers of absorbent non-woven felt fabric surrounded by a cured thermosetting resin. This pipe is formed within an existing pipe. Therefore, it takes the shape of and fits tightly to the existing pipe.

Contractor shall install a resin impregnated flexible felt tube, inverted into the existing sewer line utilizing a vertical inversion standpipe and hydrostatic head for the reconstruction of sanitary sewer lines. Curing shall be accomplished by steam pressure or other approved method to cure the resin into a hard impermeable pipe. When cured, CIPP shall extend over the length of the inversion in a continuous tight fitting watertight pipe-within-a-pipe.

Materials: The tube should be compatible with the resin system used. The material shall be able to withstand installation pressures, have sufficient strength to bridge missing pipe and stretch to fit irregular pipe sections and negotiate bends. The material shall be fabricated to a size that when installed will neatly fit the internal circumference and the length of the original conduit. Allowance shall be made for circumferential stretching during inversion. Overlapped layers of felt in longitudinal seams that cause lumps in the final product shall not be permitted.

The outside layer of the tube shall be coated with an impermeable, flexible membrane that will contain the resin and allow the resin impregnation procedure to be monitored. The tube shall be homogeneous across the entire wall thickness containing no intermediate or encapsulated elastomeric layers. No material shall be included in the tube that may cause delamination in the cured CIPP. No dry or unsaturated layers shall be evident. Seams in the tube shall be stronger than the non-seamed felt material.

The resin system shall be a corrosion resistant polyester, vinyl ester or epoxy system including all required catalysts, initiators or hardeners that when cured within the tube create a composite that satisfies the requirements of ASTM F1216, the physical properties herein, and those which are to be utilized in the design of the CIPP for this project. The resin shall produce a CIPP that will comply with the structural and chemical resistance requirements for this specification. The finished CIPP shall be fabricated from materials which when cured will be chemically resistant to withstand internal exposure to domestic sewage.

Structural Requirements: The CIPP shall be designed per ASTM F1216 and conform to the minimum structural standards of ASTM F1216 listed below. The liner thicknesses shall be designed based on a partially deteriorated pipe with a safety factor of 2, an ovality of 8%, and a maximum external water head level 2' below grade. An H20 highway live load shall be used in the design calculations for each CIPP section. The CIPP design shall assume no bonding to the original pipe wall.

<u>CIPP</u>	<u>STANDARD</u>	<u>RESULTS</u>
Flexural Stress	ASTM D790	4,500 psi
Modulus of Elasticity	ASTM D790	400,000 psi
Flexural Modulus (50 Yr)	ASTM D790	200,000 psi
Tensile Strength	ASTM D638	3,000 psi

The tube shall have a relatively uniform thickness that when compressed at installation pressures will equal or exceed the calculated minimum design thickness. **The minimum installation thickness shall be 6 mm.**

The layers of the cured CIPP shall be uniformly bonded. It shall not be possible to separate any two layers with a probe or point of a knife blade so that the layers separate cleanly or the probe or knife blade moves freely between the layers. If the layers separate during the field sample testing, new samples will be required to be obtained from the installed pipe. Any recurrence may cause rejection of the work.

Any layers of the tube that are not saturated with resin prior to insertion into the existing pipe shall not be included in the structural CIPP wall thickness computation.

Safety: The Contractor shall carry out his operations in strict accordance with all OSHA and manufacturer's safety requirements. See also the included Safety Special Provisions. Particular attention is drawn to those safety requirements involving working with scaffolding and entering confined spaces.

Cleaning of Sewer Line: It shall be the responsibility of the Contractor to remove all internal debris out of the sewer line, included but not limited to, grease, gravel, mud, roots, solids, large deposits of debris, root growth, mineral deposits, bricks, grease, tuberculation, corrosion, damaged lining material and others to restore the pipe to its original inside pipe diameter. This work includes "light" cleaning and the cost of doing the work shall be incidental to the bid item.

Inspection of sewers: The inspection shall be performed by experienced personnel trained in locating breaks, obstacles and service connections, and able to identify excessive sanitary service flows by closed circuit television in accordance with Special Provision Closed Circuit T.V. Inspection. The Contractor shall be responsible for confirming the locations of all branch service connections.

Bypassing Sewage: Bypassing sewage shall be performed in accordance with the bypass pumping special provision and the cost of bypass pumping shall be incidental to the cost of the work on the pipe or manhole being bypassed.

Line Obstructions: There will be no point repair excavations. The Contractor shall remove any and all obstructions prior to the installation of the cured-in-place pipe liner, such as protruding service taps, root masses, mineral deposits, etc. Protruding taps or service connections shall be removed by cutting the protrusion flush with the pipe wall with a protruding tap cutter. In no circumstance shall the protrusion be broken off by mechanical means. All debris shall then be removed from the system and properly disposed of at a permitted disposal facility. This work shall be paid for at the contract unit price per EACH for CUT PROTRUDING TAP IN

SANITARY SEWER which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

Public Notification: The Contractor shall make every effort to maintain sewer service usage throughout the duration of the project. In the event that a connection will be out of service, the longest period of no service shall be 8 hours. A public notification program shall be implemented, and shall as a minimum, require the Contractor to be responsible for contacting each home or business connected to the sanitary sewer and informing them of the work to be conducted, and when the sewer will be off-line. The Contractor shall also provide the following:

1. Written notice to be delivered to each home or business at least 48 hours prior to the beginning of work being conducted on the section, and a local telephone number of the Contractor they can call to discuss the project or any potential problems.
2. Personal contact with any home or business, which cannot be reconnected within the time stated in the written notice.

Pipe Installation: Individual inversion runs can be made over one or more manhole sections.

The Contractor shall designate a location where the uncured resin in the original containers and the unimpregnated tube will be vacuum impregnated (wet-out) prior to installation. The volume of resin used shall be sufficient to fill the voids in the tube material at a nominal thickness and diameter. The volume shall be adjusted by adding excess resin for the change in resin volume due to polymerization and to allow for migration of resin into the cracks and joints of the original pipe. The Contractor shall allow the Owner to inspect the materials and wet out procedure. A resin and catalyst system compatible with the requirements of this method shall be used.

The wet out tube shall be inserted through an existing manhole or other approved access by means of an inversion process and the application of a hydrostatic head sufficient to fully extend it to the next designated manhole. The tube shall be inserted into the vertical inversion standpipe with the plastic membrane side out. At the lower end of the inversion standpipe, the tube shall be turned inside out and attached to the standpipe so that a leakproof seal is created. The inversion head will be adjusted to be of sufficient height to cause the impregnated tube to invert from manhole to manhole and hold the tube tight to the pipe wall, produce dimples at side connections and flared ends at the manholes. The use of a lubricant is recommended to reduce friction during inversion. Care shall be taken during the elevated curing temperature so as not to over stress the felt fiber. (In certain cases the Contractor may elect to use a top inversion. In this method the tube is pre-inverted to a distance that corresponds to the required inversion head and instead of attaching to an elbow at the base of the vertical inversion standpipe, it is attached to a top ring and the standpipe is formed from the tube itself).

Before the inversion begins, the Contractor shall provide the minimum pressure required to hold the tube tight against the existing conduit, and the maximum allowable pressure so as not to damage the tube. Once the installation has started, the pressure shall be maintained. Tube installation forces or pressures shall be limited so as not to stretch the tube longitudinally by more than 5% of the original length.

Curing: After inversion is completed, the Contractor shall supply a suitable heat source and recirculation equipment. The equipment shall be capable of delivering hot water or hot air throughout the section to uniformly raise the temperature above the temperature required to effect a cure of the resin. This temperature shall be determined by the resin/catalyst system employed.

The heat source shall be fitted with suitable monitors to gauge the temperature. Another such gauge shall be placed between the impregnated tube and the pipe invert at the remote manhole to determine the temperature during cure. The hot water or hot air temperature in the line during the cure period shall be recommended by the resin manufacturer.

Initial cure shall be deemed to be completed when inspection of the exposed portions of the pipe appear to be hard and sound and the remote temperature sensor indicates that the temperature is of a magnitude to realize

an exotherm or cure in the resin. The cure period shall be of a duration recommended by the resin manufacturer, as modified for the CIPP process.

Cool Down: The installer shall cool the hardened pipe to a temperature below 100 degrees F. before relieving the static head in the inversion standpipe. Care shall be taken in the release of the static head so that a vacuum will not be developed that could damage the newly installed pipe.

Finish: The finished pipe shall be continuous over the entire length of an inversion run and be as free as commercially practicable from visual defects such as foreign inclusions, dry spots, pinholes, lifts and delaminations. If these conditions are present, the Contractor shall remove and replace the CIPP in these areas at the Contractor's expense. The CIPP shall also meet the leakage requirements as specified in the testing section.

During the warranty period any defects which will affect the integrity or strength of the pipe shall be repaired at the Contractor's expense.

Sealing CIPP at Manholes: All pipes shall be fitted with a hydrophilic gasket, as manufactured by LMK or equivalent, at both ends of each segment prior to installation of the liner.

Service Connections: When service connections are encountered, they shall be reinstated after the CIPP has been cured in place, and shall be done without excavation, and in the case of non-man entry pipes, from the interior of the pipeline by means of a television camera and a cutting device that re-establishes them to not less than 90 percent capacity and not more than 100 percent. The cost of reinstating services shall be paid for at the contract unit price per EACH for CIPP SERVICE LATERAL REINSTATEMENT. No additional payment will be made for excavations required for the purpose of reopening service connections and the Contractor will be responsible for all costs associated with such excavation and restoration work.

Service Lateral Lining: All work associated with the installation of the service lateral liner shall be in accordance with ASTM Designation F 2561-06 and shall include the use of a one piece main and lateral liner. This work shall include all material and labor to perform the product including but not limited to: by-pass pumping, public notification, traffic control, pre-cleaning, sewer televising pre-installation and post installation, testing, etc. The unit price for CIPP Service Lateral Liner shall also include the cost for 2 foot of 6" liner. This work shall be paid for at the contract unit price per EACH (EA) for CIPP SERVICE LATERAL LINER. Additional lining of 6" service laterals beyond the 2 foot included under CIPP Service Lateral Liner shall be paid for at the contract unit price per LINEAL FOOT (LF) for CIPP LINING, 6". The exact length of 6" liner will be determined by the Engineer after the Contractor has completed the televising and locating of the existing sanitary services.

Testing: The water tightness of the CIPP shall be gauged while curing and under a positive head. After the work is completed, the Contractor will provide the Owner with an electronic format showing the completed work including the restored conditions. Acceptance of the work will be based upon televising of the liner in accordance with the Special Provisions for closed circuit TV inspection. The pipe will be televised before and after the installation of the CIPP, under no flow conditions. The tape shall show the date, upstream and downstream manhole numbers, and shall be stationed from the upstream manhole. The video tape shall be in color. No infiltration of groundwater should be observed. According to ASTM F1216-16, tensile strength testing will only be required for CIPP lining of pressure pipe.

Clean-Up: Upon acceptance of the installation work and testing, the Contractor shall reinstate the project area affected by his operations.

Acceptance: Upon completion, the installer will deliver videos of the completed work and a report to the Owner in a digital format. The Owner will review the documentation and the site to determine that the scope of work is complete and the work is satisfactory. The CIPP shall be guaranteed for a period of two (2) years after approval of the Final Payment.

CIPP Sectional Sanitary Sewer Lining: The CIPP sectional sanitary sewer lining shall be completed and installed in a manner that meets the full length cured in place sanitary sewer lining process except for these additional specifications: This repair will be accomplished using a liner tube of the length required to cover the identified defect (equal to or less than 10') with a thermo-set resin with physical and chemical properties appropriate for the application. The installation procedure shall conform to ASTM F2599-11 "Standard Practice for Sectional Repair of Damaged Pipe by Means of an Inverted Cured-In-Place Liner". The tube shall be positioned within a translucent inversion bladder vacuum impregnated with the resin, then placed inside a protective launching device and winched through the sewer pipe. The liner must be installed at low pressure (not to exceed 10-PSI) to prevent further damage to the host pipe. The flexural modulus of Elasticity shall meet or exceed 250,000 PSI. The inversion installation method will not be required as long as the modulus of Elasticity requirement is met.

Payment: This work shall be paid for at the contract unit price per FOOT (FT) for CIPP SANITARY SEWER FULL LENGTH LINING or EACH (EA) for CIPP SANITARY SEWER SECTIONAL LINING of the size and type specified in the contract, per EACH for CIPP SERVICE LATERAL LINER, and per LINEAL FOOT (LF) for CIPP LINING, 6" as directed by the Engineer.

SP SN.5 – SANITARY SERVICE CROSSINGS

This item consists of replacing sanitary services and risers due to crossing said services during the installation of storm sewers, water mains, and sanitary sewers, and reconnection of existing sanitary services to new or existing sanitary mains, in accordance with the details included in the plans and as directed by the Engineer in the field.

The locations of any existing sanitary services shown on the plans are approximate and are not guaranteed to be correct or complete. Sanitary services are private utilities and will not be located by the City. The Contractor shall be responsible for locating all sanitary services in the field and repairing any damaged services. The Contractor should anticipate encountering inactive sanitary services and active sanitary services that are not shown on the plans. The Contractor shall be responsible for determining whether or not services are active. The Contractor shall plug all inactive services unless directed otherwise by the Engineer. Locating services in the field, determining if services are active or inactive, and plugging inactive services within the limits of the excavation required for the proposed utility shall be considered incidental to the contract. In the event the Contractor is directed to remove a service at the point of connection with a sewer that is to remain, the work shall be performed and paid for in accordance with special provision REMOVAL/ABANDONING OF SEWERS AND/OR WATER MAINS.

When the existing service is found to be under the proposed pipe, the Contractor shall be required to probe for the existing service. If the existing service is found to be within 2' below the proposed pipe, the Contractor shall remove and replace the existing service for a length of at least 2 feet beyond the width of the proposed trench.

In the event of a break in a sanitary service and/or riser, the Contractor shall maintain the flow from the sanitary service at all times.

Where grade conflict arises between existing services and the proposed improvements, the Contractor shall relay those services at the grade given by the Engineer in the field prior to the construction of the proposed pipe. The locations for this work may or may not be shown on the plans. In the event that an unforeseen conflict may occur between the proposed work and an existing sanitary sewer or service, the Contractor will not be entitled to any additional compensation other than as provided within this special provision.

Contractor shall replace said services with PVC DR 18 C-900 pipe. All connections shall be made using CNSS non-shear sewer couplings as manufactured by Cascade Water Works Mfg. Co. or approved equal. The coupling shall be constructed with an outer shell of T-304 (ASTM A-240/ASME SA-240) stainless steel with three stainless steel heavy duty worm gear fasteners (SAE J-1508 - MIL 5059-A) permanently welded in place and passivated per ASTM A-380. The shell shall fully encircle a 40 durometer ribbed gasket made from virgin SBR (ASTM

D2000) rubber formulated for sewer service. Inserts shall be provided to compensate for differences in the outside diameters of the new and existing pipes.

In the case of services crossing the storm sewer trench above the proposed conduit that are damaged during construction, the Contractor shall replace said services with PVC DR 18, C-900 pipe across the full width of the excavation and an additional distance on each side of the trench so that the connection to the existing service pipe material is on solid ground. However, in no case shall this additional distance on each side of the trench for said connections be less than 24 inches. The total length of the service to be replaced shall be determined by the Engineer in the field. All connections shall be made using non-shear sewer couplings.

Payment for the work specified herein shall be made at the contract unit price per FOOT (FT), measured in accordance with the details shown on the Plans for SANITARY SEWER SERVICE REMOVAL & REPLACEMENT, 6".

SP SN.6 – SANITARY SERVICES AND TEE REPLACEMENT

This item consists of installing sanitary tees, risers, and making connection to existing services in areas where the existing tee shall be replaced due to a conflict with the proposed pipe. Tees replaced in conjunction with installation of a new sanitary sewer main will not be paid separately and shall be considered incidental to the cost per FOOT (FT) for SANITARY SEWER of the size and type specified.

Sanitary services, risers, fittings and tees, shall be of the type and material specified in the plans and Specifications. Size shall be minimum 6" diameter. Connection to the existing sanitary service shall be made with non-shear sewer couplings. The couplings shall be furnished with suitable bushings to correct for the difference in pipe diameters (see detail shown on the Plans).

The location of the existing sanitary sewers and services shown on the plans is approximate and is not guaranteed to be correct or complete. When required for relocation or replacement the Contractor shall be responsible for locating services in the field. The Contractor should anticipate encountering inactive sanitary services and active sanitary services that are not shown on the plans. The Contractor shall be responsible for determining whether or not services are active, **and record the locations of all services encountered on the record drawings**. The Contractor shall plug all inactive services unless directed otherwise by the Engineer. Locating services in the field, determining if services are active or inactive, and plugging inactive services shall be considered incidental to the contract.

In the event of a break in a sanitary service and/or riser, the Contractor shall maintain the flow from the sanitary service at all times.

Non-Shear Sewer Coupling

Straight and transition couplings for sewer construction and repair shall be Style CNSS non-shear sewer couplings as manufactured by Cascade Water Works, Mfg. Co. of Yorkville, IL or equal. The coupling shall be constructed with an outer shell of T-304 (ASTM A-240/ASME SA-240) stainless steel with three stainless steel heavy duty worm gear fasteners (SAE J-1508 - MIL 5059-A) permanently welded in place and passivated per ASTM A-380. The shell shall fully encircle a 40 durometer ribbed gasket made from virgin SBR (ASTM D2000) rubber formulated for sewer service.

Tees

For service connections to existing sewers less than 8 inches in diameter, the tees shall be PVC as the same size and type as previously specified and shall be connected to the existing main with non-shear couplings, as previously specified.

For service connections to sewers equal to or greater than 8 inches in diameter, the service connection shall be "Inserta Tee" (or equal). In the event that a service connection to an existing brick sewer is required, the Contractor shall core drill and cement a 6" PVC pipe hub into place.

Payment for tees will be made at the contract unit price EACH for SANITARY SEWER REMOVAL AND REPLACEMENT, TEE of the size specified and of the same material as the sanitary service, constructed in accordance with the details shown on the plans, including the cost of furnishing and installing the tee with or without riser, removal and replacement of existing service for a distance of up to five (5) feet measured horizontally from the sewer main, excavation, bedding, granular backfill and all appurtenances.

Payment for Inserta Tee shall be made at the contract unit price EACH for INSERTA TEE of the specified size, constructed and installed in accordance with manufacturer's recommendations which shall include the furnishing and installation of the Inserta Tee or pipe hub in the event the existing sewer is brick, with or without riser, excavation, bedding, granular backfill and all appurtenances.

Additional Footage of Sanitary Services

Additional footage of 6" sanitary service shall be approved by the Engineer when minimum grade of 1/8" per foot beyond the five (5) feet included in SANITARY SEWER REMOVAL AND REPLACEMENT, TEE or INSERTA TEE cannot be obtained to connect to the existing service or where a sanitary service is relocated due to a grade conflict with a proposed conduit. The additional footage shall be paid for at the contract unit price per FOOT (FT) for SANITARY SEWER SERVICE RELOCATION, 6".

Location of Sanitary Wyes and Break-Ins

The City has acquired for its use, certain information relating to the location of wyes and break-ins in the existing sanitary sewers. This information is shown on the plans and is based on sewer televising or record information. The Contractor shall use this information for whatever value they consider it worth, since locations are not guaranteed. Inactive break-ins and wyes are expected. The Contractor shall verify them by making contact with the residents of each property owner and having them flush a toilet and/or performing other investigations. When a sanitary service is found inactive, the Contractor shall plug the inactive service watertight with a factory made plug and record its location.

SP SN.19 – CLOSED CIRCUIT T.V. INSPECTION

In order for the Owner to accept sanitary sewers improvements, the Contractor shall televise the new/lined storm and/or new/lined sanitary sewer, and the interior of each new/lined lateral from the point of connection with the main. The televising shall be performed from manhole to manhole with each lateral referenced by station from the upstream manhole. The televising shall be performed by an operator that is PACP certified according to NASSCO (National Association of Sewer Service Companies) and the pipeline evaluations and reporting shall be coded using PACP guidelines.

In addition to televising the new/lined storm and/or sanitary sewers, the Engineer may direct the Contractor to televise additional sewers during the project.

Prior to televising the Contractor shall flush and clean all sewers. This method shall include but not be limited to: high velocity hydro-cleaning; mechanical cleaning using bucketing machines; and root removal. Contractor shall be responsible for the disposal of all solids or semi-solids resulting from the cleaning operations.

The television camera used for the inspection shall be one specifically designed and constructed for such inspection. Lighting for the camera shall be suitable to allow a clear picture of the entire periphery of the pipe. The camera shall have a rotating head and shall be operative in 100 percent humidity conditions. The camera, television monitor and other components of the video system shall be capable of producing a minimum 500 line resolution video picture in color. Picture quality and definition shall be to the satisfaction of the Engineer and if unsatisfactory, shall be redone at no cost to the Owner.

The inspection will be done one manhole section at a time, and the flow in the section being inspected will be suitably controlled. The camera shall be moved through the line from the upstream manhole to the downstream manhole at a uniform rate, stopping when necessary to ensure proper documentation of the sewer's condition,

but in no case will the television camera be moved at a speed greater than 30 feet per minute. Manual winches, power winches, TV cable and powered rewinds or other devices that do not obstruct the camera view or interfere with proper documentation of the sewer conditions shall be used to move the camera through the sewer line. If, during the inspection operation the television camera cannot pass through the entire sewer section, the Contractor shall re-set his equipment in a manner so that the inspection can be performed from the opposite manhole.

Measurement of any defects, connections, etc. as described in the following report shall be accurate to two tenths (0.2) of a foot over the length of the section being inspected.

Electronic copies of the reports shall be provided to the Engineer in pdf format. Reports will clearly show the location, in relation to adjacent manholes, of points of significance such as locations of building sewer connections, unusual conditions, roots, storm and/or sanitary sewer connections, collapsed sections, presence of scale and corrosion, and other discernible features. Each manhole shall be identified by numbers pre-selected by the Engineer and depths of the manholes shall be recorded.

Electronic copies of the videos shall be provided to the Engineer of sections televised.

If this work is subcontracted to others, the City will require approval of said Subcontractor.

The Closed Circuit TV Inspection required following the installation of sanitary sewer cured in place pipe lining will not be paid for separately, but shall be considered incidental to the lining process. Televising required after a sanitary sewer spot repair, a new sanitary sewer installation project or additional Closed Circuit TV Inspection requested beyond the limits of the sanitary sewer installation shall be paid for at the contract unit price per FOOT (FT) for SANITARY or STORM SEWER TELEVISIONING when a pay item is included and it is specified in the plans.

SP W.1 – WATER MAIN INSTALLATION

This item consists of furnishing all labor, materials, and equipment necessary to perform the work required under this Special Provision and shall be in accordance with the Specifications, the Plans, and as directed by the Engineer. It shall consist of providing, hauling and distributing all pipe, castings, fittings, and accessories and shall also include the excavation of trenches to the required depth; sheeting, bracing and supporting the adjoining ground or structures where necessary; dewatering; provide barricades, guards and warning lights; restrained joints; V-bio polyethylene encasement; laying and testing the pipe, castings, fittings, and accessories, backfilling and consolidating the trenches; dewatering the underlying soil stratum; relocation and/or bracing of power poles and street lights; cleaning and restoration of the work site and maintaining the streets or other surfaces over the trenches as required. The water main shall be laid to meet all vertical and horizontal separation requirements as described in section 41-2.01 of the Standard Specifications for Water and Sewer Construction in Illinois, latest edition, as amended and the separation details provided in the improvement plans.

All appropriate parts shall be lead free and be stamped "NL". Any variation from the special provisions below should be approved by the Engineering Division prior to installation.

All contamination preventive measures, pressure testing, preliminary flushing, chlorination, and bacteriological sampling of the water main shall be conducted under the supervision of the City of Aurora's Engineering Division or its designated representative. The installation Contractor shall notify the City of Aurora's Engineering Division or its designated representative a minimum of 48 hours in advance of each of the following activities: starting construction of a project, scheduling shutdowns, connections, pressure testing, preliminary flushing, chlorination, and bacteriological sampling of any water main piping. Refer to the separate special provisions regarding each of those activities.

Contamination Preventive Measures During Construction

Soil, organic matter, and other heavy material typically contain bacteria and can prevent even high concentrations of chlorine from contacting and killing the organisms. These bacteria can cause failure of bacteriological sampling. Preventing these types of materials from entering water main pipe either during or before installation is critical. Preventive measures are described in detail in AWWA Standard C651-14 Section 4.8. At a minimum, the following preventive measures shall be followed during water main pipe installation:

1. *Keep pipe clean and dry.* The interiors of pipes, fittings, and valves shall be protected from contamination. All openings in the pipeline shall be closed watertight or with rodent-proof plugs when pipe laying is stopped at the close of the day's activities or for other reasons.
2. *Joints.* Joints of all pipe in the trench shall be completed before work is stopped.
3. *Cleaning and swabbing.* If dirt or other foreign material enters the pipe, it shall be removed and the interior of the pipe surface swabbed with a 1 to 5% sodium hypochlorite (NaOCl) disinfecting solution. If in the opinion of the City of Aurora Engineering Division, or its designated representative, the foreign material in the pipe will not be removed by preliminary flushing activities, the interior of the pipe shall be cleaned using mechanical means at no additional cost to the City of Aurora and then swabbed as described above.

Brass wedges shall be installed per Section 41-2.05D of the Standard Specifications for Water and Sewer Construction in Illinois, latest edition, as amended.

The Contractor shall be required to keep existing water mains in service until the existing service connections are transferred to the newly installed water main. Any work associated with temporarily capping or disconnecting existing mains, or installing temporary services shall be considered incidental to the contract and shall not be paid for separately unless the activity requires a separate dig location/occurrence and is specified on the improvement plans and bid schedule. **Reducing the pressure in the water main below 20 PSI will result in the issuance of a precautionary boil order to all services connected to that section of the water main. The improvement plans show the proposed steps to be taken to avoid dropping the pressure below this threshold which may necessitate the use of a line stop or the installation of an inserta-valve.** Prior to performing any water main shutdowns, the Contractor shall notify any affected residents or business per the NOTIFICATION special provision.

Specification references made herein for manufactured materials such as pipe, fittings, valves and hydrants refer to designations for AWWA, or to ANSI, as effective on the date of call for bids.

Unless specified in the pay items or on the plans, Ductile Iron Water Main (DIWM) shall be used for all water mains in this project. Ductile-iron pipe for water mains shall conform to ANSI Specification A21.51 or AWWA C151. Class 52, thickness designation, casting, marking, testing, etc. shall be provided in accordance with applicable ANSI or AWWA standards.

Zinc Pipe Coating

The exterior of the ductile iron pipe shall be coated with arc-sprayed zinc. The mass of zinc is to be 200 g/m² of surface area. A bituminous top coat shall be provided on top of the zinc. Zinc coating shall meet ISO 8179 except where noted within the specifications. The zinc coating of the water main shall be included in the lineal foot unit price of the water main.

All ductile-iron pipe and appurtenances shall be protected against corrosion with V-bio polyethylene wrapping in accordance with AWWA C-105-82 and the Protection Against Corrosion special provision.

Cement lining shall be included in accordance with ANSI A21.4 (AWWA C-104). All pipe and fittings shall be cement mortar lined in the shop with centrifugally spun lining in accordance with AWWA C205-85 or cement mortar lined mechanically in accordance with AWWA C602-83. Use ASTM C150, Type II, cement for lining. Field joints shall be made in accordance with AWWA C205, Appendix A.

Pipe joints shall be either mechanical or push-on (rubber gasket) type as recommended by the pipe manufacturer. Restrained joints shall be of the type recommended by the pipe manufacturer and approved by

the Engineer. Backfilling and bedding shall be accomplished in accordance with Trench Details shown within these plans.

Water Main Casing

Joints for water main to be installed inside casing pipes shall be either mechanical joint or push on with Field Lok 350 gaskets or approved equal. Casing pipe shall consist of the pipe size and type as specified on the plans. Casing spacers manufactured by Cascade Waterworks Mfg. or an Engineer approved equal shall be utilized in the pipe. The location of the spacers shall be per the manufacturers recommendations which shall be included in the cost of the casing pipe. The ends of the casing pipe shall be capped with a rubber seal or Engineer approved equal also included in the cost of the casing pipe. This work shall be paid for at the contract unit price per FOOT (FT) for WATER MAIN CASING of the diameter specified, which shall be payment in full for all labor, equipment and material required to install the casing pipe with spacers and end caps as shown on the plans or as directed by the Engineer in the field.

Laying of Pipe

The pipe shall be installed so that the entire length of pipe shall have full bearing. The bedding shall be shaped such that the pipe is uniformly supported over its entire length.

Installation of the water main pipe shall be accomplished to line and grade in the trench only after the bedding has been completely de-watered and is free of mud, loose silt, or foreign material. All foreign material shall be kept out of the pipe.

Dirt or other foreign material shall be prevented from entering the pipe or pipe joint during handling or laying operations and any pipe or fitting that has been installed with dirt or foreign material in it shall be thoroughly cleaned. At times when pipe installation is not in progress, and at the end of each working day, the open ends of the pipe shall be closed by a water-tight plug to ensure absolute cleanliness inside the pipe.

Water Main Restraint – Mechanical Joint Restraint

In lieu of thrust blocking, joint restraint systems such as a mechanical joint fitting or a joint restraint gasket can be utilized for restraining the system and shall be installed to the lengths specified in the Minimum Restraint Length (ft) on both sides of the Fitting detail located in the improvement plans. Field Lok 350 Gaskets or an approved equal shall be utilized for the joint restraint gaskets. All nuts, bolts, and threaded rods shall be stainless steel, Grade 304 bolts and Grade 316 nuts.

Water Main Restraint – Thrust Blocking

Additionally, the Contractor may install thrust blocking to prevent movement of lines under pressure at bends eleven and one-quarter (11¼) degrees and greater, tees, caps, valves and hydrants shall be precast or poured Portland cement concrete, rated at 3500 psi, a minimum of twelve (12") thick. Stainless steel tie rods are to be used in addition to blocking on all fittings and shall be anchored in such a manner that pipe and fitting joints will be accessible for repairs. Poured concrete shall not hinder access to metal fittings and bolts or hydrant drainage. All nuts, bolts, and threaded rod shall be stainless steel. When used for restraint, the thrust blocking and tie rods shall be considered included in the cost of the water main.

Installation of Mechanical Joints for Ductile Iron Pipe

The outside of the spigot and the inside of the bell of mechanical joint pipe shall be thoroughly cleaned to remove all foreign matter from the joint. The cast iron gland shall then be slipped on to the spigot end of the pipe with lip extension of the gland toward the socket or bell end. The rubber gasket shall be placed on the spigot end with the thick edge toward the gland. The pipe shall be pushed forward to completely seat the spigot end in the bell. The gasket shall then be pressed into place within the bell, being careful to have the gasket evenly located around the entire joint. The cast iron gland shall then be moved along the pipe into position and bolted.

Nuts spaced 180 degrees shall be tightened alternately to AWWA C-600 Standards in order to produce an equal pressure on all parts of the gland.

Jointing Gasket Joint Pipe (AWWA C111, AWWA C900, AWWA C200, ASTM F477, AWWA C950)

The inside of the bell shall be thoroughly cleaned to remove all foreign matter from the joint. The gasket shall be inserted in the gasket seat provided.

A thin film of gasket lubricant shall be applied to inside surface of the gasket. Gasket lubricant shall be a solution of vegetable soap or other solution supplied by the pipe manufacturer and approved by the Owner. The spigot end of the pipe shall be cleaned and entered into the rubber gasket in the bell, using care to keep the joint from contacting the ground. The joint shall then be completed by forcing the plain end to the seat of the bell. Care must be taken not to damage exterior or interior lining when joining the pipe. Field cut pipe lengths shall be beveled to avoid damage to the gasket and facilitate making the joint.

All pipe shall be furnished with a depth mark to assure that the spigot end is inserted to the full depth of the joint.

All fittings shall be ductile iron conforming to the latest ANSI specifications A21.10 for fittings, twelve inches (12") or less, and AWWA C110 for fittings fourteen inches (14") or larger. Joints for all fittings shall be mechanical joints with Mega Lug wedge action retaining glands, or approved equal. All nuts and bolts used for jointing shall be stainless steel, Grade 304 bolts, and Grade 316 nuts.

This work shall be paid for at the contract unit price per FOOT (FT) for WATER MAIN of the diameter and type specified, which shall be payment in full for all labor, equipment and material to install and/or relocate the water mains as shown on the plans or as directed by the Engineer in the field.

All fittings shown on the plans shall be considered incidental to the cost of the water main.

In the event that fittings are required beyond what are shown in the plans, payment shall be made at the contract unit price per POUND (LB) for ADDITIONAL FITTINGS.

SP W.2 – WATER SERVICE/WATER SERVICE RELOCATION

This item shall consist of transferring and reconnecting all existing water services once the new main has met all testing requirements. All copper fittings shall be flared fittings. Compression fittings shall **not** be allowed. All water services shall be constructed of 1" diameter Type K copper pipe unless otherwise called out on the plans or directed by the Engineer in the field. Whenever possible, the Contractor shall install water services under pavement using trenchless construction methods (TCM). The Contractor shall submit a detail plan describing the TCM to be used to the Engineer for approval. The costs associated with exposing existing utilities that may potentially be in conflict with the proposed copper water service to be installed utilizing trenchless methods shall not be paid for separately and shall be considered incidental to the trenchless copper water service installation. Water services and all appurtenances shall be installed meeting the requirements of Part 890 of the Illinois Plumbing Code (77 IL Admin Code 890.1150).

Installation of water services shall be paid for at the contract unit price per FOOT (FT) for OPEN CUT COPPER WATER SERVICE or for TRENCHLESS COPPER WATER SERVICE for the size specified in the contract, which shall be payment in full for all excavation, trench backfill, dewatering, sheeting, shoring and bracing, supplying and installing the copper pipe and fittings, connection to existing lead lines if required, exposing existing utilities, and flushing the existing system, all in accordance with the plans, specifications and as directed by the Engineer.

In the event of a break or a grade conflict with a water service, the Contractor shall replace the water service as required to facilitate the installation of the proposed sewer, or to reconnect services to water mains. The service replacement shall extend a minimum of 18" beyond either side of the sewer trench at a minimum depth of 5 feet. This work may include routing the service under the new sewer, at a minimum depth of 1.5 feet below the bottom of the proposed sewer.

In the event an unexpected lead water service is encountered, the Contractor shall notify the Engineer immediately so that they may discuss the replacement options with the homeowner at their earliest convenience. If a water service is damaged or interrupted, the Contractor shall not turn the water back

on until the Engineer has delivered the flushing requirement form to the homeowner and the homeowner has signed the form acknowledging they understand the required flushing procedures.

All newly installed water services shall be installed at the proper elevation to avoid conflicts with the proposed storm sewer. The Contractor will not be allowed to cut newly installed services. If the Contractor encounters a conflict with a newly installed water service, they will be required to replace the service from the new water main to the new b-box.

Relocating or repairing existing water services shall be paid for at the contract unit price per FOOT (FT) for WATER SERVICE RELOCATION of the size specified which shall be payment in full for all excavation, trench backfill, dewatering, sheeting, shoring and bracing, supplying and installing the copper pipe and fittings, connection to existing lead lines if required, and flushing the existing system, all in accordance with the plans, specifications and as directed by the Engineer.

The Contractor shall remove and replace the curb stop and box if directed by the Engineer. All curb stops shall be Minneapolis pattern with flared connections conforming to ANSI/AWWA C800 and shall be the following brands or approved equal: A.Y. McDonald 6104, Ford B22-444M, or Mueller H-15151. All curb boxes shall be 5'6" bury Minneapolis pattern with minimum 1-1/4" upper section equal to: A.Y. McDonald 5614 or Ford EM-55-56. (Accepted Brands: Mueller, Star Pipe Products, Sigma/Nappco, Bingham & Taylor or approved equal) Removal and replacement of the curb stop and box shall be paid for at the contract unit price per EACH for CURB STOP AND BOX for the size specified in the contract which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

The Contractor shall excavate and tap the new water main and install a new corporation stop at locations shown on the plans or as directed by the Engineer. Corporation stops shall have flared connections conforming to ANSI/AWWA C-800 and shall be the following brands or approved equal: A.Y. McDonald 4701 or Ford F-600. All excavation, shoring, spoil removal and disposal, trench backfill and materials and labor necessary for connecting the water service to the new water main shall be paid for at the contract unit price per EACH for CORPORATION STOP for the size specified in the contract which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

In locations where the new service is to be connected to PVC water mains, the Contractor shall use an epoxy coated ductile iron service saddle with stainless steel bands. Saddles shall be Ford FC202 for C900/C905 PVC or approved equal. All labor and material necessary for installing saddles shall be paid for at the contract unit price per EACH for SERVICE SADDLE which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.3 – WATER MAIN AND WATER SERVICE CROSSINGS

Crossing of water mains and services with storm and sanitary sewers shall comply with Sections 31-1.02 and 41-2.01 of the Standard Specifications for Water and Sewer Main Construction in Illinois. In the event of a break in the water main, the Contractor shall replace said main with new Ductile Iron Pipe Class 52 (cement lined) across the full width of the trench and an additional distance on each side of the trench so that the connection to the existing main is on solid ground. However, in no case shall this additional distance on each side of the trench for said connections be less than eighteen inches (18"). All connections shall be made using a ductile iron transition sleeve with transition gaskets for varying outside diameters of pipe complying with mechanical joint ductile iron fittings ANSI-A21.10 and AWWA C-110 Specifications, and said fittings shall not be less than twelve inches (12") in length.

SP W.4 – WATER MAIN LOWERING

This item consists of lowering existing or proposed water mains in order to avoid vertical conflicts with existing or proposed utilities. This work may be shown on the plans or may be required due to unforeseen conflicts between the existing or proposed water main and other existing or proposed utilities. For areas where the existing main must be lowered, or the proposed main must be installed at a depth of 1.5' greater than the proposed depth, the length of lowered main shall be paid for at the contract unit price per FOOT (FT) for WATER MAIN LOWERING of the size specified in the contract, which shall be payment in full for all equipment, labor, and material required. Fittings required to lower the mains shall not be paid for separately, but shall be considered incidental to WATER MAIN LOWERING.

Select Granular Trench Backfill and surface restoration shall be paid for separately.

SP W.5 – GATE VALVE AND VALVE BOX FOR WATER MAINS

This section applies to the construction of standard cast iron valve boxes, all in accordance with the City of Aurora Standard Specifications for Improvements.

Cast Iron Valve Boxes: Valve boxes must be free of debris, vertical, and centered over the operating nut so that the nut is easily keyable. Valve boxes and extensions must be cast iron only (no plastic). Valve boxes shall be 6850 Series as manufactured by Tyler Union, or equal. Adjustable cast iron valve boxes shall be screw type and shall set to position during backfilling operations so they will be in a vertical alignment to the valve operating stem. The screw type valve box shall be adjustable by screwing the upper section over the lower section. The lower casting of the unit shall be installed first in such a manner as to be snugly settled upon the body of the valve. The upper casting of the unit shall then be placed into proper alignment at such an elevation that its top will be at final grade. If necessary, extension sections shall be furnished to increase the length of the screw type valve box to ensure the top of the box will be at final grade. CA-6 crushed stone shall be utilized to backfill around the valve and valve box.

Ring and Cover and Valve Box Castings: Castings with cast iron ring and cover, and cast iron parts of valve boxes, shall conform to the requirements of Standard Specifications for Gray Iron Castings, ASTM Designation A-48.

Gate Valve: Gate valves shall be Waterous series 2500 resilient wedge or Engineer approved equal with cast iron body, fully bronze mounted, non-rising stem with upper and lower thrust collars. Waterways shall be smooth. All valves shall open by turning counterclockwise. Valves shall meet or exceed AWWA C-500. Valves shall be Waterous. All nuts, bolts, and threaded rods shall be stainless steel, Grade 304 Bolts and Grade 316 Nuts.

End Connections

End connections of all valves shall be mechanical joint.

Valve Stem Seals: All gate valves shall be furnished with O-Ring Stem Seals. Number, size and design shall conform to the AWWA Standard for R/W valve O-Ring Stem Seals.

The minimum requirements for all valves shall, in design, material and workmanship, conform to the standards of the latest AWWA C509-87, and C504. All materials used in the manufacture of waterworks valves shall conform to the AWWA standards designed for each material listed.

Manufacture and Marking: The valves shall be standard pattern and shall have the name or mark of the manufacturer, size and working pressure plainly cast in raised letters on the valve body.

Valve with valve box will be paid for at the contract unit price per EACH for GATE VALVE WITH VALVE BOX of the specified diameter which shall be payment in full for all material, equipment, and labor necessary to perform

this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.6 – VALVE IN VALVE VAULT

This work shall consist of all excavation, furnishing and installing the valve; valve vault; frame and closed lid and appurtenances; testing; disinfecting; protection; removal of existing valve, valve box or vault, and installation of corporation stops, installation and removal of copper whips for flushing and testing, removal of surplus material; and clean-up, all in accordance with the plans and specifications.

Corporation stops shall be installed on both sides of all valves within the valve vaults. The corporation stops shall be 1" diameter, unless otherwise called out in the plans or needed to provide minimum flushing velocities.

Gate Valve

Gate valves shall be resilient wedge with cast iron body, fully bronze mounted, non-rising stem with upper and lower thrust collars. Waterways shall be smooth. All valves shall open by turning counterclockwise. Valves shall meet or exceed AWWA C-500. Valves shall be Waterous. All nuts, bolts, and threaded rods shall be stainless steel, Grade 304 bolts and Grade 316 nuts. All gate valves shall be furnished with O-Ring Stem Seals. Number, size and design shall conform to the AWWA Standard for R/W valve O-Ring Stem Seals.

End Connections

End connections of all valves shall be mechanical joint.

The minimum requirements for all valves shall, in design, material and workmanship, conform to the standards of the latest AWWA C509-87, and C504. All materials used in the manufacture of waterworks valves shall conform to the AWWA standards designed for each material listed. The Contractor shall provide corporation stops on either side of all valves. The corporation stop shall be a minimum of 1" diameter. Larger diameter corporation stops may be required if needed to provide adequate flushing velocities.

Valve Vaults

Valve Vaults shall be 4' in diameter for 10" and smaller valves and 5' in diameter for 12"- 16" valves. Valve vaults shall be constructed in accordance with the plans and details and shall include all excavation, testing, frame and cover, granular trench backfill, and all other appurtenances.

Manufacture and Marking

The valves shall be standard pattern and shall have the name or mark of the manufacturer, size and working pressure plainly cast in raised letters on the valve body.

Valve with valve vault will be paid for at the contract unit price per EACH for MJ VALVE IN VAULT of the type and diameter of valve and vault specified which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.7 – CONNECTIONS TO EXISTING WATER MAINS

This work shall consist of all excavation, furnishing and installing the tapping valve, saddle; valve vault; frame and closed lid and appurtenances; furnishing and installing the valve tie downs and thrust blocking; fittings; reducers; sleeves; testing; disinfecting; protection; removal of surplus material; and clean-up, all in accordance with the plans and specifications.

Tapping Sleeve

Tapping sleeves shall be ductile iron construction meeting ASTM A536 Grade 65-45-12.

Tapping Valve

Tapping valves shall be resilient wedge with cast iron body, fully bronze mounted, non-rising stem with upper and lower thrust collars. Waterways shall be smooth. All valves shall open by turning counterclockwise. Valves

shall meet or exceed AWWA C-500. Valves shall be Waterous. All nuts, bolts, and threaded rods shall be stainless steel, Grade 304 bolts and Grade 316 nuts.

End connections of all valves shall be mechanical joint with Mega Lug retainers.

Valve Stem Seals

All gate valves shall be furnished with O-Ring Stem Seals. Number, size and design shall conform to the AWWA Standard for R/W valve O-Ring Stem Seals.

The minimum requirements for all valves shall, in design, material and workmanship, conform to the standards of the latest AWWA C509-87, and C504. All materials used in the manufacture of waterworks valves shall conform to the AWWA standards designed for each material listed.

Valve Vaults

Valve Vaults shall be 5' in diameter for 12" diameter and smaller pressure connections. Valve Vaults shall be 6' in diameter for pressure connections greater than 12" diameter.

Manufacture and Marking

The valves shall be standard pattern and shall have the name or mark of the manufacturer, size and working pressure plainly cast in raised letters on the valve body.

Non pressure connections to existing mains shall consist of the installation of necessary fittings, reducers, and sleeves; the location of the existing main to determine size and alignment prior to the installation; notification to affected residents in accordance with the special provisions; properly plugging the portion of existing main to be abandoned.

The tapping valve with valve vault will be paid for at the contract unit price per EACH for PRESSURE CONNECTION in VAULT for the size specified in the contract; non-pressure connections to existing mains shall be paid for at the contract unit price per EACH for CONNECT TO EXISTING WM, of the size specified in the contract which shall be payment in full for all labor, equipment, and material necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer in the field.

SP W.8 – FIRE HYDRANT ASSEMBLY

This item shall consist of the installation of new fire hydrant assemblies, including: all excavation; furnishing and installing the fire hydrant, tees, fittings, up to 15 feet of six inch (6") DIWM pipe, auxiliary gate valve, cast iron valve box with lid, thrust blocks, drainage system and appurtenances; testing; disinfecting; protection; removal of surplus excavated material; and clean-up. The fire hydrant shall be red in color.

Description

These specifications are to be used in conjunction with the AWWA Standard C502 for fire hydrants for ordinary water works service, and the City of Aurora's Standard Specifications for Improvements.

Materials

All materials used in the production of fire hydrants for ordinary service shall conform to the specifications designated for each material listed in AWWA Standard C502.

The hydrant shall be Waterous Pacer WB-67 (5 1/4" barrel) of a pattern approved by the Engineer. The seat must be bronze. The name or mark of the manufacturer, size of the valve opening shall be plainly cast in raised letters and so placed on the hydrant barrel as to be visible after the hydrant has been installed.

All nuts, bolts, and threaded rods shall be stainless steel, Grade 304 bolts and Grade 316 nuts.

Any vertical adjustments or hydrant extensions will not be paid for separately but shall be considered incidental

to Fire Hydrant Assembly.

This work shall be paid for at the contract unit price per EACH for FIRE HYDRANT ASSEMBLY, which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.9 – FIRE HYDRANT RELOCATE

This item shall consist of the cutting of the feeder line, removal of the tee, removal of the existing fire hydrant and auxiliary valve as an integral unit and installation of a new ductile iron tee, sleeves(MJ) and the same unit at new location, and flushing of hydrant at the location directed by the Engineer.

The Contractor shall add additional length of water main as required to locate the fire hydrant to within five (5') feet from the back of curb and adjust the fire hydrant to the new elevation required by proposed improvement. Any additional water main and the vertical adjustment or hydrant extension will not be paid for separately but shall be considered incidental to Fire Hydrant Relocate.

This item shall be paid for at the contract unit price EACH for FIRE HYDRANT RELOCATE which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.10 – FIRE HYDRANT REMOVAL

This work shall consist of removing and if necessary disposing of existing fire hydrants, auxiliary valves, valve boxes, including all required excavation, plugging the existing hydrant lead with brick and mortar, and trench backfill. The Contractor shall keep existing hydrants in service until the proposed water main improvements have passed all required testing and have been placed into service.

Existing hydrants and valves being removed shall be delivered to 649 S. River St., Aurora and unloaded at the location designated by City personnel.

This work shall be paid for at the contract unit price per EACH for FIRE HYDRANT ASSEMBLY REMOVAL which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP W.11 – PRESSURE TESTING WATER MAINS

The newly laid water mains or any valved sections of it shall be subject to a hydrostatic pressure test of no less than one-hundred and fifty (150) psi. All testing activities shall be recorded and witnessed by the City of Aurora's Engineering Division or its designated representative. Any testing not witnessed will not be accepted. The Contractor shall furnish the pump pipe connection and all necessary apparatus, including gauges and meters.

After the water main has been laid and partly backfilled, the water main shall be slowly filled with water to eliminate air pockets prior to testing. If necessary, taps with corporate stops shall be placed at points of highest elevation allowing trapped air to be expelled before being plugged. The main shall be filled with water at a rate to ensure that the water within the main will flow at a velocity no greater than 1 foot/second.

Before applying the test pressure, air shall be completely expelled from the pipe. The test pressure shall be at least 150 psi and the test shall last for a minimum of 2 hours. A loss of more than 5 psi during the test shall result in a test failure and the test must be restarted. Upon completion of the test, the volume of recovery water shall be defined as the amount necessary to restore the pressure within the test section to the value at the

commencement of the test. The allowable leakage shall be as determined by AWWA Standard C600-100 Sec. 5.2, based on an allowable leakage of 10.49 gpd/mi/inch. While lengths greater than 1,000 feet may be tested at one time, the permissible leakage will be calculated for the length of water main tested up to a maximum of 1,000 feet regardless if the actual length of main tested is longer.

All joints showing visible leaks shall be repaired until tight. Any cracked or defective pipes, fittings, valves, or hydrants discovered in consequence of this pressure test shall be removed and replaced by the Contractor with sound material and the entire pressure test shall be repeated until satisfactory to the Engineer. The Contractor will not be allowed to utilize "Bell Joint Clamps" to repair leaks at push-on joints.

This work shall not be paid for separately, but shall be considered incidental to the costs for installation of the water main.

SP W.12 – PROTECTION AGAINST CORROSION:

This covers material specifications and installation procedures for **V-bio polyethylene wrapping** of the underground installations of ductile iron pipe, and other related appurtenances or water main. **The Contractor shall use a V-bio enhanced polyethylene wrap or an Engineer approved equal.** To ensure protection against corrosive soils, all ductile iron pipe installed as part of the public system shall include V-bio polyethylene encasement. The encasement shall be installed in accordance with the following specifications.

Table 1 – Raw Material Used to Manufacture Polyethylene Film

All Characteristics	In accordance with ASTM Standard Specification D-1238-68
Type	I
Class	A (Natural Color) or C (Black)
Grade	E-I
Flow Rate (Melt Index)	0.4 Maximum
Thickness	0.008 inch (8 mils) Minimum
Volume Resistivity	Minimum Ohm-cm ³ = 10 ¹⁵
Tensile Strength	1200 psi Minimum
Elongation	300% Minimum
Dielectric Strength	800 Volts per mil Minimum

Thickness Tolerance

Polyethylene film shall have a minimum thickness of 0.008 inch (8 mils). The minimum thickness tolerance is ten percent (10%) of the nominal thickness.

Table II – Minimum Polyethylene Width

Nominal Diameter of Pipe (Inch)	Flat Tube	Sheet
6	21	48
8	24	48
10	27	54
12	30	60
16	37	74
24	54	108
30	67	134
36	81	162

General Installation

The V-bio polyethylene encasement shall prevent contact between the pipe and the surrounding backfill and

bedding material but is not intended to be a completely air and water tight enclosure. Overlaps shall be secured by the use of adhesive tape, plastic string, or other material capable of holding the V-bio polyethylene encasement in place until backfilling operations are completed.

Pipe Wrapping

The standard includes three different methods for the installation of V-bio polyethylene encasement on pipe. For polyethylene supplied in tubes, use Methods A and B. Method C is for use with polyethylene sheets.

METHOD A

Cut polyethylene tube to a length approximately two feet (2') longer than that of the pipe section. Slip the tube around the pipe, centering it to provide a one foot (1') overlap on each adjacent pipe section, and bunching it accordion fashion length-wise until it clears the pipe ends.

Lower the pipe into the trench and make up the pipe joint with the preceding section of pipe. A shallow bell hole must be made at joints to facilitate installation to the polyethylene tube.

After assembling the pipe joint, make the overlap of the polyethylene tube. Pull the bunched polyethylene from the preceding length of pipe, slip it over the end of the new length of pipe and secure in place. Then slip the end of the polyethylene from the new pipe section over the end of the first wrap until it overlaps the joint at the end of the preceding length of pipe.

Secure the overlap in place. Take up the slack width to make a snug, but not tight fit along the barrel of the pipe, securing the fold at quarter point.

Repair any rips, punctures, or other damage to the polyethylene with adhesive tape or with a short length of polyethylene tube cut open, wrapped around the pipe and secured in place. Proceed with installation of the next section of pipe in the same manner.

METHOD B

Cut polyethylene tube to length approximately one foot (1') shorter than that of the pipe section. Slip the tube around the pipe, centering it to provide six inches (6") of bare pipe at each end. Make polyethylene snug, but not tight; secure ends as described elsewhere.

Before making up a joint, slip a three foot (3') length of polyethylene tube over the end of the preceding pipe section, bunching it accordion fashion lengthwise. After completing the joint, pull the three foot (3') length of polyethylene tube over the joint, overlapping the polyethylene previously installed on each adjacent section of pipe by at least one foot (1'); make snug and secure each end as described elsewhere.

Repair any rips, punctures, or other damage to the polyethylene. Proceed with installation of the next section of pipe in the same manner.

METHOD C

Cut polyethylene sheet to a length approximately two feet (2') longer than that of the pipe section. Center the cut length to provide a one foot (1') overlap on each adjacent pipe section, bunching it until it clears the pipe ends. Wrap the polyethylene around the pipe. Secure the cut edge of polyethylene sheet at intervals of approximately three feet (3').

Lower the wrapped pipe into the trench and make up the pipe joint with the preceding section of pipe. A shallow bell hole must be made at joints to facilitate installation of the polyethylene. After completing the joint, make the overlap as described above.

Repair any rips, punctures or other damage to the polyethylene. Proceed with installation of the next section in the same manner.

Pipe Shaped Appurtenances Wrapping

Cover bends, reducers, offsets, and other pipe-shaped appurtenances with polyethylene in the same manner as the pipe.

Odd Shaped Appurtenances Wrapping

When valves, tees, crosses, and other odd-shaped pieces cannot be wrapped practically in a tube, wrap with a flat sheet or split length of polyethylene tube by passing the sheet under the appurtenance and bringing it up around the body. Make seams by bringing the edges together, folding over twice, and taping down. Handle width and overlaps at joints as described above. Tape polyethylene securely in place at valve stem and other penetrations.

This work shall not be paid for separately, but shall be considered incidental to the contract unit price per FOOT (FT) for WATER MAIN and WATER MAIN LOWERING of the size and type specified.

SP W.13 – FLUSHING OF WATER MAINS

After satisfactory completion of pressure/leakage testing, the water main shall receive a preliminary flush. Flushing of water mains shall be conducted under the supervision of the City of Aurora's Engineering Division, or its designee, in accordance with the approved flushing plan. The flushing shall include 100% of the newly installed water main as well as **every fire hydrant installed**. During the flushing operation the direction of flow through the mains shall be reversed. All main line and hydrant valves shall be opened and closed while flushing in each direction.

The flushing velocity in the main shall be a **minimum of 3.0 feet/second**. See Table A for recommended flows to properly flush piping.

Table A

Required Flow and Openings to Flush Pipelines*

Pipe Diameter (Inch)	Flow Required to Produce 3.0 ft/s Velocity in Main (gpm)	Size of Tap			Number of 2-1/2 inch Hydrant Outlets
		1-inch	1-1/2 inch	2-inch	
		Number of Taps on Pipe**			
4	120	1	-	-	1
6	260	-	1	-	1
8	470	-	2	-	1
10	730	-	3	2	1
12	1,060	-	-	3	2
16	1,880	-	-	5	2

* Assuming 40 psi residual pressure in existing water main

** Number of taps on pipe based on discharge through 5 ft. of galvanized iron (GI) pipe with one 90 degree elbow.

NOTE: Flushing is no substitute for preventive measures during construction. Certain contaminants, such as caked deposits, resist flushing at any feasible velocity.

This work shall not be paid for separately, but shall be considered incidental to the costs for installation of the water main.

SP W.14 – REQUIREMENTS OF CHLORINE

Water Main Disinfection

Disinfection shall be accomplished by the use of liquid sodium hypochlorite (NaOCl) or chlorine gas only. The City of Aurora's Engineering Division or its designated representative shall witness the chlorination of the water main. Chlorination of the water main shall not be permitted until the main has passed the pressure/leakage test and a preliminary flush has been performed, witnessed, and approved.

Under the supervision of the project field representative, water from the existing distribution system shall be made to flow at a constant rate into the newly laid water main. At a point not more than 10 feet downstream from the beginning of the new main, water entering the new main shall receive a dose of chlorine fed at a constant rate such that the water will receive not less than 50 mg/L of free chlorine (see Table B or C below).

If chlorine gas is utilized, a minimum of two people employed by the Chlorinator are required when chlorinating a main. One person to monitor the chlorine gas system at the cylinder and one person to monitor the free chlorine levels at the whip/sample locations. The chlorine gas cylinder is not to be left unattended at any time during the disinfection procedure.

All main line and hydrant valves (except for valves at the connection between the new and existing systems) shall be operated after the main has been chlorinated in order to allow the valve disk to make contact with the chlorine solution. As an optional procedure (if specified by the City of Aurora or its designee), water used to disinfect the new main during the application of chlorine will be supplied through a temporary connection. This temporary connection shall be installed with an appropriate cross-connection control device to prevent backflow into the distribution system.

Table B

*Chlorine Gas Required to Produce 50 mg/L
Concentration in 100 ft. of Pipe*

Pipe Diameter (Inch)	100% Chlorine Gas* (Pounds / 100 LF)
4	.026
6	.060
8	.108
10	.170
12	.240
16	.434

* Approximate dosages required

Table C

*1% Sodium Hypochlorite (NaOCl) Solution Required to
Produce 50 mg/L Concentration in 100 ft. of Pipe*

Pipe Diameter (Inch)	1% Sodium Hypochlorite Solution* (Gallons / 100 LF)
4	.32
6	.72
8	1.30
10	2.04
12	2.88
16	2.60

* Approximate dosages required

A minimum free chlorine residual of 25 mg/l shall remain in the water main after standing 24 hours in the pipe as tested/confirmed by the City's Engineering Division or designated representative. A free chlorine concentration less than 25 mg/L indicates an unusually large chlorine demand and can be an indication of significant contamination within the pipe. This condition shall require the Contractor to perform a second preliminary flush and also to chlorinate the main a second time prior to collection of any samples.

Final Flushing and Bacteriological Testing

A minimum of 24 hours after the water main has been properly chlorinated, the Contractor shall schedule an appointment for bacteriological testing. The Contractor shall contact the City of Aurora's Microbiology Laboratory at 630-256-3255 to schedule sample collection. Typically, sample collection will occur on the next business day. Samples will NOT be collected on Fridays, Saturdays, or Sundays, unless advance coordination has been completed and the Contractor is willing to pay for the sampling.

All of the water main that is covered by one IEPA permit must be tested and sampled as a complete project. Bacteriological sampling will not begin until the entire length of the water main being permitted by the IEPA for that particular project has been installed, pressure tested, and chlorinated. Modifications of this requirement must be discussed with the city's representative 7 days prior to disinfection procedures.

Just prior to sampling, the main shall be flushed under the supervision of approved City of Aurora personnel or a designated representative to reduce the free chlorine concentration to no more than 3.5 mg/L. City of Aurora Water Production Division personnel shall collect all bacteriological samples. Sample points shall consist of only copper whips attached to the main and shall be located every 1,200 feet, plus one location from the end of the line, and at least one location from each branch greater than one pipe length long (generally 20 feet). Representative samples shall be collected at locations as directed by the City of Aurora's Water Production Division. **Samples shall not be drawn from hydrants.**

All water mains must be shown to be free of bacterial contamination before being placed into service. All samples shall be analyzed for bacteriological contamination at the City of Aurora's Illinois Department of Public Health certified laboratory. If an initial sample set indicates no bacterial contamination in the water main then the disinfection will be considered satisfactory. If any of the samples that are part of the initial sample set do not pass satisfactorily, then two consecutive water samples collected at least 24 hours apart from each of the unsatisfactory locations must pass to indicate no bacteriological contamination and to allow the main to be placed into service.

The City of Aurora will collect a total of three samples from each designated sample location free of charge. If any of the third samples collected from any location indicate bacteriological contamination then the Contractor must again perform preliminary flushing and chlorination (as described above) on the water main before additional samples will be collected by the City of Aurora. If the portions of the water main which have not passed the bacteriological sampling can be properly isolated from the portions that have passed, and the City of Aurora Engineering Division or its designated representative approves, then only the unsatisfactory portions of the main will be required to be re-flushed, re-chlorinated, and re-sampled.

Once samples are collected, City of Aurora employees or its designated representative shall stop the flow of water through the copper sample whip and the main. Thus, all valves associated with all hydrants, copper whips, and new main isolation valves shall be closed and may not be left "running" between collections of samples on consecutive days.

After samples are collected, City of Aurora personnel or its designated representative shall close the main isolation valve that provides water from the existing water main into the newly installed water main being tested. This valve shall remain closed until the water main project receives approval to become active or if additional sampling or flushing is required. Approved City of Aurora personnel, or its designated representative, shall be the only individuals allowed to operate this valve.

Any questions concerning installation, testing, or disinfection procedures should be directed to the City's designated representative or the Water Production Division at 630-256-3250.

This work shall not be paid for separately, but shall be considered incidental to the costs for installation of the water main.

SP W.15 – LINE STOP

The Contractor shall furnish and install a permanent stainless steel tapping fitting, temporary line stopping device and permanent cap and plug at the location shown on the plans or as directed by the Engineer. Before ordering the line stop device and fitting, the Contractor shall dig exploratory pits to determine the exact outside diameter of the existing mains.

The method of installation and the equipment for inserting the line stops shall be in strict accordance with the recommendations of the line stop manufacturer. The line stop shall make an effective temporary seal. Any excavation required to install the line stop a safe distance (to be determined by the Contractor and/or the Line Stop manufacturer) from the point of insertion shall be considered included in this pay item. The necessary backfill and restoration at the site of the line stop (after installation of the permanent cap and plug) shall be paid for using the appropriate pay item.

This work will be paid for at the contract unit price of EACH for LINE STOP of the size specified, which price shall include all of the labor, materials and equipment to install the line stop as described herein.

SP W.16 - DIRECTIONAL DRILLING WATER MAIN INSTALLATION

This work shall consist of the installation of water main via directional drilling methods. All pipe shall be High Density Polyethylene Plastic Pipe – HDPE (Directional Drilling Installation) or Ductile Iron Pipe – DIP (Directional Drilling Installation).

Polyethylene Plastic Pipe shall meet the applicable requirements of ASTM F-714 "Polyethylene (PE) Plastic Pipe (SDR-PR) Based on Outside Diameter" and ASTM D-1248 "Polyethylene Plastic Molding and Extrusion Materials" and shall meet the following minimum requirements:

1. All pipe shall be made of virgin material. Use of rework will not be permitted. The pipe shall be homogenous throughout and shall be free of visible cracks, holes, foreign material, blisters, or other deleterious faults.
2. HDPE shall comply with ANSI/AWWA C906 and ANSI/AWWA C901 specifications.
3. Pipe material shall conform to ASTM D-1248 Type IV, Class C, or in accordance with directional drilling system manufacturer's recommendation as approved by the Engineer.
4. Dimension ratios – the minimum wall thickness of the polyethylene pipe shall be DR-11.
5. All pipe sections shall be connected using molded butt fusion welded in accordance with ASTM D3261.
6. Pipe shall be black with a blue stripe shall conform to PE 4710 DIPS HDPE Pipe specifications and sizes.
7. Provide coupling to connect HDPE to Ductile Iron at each end of directional bore and at fittings. Provide JCM 230 pipe stiffeners or approved equal at all HDPE to mechanical joint connections. Pipe stiffeners are to be made of 316 stainless steel, match the inside diameter of the HDPE, and be designed for use with mechanical joint restraining devices.
8. All fittings shall be ductile iron fittings and shall be considered incidental to the line items in the bid.
9. All HDPE pipe shall be installed along with two detectable tracer wires installed in a ½" PVC or HDPE conduit attached to the top of the main. Wire shall be a #10 gauge copper wire with 45 mil. PE coating (Kris-Tech or approved equal). Terminal ends shall be brought to the surface at all structures, fire hydrants and any other locations determined by the Engineer. All splice locations shall be made with suitable electrical connection devices or electrical wire connectors as approved by the Engineer. The Contractor shall demonstrate to the Engineer a check of the completed tracer wire "continuity" to verify

the wires were installed properly. If the Contractor fails to install the tracer wires properly, the Contractor will be required to fix or replace the wires until they are working properly.

Ductile Iron Pipe shall meet all requirements as specified under "Water Main Installation" and shall be boltless restrained joint or lock ring type and shall be manufactured in the United States. All ductile iron fittings shall be manufactured in the United States.

The Contractor shall provide plan of proposed directional installation, including, but not limited to location and dimensions of push-pits and receiving pits and proposed vertical and horizontal alignment. Installation of pipelines shall be in accordance with the applicable reference standards and as specified herein.

The CONTRACTOR shall take necessary precautions to insure materials are not damaged in unloading, handling, and placing on site storage area will be designated by Engineer. Damaged material shall be removed from the site and replaced with undamaged material. Pipe ends shall be closed at the completion of any work period to prevent entry of animals and foreign material. All new materials shall be selected, handled and installed in accordance with these specifications.

The CONTRACTOR shall notify the engineer not less than 48 hours in advance of the time when he plans to begin construction work at a particular location within the project area. The contractor is responsible for obtaining the location of other utilities near the area to be excavated.

Contractor shall install all pipe at designated depth and grade in accordance with the reference standards, industry practices, and in strict accordance with the equipment and material manufacturer. The Contractor will furnish all labor, equipment materials, and supplies and will perform all work necessary to provide Owner with a complete, finished product. All spoil and slurry from the directional drilling activities shall be promptly removed from the site and disposed of in a legal manner. Contractor will supply portable mud tanks or construct temporary mud pits to contain excess drill fluids during construction. It is the intent to install majority of water main through long segments of directional drilling. Contractor will be allowed to utilize small amounts of open cut installation as shown on plans and as directed by the Engineer. The proposed alignment, length, profile and grade to which the pipe shall be installed are noted on the applicable drawings. This profile indicates the grade to which the pipe will be installed. Contractor shall haul, string, weld, coat field joints and hydrostatically test the product line in one section. The Contractor shall provide adequate security and shall be responsible for the integrity of the work until after the pullback and final testing. Contractor shall provide adequate support rollers for the product line during pullback of the product string into the pre-drilled hole. The rollers and cradles shall be of a type that will prevent damage to the product line and/or coating and will be of sufficient number to prevent over stressing due to sag bends during the pullback procedure.

Prior to beginning construction, Contractor shall be required to submit a detailed drilling procedure for installation of the crossing, a drill site layout drawing and a bar chart detailing the proposed work schedule. In the event that the Contractor must abandon the drill hole before completion of the crossing, the Contractor will seal the borehole and re-drill the crossing at no extra cost to Owner. In the event that a boulder or other obstacle is encounter, the contractor shall attempt horizontal alignment adjustment to avoid the obstacle. If necessary, the contractor shall remove the obstacle utilizing the most appropriate and economic technology available, including vertical auguring through the boulder.

The Contractor shall limit the longitudinal pull on the product line so as not to exceed 72% of the specified minimum yield strength (SMYS) of the product. Contractor will continuously monitor the longitudinal pulling forces during product line pullback.

The CONTRACTOR shall perform acceptance tests on all new lines. Unless otherwise noted, no separate compensation will be paid for testing; the testing costs are to be included in the related pay items. If the work should fail to pass the tests, it is the CONTRACTOR'S responsibility to correct the work and re-test with no additional compensation. If, within the warranty period, any section of the water system is not acceptable due to subsequent leakage or any other defects, although originally accepted, the CONTRACTOR shall repair or replace the affected portion at no cost to the OWNER.

This work shall be paid for at the contract unit price per foot for WATER MAIN HDPE (TRENCHLESS) or WATER MAIN DIP (TRENCHLESS) of the size and type specified in the plans and specifications and shall include the cost of:

- 1) Site preparation except removal and replacement of pavement and curb and gutter.
- 2) Excavating and backfilling of drilling and receiving pits to proper grade (if necessary) and disposing off-site of all surplus excavated materials.
- 3) Protecting existing utilities, site objects, and new work, which are to remain in service after completion of new sewers and appurtenances including the costs associated with exploratory excavations.
- 4) Sheeting, shoring, and bracing materials and their installation and removal.
- 5) Dewatering and/or By-Pass Flow Control as necessary to complete the work. Contractor shall maintain flow in all existing mains/services throughout the entire process.
- 6) Drilling materials, equipment, and labor. Pipe materials and pipe installation. Pipe, fittings, butt joints, equipment, labor and material.
- 7) Providing and installing fittings, flexible connectors for connecting to existing pipe or structures.
- 8) Cleanup and all other appurtenant and incidental work.

SP W.17 – CURED IN PLACE WATER MAIN LINING

The Cured in Place Pipe liner shall meet the following conditions to be considered acceptable:

- 1) Have been successfully installed in a minimum of 100,000 linear feet of pressurized potable water transition and/or distribution system in the United States;
- 2) Have been manufactured continuously for at least five years;
- 3) Be produced by a manufacturer that demonstrates sufficient in-house engineering support and manufacturing quality control (as demonstrated through a comprehensive quality control program);
- 4) Product repair, or new appurtenances added to the lined main shall follow manufacturer's recommendations per use of end seals or proprietary couplings;
- 5) The liner shall be NSF 61 approved.

The Lining Contractor shall meet the following conditions to be considered acceptable:

- 1) Be certified by the CIPP liner manufacturer that the Lining Contractor is a fully trained user and qualified installer of the liner method;
- 2) Have had at least five years of active experience in the commercial installation of CIPP lining;
- 3) Have successfully installed at least 100,000 linear feet of CIPP lining in pressurized potable water transmission and/or distribution mains. A minimum of three municipal references from these projects shall be provided;
- 4) Assign only experienced employees to this project;
- 5) Certify that the installation of the product will be done in accordance with the manufacturer's recommended procedures;
- 6) Contractor shall provide documentation of internal service reinstatement success rate of 90% or greater.

The water main liner shall follow all applicable portions of the special provisions contained in the CURED IN PLACE SANITARY SEWER LINING and CLOSED CIRCUIT T.V. INSPECTION.

Payment shall be made per linear foot of WATER MAIN LINING of the diameter specified, and shall include payment for all installation, televising, cleaning, service reinstatement, equipment and material needed to install a pipe liner on the existing water main.

Separate payment shall be made for access pits which are only needed for the water main lining process and shall be paid for at the contract unit price per Each of 8" Water main Lining – Access Pit, and shall include all labor, material and equipment needed to perform this work. The water main through these access pits shall be paid for as Zinc Coated DIP WM, CL 52, 8" w/ V-Bio Polywrap.

Locations where the existing butterfly valves are removed shall be used as access pits and shall be paid for as Cut-Out Existing 8" Butterfly Valve.

Temporary water services shall be provided for all services in the water main lining area. Temporary water main and water services shall be provided to ensure service is maintained throughout the process. Temporary water main testing, chlorination and sampling shall also be performed. Access shall be maintained to all residents and adequate protection methods for the temporary water main and water services shall be maintained by the contractor to allow access to the homes and roadway. Temporary water main and services shall be served off existing or proposed fire hydrants. All work associated with providing temporary water service to each service shall be paid for at the contract unit price per EACH for TEMPORARY WATER SERVICE and shall include all labor, material and equipment needed to provide water service to each house as stated herein. Each shall be defined as per home in the water main project and only one will be paid for each house over the entirety of the project.

Documentation shall be submitted with the bid to verify such requirements are met. Those bids submitted without documentation shall be considered as non-responsive.

SP R.1 – SAW CUTTING

When called for on the plans or where directed by the Engineer, the Contractor shall saw-cut existing bituminous concrete and/or Portland cement concrete pavement full depth to penetrate the base and sub-base, so as to completely separate the existing pavement to be removed from that to remain. It is the Contractor's responsibility to determine the thickness of the existing pavement and whether or not it contains reinforcement.

The work shall be performed in such a manner that a straight, vertical joint will be obtained. The saw cutting shall be done prior to the commencement of removal operations. Care shall also be taken by the Contractor so as not to damage the remaining pavement or surface directly adjacent to the pavement or surface to be removed. Any damage to the existing pavement or surface resulting from removal operations shall be repaired at the Contractor's expense, as directed by the Engineer.

The saw cutting shall be performed on both sides of the trenches for the proposed underground utilities. This work shall be performed prior to the commencement of the installation of the improvements as specified. It shall be the Contractor's responsibility to lay out the locations for the proposed saw cuts.

This work shall not be paid for separately, but shall be considered incidental to the contract unit prices. Saw cutting required for items not listed above or designated elsewhere in the special provisions shall be considered incidental to the contract.

SP R.2 – TEMPORARY DRIVEWAY SURFACE, AND TEMPORARY PAVEMENT SURFACE

Restoration of all improvements on public property is to be done in an expeditious manner. Failure to conform to these requirements will result in the City causing such work to be done. All costs of such work, including administrative costs, will be charged to the Contractor along with a \$500.00 penalty for each occurrence on Driveways, Local Roads and Minor Arterials, and \$500.00 for each hour per occurrence on Major Collectors and Arterials during the peak traffic hours Monday through Friday between 7 AM to 9 AM and 3 PM to 7 PM, during non-peak hours the penalty shall be \$500 per occurrence whereby the City must invoke this provision. The parties agreeing that actual damages to the City of Aurora would be uncertain and difficult to calculate and the amount of such liquidated damages is a reasonable estimate of the supervision costs likely to be incurred by the City of Aurora as a result of the Contractor's failure to temporarily or permanently restore public property as required.

PRIOR TO THE REMOVAL OF ANY PAVEMENT OR DRIVEWAYS, THE CONTRACTOR SHALL HAVE TEMPORARY PAVEMENT ON SITE, IN ORDER TO ENSURE THAT THE TEMPORARY PAVEMENT IS IN PLACE THE SAME DAY THAT THE EXISTING PAVEMENT IS REMOVED.

Where a temporary pavement surface has not been requested by the Engineer, the Contractor is encouraged to cap the surface with HMA grindings. However, HMA grindings will not qualify as a temporary pavement surface and will not be paid for as such.

Driveways

A cold mix **temporary surface** is required the same day of excavating the drive approach or the curb adjacent to the drive approach. The Contractor shall provide a temporary approach for all driveways across the width of the approach until the final surface is placed. Temporary driveways shall be inspected at the end of all workdays or in a timely manner to ensure the driveway surface remains usable to the satisfaction of the Engineer. Special attention shall be taken for handicapped residents or residents who may need imminent emergency care (expectant mothers, etc.). The Contractor and Engineer will work to identify special-needs residents to assure they have access to traffic or special vehicles at all times.

Local Streets and Minor Collectors

The Contractor shall place cold mix at street intersections, and/or at other locations as directed by the Engineer the same day of excavating the pavement. Cold Mix shall have a minimum of two inches (2") thickness. The temporary surface shall be removed prior to placing the permanent pavement the cost of which is included in this temporary pavement surface pay item. The temporary surface shall be maintained so that it will provide a smooth, usable surface with a minimum of distraction to traffic to the satisfaction of the Engineer. The Contractor shall be responsible for coring through the cold patch in order to jet trenches. After the trenches are thoroughly jetted and consolidated, additional cold patch shall be applied. At all locations where cold mix is not installed, the Contractor shall place and maintain a CA-6 crushed limestone surface. Holes shall be backfilled or steel-plated over weekends and holidays. The permanent patch to City specifications must be in place as soon as possible.

Special attention shall be taken for handicapped residents or residents who may need emergency trips to a hospital. The Contractor, as directed by the Engineer, shall work with special-needs residents to assure they have special access to traffic and/or special vehicles at all times.

Arterials and Major Collectors

The Contractor shall place Hot Mix Asphalt (HMA) at all excavated locations within active travel lanes and intersections, and at other locations as directed by the Engineer. The HMA depth shall have a minimum of two inches (2") thickness. The temporary surface shall be maintained so that it will provide a smooth, usable surface with a minimum of distraction to traffic to the satisfaction of the Engineer. The Contractor shall be responsible for coring through the temporary pavement in order to jet trenches. After the trenches are thoroughly jetted and consolidated, additional temporary pavement shall be applied. As an alternative, the Contractor may use cold mix asphalt. If cold mix is used, the Contractor shall inspect, repair and/or replace cold mix at all actively travelled locations, and at other locations as directed by the Engineer, on a daily basis when the temporary patch exceeds 1-inch of deviation (above or below) from the adjacent pavement or when excessive tracking of material occurs. Cold mix must be compacted with vibratory or heavy equipment – hand tamping shall not be allowed. Tracking of cold mix onto the travelled lanes shall be cleaned on a daily basis during off-peak traffic hours. The Contractor may use steel-plates, secured in place, to cover open excavations during weekends and holidays with appropriate warning signage. The use of CA-6 crushed limestone as a temporary patch is prohibited. The temporary surface shall be removed prior to placing the permanent pavement the cost of which is included in this temporary pavement surface pay item. HMA in good condition may be allowed to remain in place at the Engineer's discretion. Cold mix shall be removed and replaced with permanent pavement.

Special attention shall be taken for handicapped residents, residents who may need emergency trips to a hospital, and businesses and emergency services needing 24-hour access for public safety. The Contractor, as directed by the Engineer, shall work with special-needs residents, businesses, and services to assure they have special access to traffic and/or special vehicles at all times.

Measurement and Payment

The installation and maintenance of the temporary surface shall be paid for at the contract unit price per SQUARE YARD (SY) for TEMPORARY PAVEMENT, 2" which shall be payment in full for all material, equipment, and labor necessary to perform this work in accordance with the plans, specifications, and as directed by the Engineer.

SP R.3 – HOT MIX ASPHALT PAVEMENT REMOVAL AND REPLACEMENT

This work shall consist of saw cutting, removing, and disposing of the existing roadway pavement and replacement with Hot Mix Asphalt pavement and aggregate base course in accordance with the IDOT Specifications, and as shown on the plan details. This work shall be performed after the successful completion of a proof roll.

The cut faces of the existing pavement shall be primed in accordance with the IDOT Specifications.

Damages to existing pavement due to construction traffic and track machinery shall be repaired according to these specifications, to the limits dictated by the Engineer. The repair of damages to existing pavement due to construction traffic and track machinery shall **not** be paid for, but shall be fully repaired at the Contractor's expense.

Prior to the placement of any permanent pavement, the Contractor shall perform a proof roll in accordance with the latest addition of the IDOT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

Measurement and Payment

This work shall be paid for at the contract unit price per SQUARE YARD (SY) for CLASS D PATCHING of the thickness specified, which price shall be payment in full for all labor, materials including aggregate base, and equipment necessary to perform this work in accordance with the plans, details, and specifications.

SP R.4 – HOT-MIX ASPHALT PAVEMENT SURFACE COURSE

This work shall consist of the placement of a one and one-half (1-1/2") layer of hot-mix asphalt surface course mix N50 after preparing and cleaning the base in accordance with the applicable portions of Section 406 of the Standard Specifications and as stated herein.

The Contractor shall begin the placing of bituminous surface so as to complete the work on the same day. The Contractor shall stagger the longitudinal joints in the surface course to provide a minimum offset distance of six inches (6") from the binder course. Prime coat in accordance with the IDOT Specifications is incidental.

This work shall be measured and paid for at the contract unit price per TON in place for HMA SURFACE COURSE 1-1/2", which price shall be payment in full for preparing and cleaning the base, application of prime coat, placement of bituminous mixture, and disposal of any unsuitable material, as specified herein and as directed by the Engineer.

SP R.5 – PCC DRIVEWAY PAVEMENT REMOVAL & REPLACEMENT

This work consists of the removal of existing residential and commercial drive approaches, and replacement with Portland concrete cement driveways and performing necessary earthwork (such as excavation or embankment) according to the proposed grade.

The replaced driveway shall be six inches (6") for residential approaches, and eight inches (8") for commercial

approaches of Class PV Portland cement concrete, non-reinforced with a continuous, full depth bituminous fiber expansion joint at the sidewalk and at the back of the curb. The surface shall be cured and protected as per the requirements for sidewalk. The pavement shall be placed on a compacted stone or gravel base to a depth of four inches (4") minimum for residential, and 6" minimum for commercial. **Portland cement concrete driveways shall have contraction joints installed as shown on the plan details.**

This item shall be paid for at the contract unit price per SQUARE YARD (SY) for PCC DRIVE APPROACH REMOVAL & REPLACEMENT, for the thickness specified in the contract, measured in place, which price shall be payment in full for all labor, materials, and equipment necessary to complete this item in accordance with the plans and specifications.

SP R.6 – HOT MIX ASPHALT DRIVEWAY PAVEMENT REMOVAL & REPLACEMENT

This work consists of the removal of existing residential and commercial drive approaches, and replacement with hot-mix asphalt driveways and performing necessary earthwork (such as excavation or embankment) according to the proposed grade.

The replaced driveway surface course shall be two inches (2") for residential approaches and four inches (4") for commercial approaches. The driveway pavement shall be placed on a compacted stone or gravel base to a depth of four inches (4") minimum for residential, and 6" minimum for commercial.

This item shall be paid for at the contract unit price per SQUARE YARD (SY) for HOT MIX ASPHALT DRIVE APPROACH REMOVAL & REPLACEMENT, for the thickness specified in the contract, measured in place, which price shall be payment in full for all labor, materials, and equipment necessary to complete this item in accordance with the plans and specifications.

SP R.7 – COMBINATION P.C.C. CURB AND GUTTER

This work shall consist of the removal of existing and the installation of new combination P.C.C. (Portland cement concrete) curb & gutter of the type and size matching that which exists, or as directed by the Engineer, by method and materials specified in Articles 606 and 1020 of the Standard Specification for Road and Bridge Construction. The new combination P.C.C. curb and gutter shall be installed in locations where the work has caused damage or loss of the existing curb, or as shown on the plans or directed by the Engineer.

Removal of P.C.C. curb and gutter shall include full depth saw cuts.

Construction of combination P.C.C. curb and gutter shall include:

1. The excavation for, the supplying and placement of, four inches (4") compacted CA-7 Aggregate base.
2. The placement of Class SI, P.C.C. (Portland cement concrete) per the detail shown on the plans.
3. The placement of reinforcement per the detail shown on the plans.
4. The drilling and placement of dowel bars with grease caps into the existing adjoining concrete.
5. The placement of contraction joints, expansion joints, and construction joints per the detail and table shown on the plans.
6. The application of curing and sealing compounds for Portland cement concrete per the P.C.C. Sidewalk Removal & Replacement special provision below.
7. The backfilling of curb & gutter with material approved by the Engineer.

The contractor shall be responsible for damage or vandalism to finished concrete surfaces until final acceptance of the project. Damaged or vandalized concrete shall be replaced at the discretion of the Engineer.

This work shall be paid for at the contract unit price per FOOT (FT) for COMBINATION P.C.C. CURB & GUTTER

and shall include all labor, material, and equipment necessary for installation as specified herein. Saw cutting, expansion joints, reinforcement, and dowel bars shall be considered incidental to this item.

SP R.8 – P.C.C. SIDEWALK REMOVAL AND REPLACEMENT, 5" AND DETECTABLE WARNINGS

This work shall consist of removing the existing sidewalk and placing a Portland Cement Concrete Sidewalk in accordance with Section 424 and 440 of the Standard Specifications, the details included and as directed by the Engineer.

The Contractor shall saw cut, remove and dispose of sidewalks marked in the field for removal and prepare the subgrade to provide for the proposed sidewalk and 2" of compacted granular material, CA-6.

At locations where sidewalk shall be lowered to meet ADA accessibility requirements, the Contractor shall excavate subbase and subgrade as required to properly construct the lowered sidewalk. Earth excavation and disposal required to achieve the desired subgrade shall be considered incidental to the cost of the sidewalk.

Sidewalk ramps may require curb installation along the edge of the ramp where adjacent grading is prohibitive. In this application barrier curbs will be poured monolithically on each side of the curb ramp. These Barrier Curbs will be paid for at the contract unit price per FOOT (FT) of BARRIER CURB and shall include all labor, material, earth excavation and disposal, and equipment necessary for installation as specified herein.

Sidewalk shall be completely formed with lumber of 1½" nominal thickness and held securely in place with stakes.

All replacement sidewalks shall be a minimum of 5" thick. Sidewalk through driveways shall be increased to 6" thick for residential and 8" thick for commercial drive approaches. Sidewalk curb ramps shall be increased to 6" thick. The additional thickness will not be paid for separately but shall be considered incidental to Sidewalk Removal and Replacement.

The concrete used shall be Class SI concrete in accordance with Section 424 and 440 of the Standard Specifications, and should be cured as specified in the current issue of the Standard Specifications for Road and Bridge Construction. Membrane curing with W. R. Meadows CS 309, or approved equal, will be allowed with a white fugitive dye as per Type II membrane curing.

All sidewalk shall be sealed with W. R. Meadows "TIAH", or approved equal, immediately after seven (7) days of curing at a rate of 300 sq.ft. per gallon, utilizing a spray application. The surface must be thoroughly clean and dry at time of application.

The surface finish shall be a light broom finish.

The sidewalk shall be constructed with construction joints at five foot (5') intervals and shall be saw cut to a minimum depth of one inch (1") full width within twenty-four (24) hours of concrete placement, or tooled at the time of placement to the same depth.

Expansion joints of three-fourths inches (3/4") full depth bituminous fiber material are required where the new sidewalk abuts all curb, buildings, poles, other structures, through all drives on each side, and spaced as specified in the plans, at the recommended spacing based on the pour temperature, or as directed by the Engineer.

The contractor shall be responsible for damage or vandalism to finished concrete surfaces until final acceptance of the project. Damaged or vandalized concrete shall be replaced at the discretion of the Engineer.

At locations as directed by the Engineer, the Contractor shall excavate sod, topsoil and other material to install subbase granular material and a new sidewalk. Subbase thickness at these locations shall be 4". Earth Excavation required for this work will not be paid for separately but shall be considered incidental to this item.

Sidewalk curb ramps with detectable warning surface shall be constructed according to Standard 424001 and the details included. The Detectable Warning area shall be Red Color, 2' X 4' or 2' X 5' as required.

This work will be paid for at the contract unit price per SQUARE FOOT (SF) for SIDEWALK REMOVAL AND REPLACEMENT, 5" and DETECTABLE WARNINGS, which price shall include all labor and equipment necessary to remove the existing sidewalk, earth excavation and disposal, subbase material, disposal and placing sidewalk and furnishing and installing detectable warnings as specified herein. Root cutting and disposal of roots shall be considered incidental to this item.

SP R.10 – SEEDING - AURORA MIX:

This work shall consist of re-establishing swales and ditch lines, furnishing and placing 6" of pulverized top soil, fine grading, fertilizer, sowing of "Aurora Mix" grass seed by hand raking, and installing loose straw mulch stabilized with hydraulic mulch at the locations designated by the Engineer in accordance with the applicable portions of Section 250 and 251 of the Standard Specifications for Road and Bridge Construction.

Fertilizer nutrients shall be applied to the prepared areas at a 9:18:9 ratio at a rate of 200 pounds per acre.

Aurora Mix:

The City of Aurora grass seed mixture consists of:

- 24.93% ASAP Perennial Ryegrass
- 24.46% Caddieshack Perennial Ryegrass
- 24.33% Goalkeeper Perennial Ryegrass
- 12.37% Geronimo Kentucky Bluegrass
- 12.29% Kentucky Bluegrass (variety not stated)
- 1.34% Inert Matter, 0.28% Crop, 0.00% weed

This mixture shall be sown in such a manner as to produce a growth of grass similar in quality and appearance to the grass of adjoining areas. Grass seed mix shall be proportioned by weight and planted at a minimum rate of eight (8) pounds per thousand (1,000) square feet. Seeds furnished shall be first grade in quality, high in germination, and free from weeds. Seed shall not be sown in high wind, foul weather conditions, or when ground conditions are not proper in the opinion of the Engineer.

Within twenty-four (24) hours from the time seeding has been performed, the seeded area shall be covered with loose straw mulch and immediately stabilized in accordance with Method 2, Procedure 2 of Article 251.03 of the Standard Specifications.

The Contractor shall notify the Engineer a minimum of 48 hours prior to performing any landscape restoration. The Contractor shall demonstrate to the Engineer seeding and fertilizer applications rates prior to performing this work. Documentation regarding seed mixtures and fertilizer concentrations shall be provided to the Engineer prior to performing this work. In the event that the Contractor fails to adhere to these requirements, the work shall not be eligible for payment.

This work shall not be considered complete until a mowable weed-free stand of grass is obtained.

Measurement and Payment: The work specified herein shall be paid for by the contract unit price per SQUARE YARD (SY) for SEEDING – AURORA MIX, which price shall be payment in full for all labor, materials, and equipment necessary, including pulverized top soil, loose straw mulch covered with hydraulic mulch, and all other appurtenances required to perform this work in accordance with the plans, details, and specifications.

State of Illinois
DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION
FOR
EMPLOYMENT PRACTICES

In addition to all other labor requirements set forth in this proposal and in the Standard Specifications for Road and Bridge Construction, adopted by the Department of Transportation, during the performance of this contract, the Contractor for itself, its assignees, and successors in interest (hereinafter referred to as the "Contractor") agrees as follows:

I. SELECTION OF LABOR

The Contractor shall comply with all Illinois statutes pertaining to the selection of labor.

II. EQUAL EMPLOYMENT OPPORTUNITY

During the performance of this contract, the Contractor agrees as follows:

- (1) That it will not discriminate against any employee or applicant for employment because of race, color, religion, sex, national origin, ancestry, age, marital status, physical or mental handicap or unfavorable discharge from military service, and further that it will examine all job classifications to determine if minority persons or women are underutilized and will take appropriate affirmative action to rectify any such under-utilization.
- (2) That, if it hires additional employees in order to perform this contract or any portion hereof, it will determine the availability of minorities and women in the area(s) from which it may reasonably recruit and it will hire for each job classification for which employees are hired in such a way that minorities and women are not underutilized.
- (3) That, in all solicitations or advertisements for employees placed by it or on its behalf, it will state that all applicants will be afforded equal opportunity without discrimination because of race, color, religion, sex, national origin, ancestry, age, marital status, physical or mental handicap or unfavorable discharge from military service.
- (4) That it will send to each labor organization or representative of other workers with which it has or is bound by a collective bargaining or other agreement or understanding, a notice advising such labor organization or representative of the Contractor's obligations under the Illinois Human Rights Act and the Department's Rules and Regulations. If any such labor organization or representative fails or refuses to cooperate with the Contractor in its efforts to comply with such Act and Rules and Regulations, the Contractor will promptly so notify the Illinois Department of Human Rights and the City of Aurora and will recruit employees from other sources when necessary to fulfill its obligations thereunder.
- (5) That it will submit reports as required by the Department of Human Rights Rules and Regulations, furnish all relevant information as may from time to time be requested by the Department or the City of Aurora, and in all respects comply with the Illinois Human Rights Act and the Department's Rules and Regulations.

(6) That it will permit access to all relevant books, records, accounts and work sites by personnel of the City of Aurora and the Illinois Department of Human Rights for purposes of investigation to ascertain compliance with the Illinois Human Rights Act and the Department's Rules and Regulations.

(7) That it will include verbatim or by reference the provisions of this clause in every subcontract so that such provisions will be binding upon every such Subcontractor. In the same manner as with other provisions of this contract, the Contractor will be liable for compliance with applicable provisions of this clause by all its Subcontractors; and further it will promptly notify the City of Aurora and the Illinois Department of Human Rights in the event any Subcontractor fails or refuses to comply therewith. In addition, the Contractor will not utilize any Subcontractor declared by the Illinois Human Rights Commission to be ineligible for contracts or subcontracts with the State of Illinois or any of its political subdivisions or municipal corporations.

State of Illinois
DEPARTMENT OF TRANSPORTATION
Bureau of Local Roads & Streets
SPECIAL PROVISION
FOR
WAGES OF EMPLOYEES ON PUBLIC WORKS
Effective: January 1, 1999
Revised: January 1, 2015

1. **Prevailing Wages.** All wages paid by the Contractor and each subcontractor shall be in compliance with The Prevailing Wage Act (820 ILCS 130), as amended, except where a prevailing wage violates a federal law, order, or ruling, the rate conforming to the federal law, order, or ruling shall govern. The Illinois Department of Labor publishes the prevailing wage rates on its website at www.state.il.us/agency/idol/rates/rates.htm. If the Illinois Department of Labor revises the prevailing wage rates, the revised prevailing wage rates on the Illinois Department of Labor's website shall apply to this contract and the Contractor will not be allowed additional compensation on account of said revisions. The Contractor shall review the wage rates applicable to the work of the contract at regular intervals in order to ensure the timely payment of current wage rates. The Contractor agrees that no additional notice is required. The Contractor shall be responsible to notify each subcontractor of the wage rates set forth in this contract and any revisions thereto.
2. **Payroll Records.** The Contractor and each subcontractor shall make and keep, for a period of not less than five years from the date of the last payment on a contract or subcontract, records of all laborers, mechanics, and other workers employed by them on the project; the records shall include each worker's employed by them on the project; the records shall include information required by 820 ILCS 130/5 for each worker. Upon seven business days' notice, the Contractor and each subcontractor shall make available for inspection and copying at a location within this State during reasonable hours, the payroll records to the public body in charge of the project, its officers and agents, the Director of Labor and his deputies and agents, and to federal, State, or local law enforcement agencies and prosecutors.
3. **Submission of Payroll Records.** The Contractor and each subcontractor shall, no later than the 15th day of each calendar month, file a certified payroll for the immediately preceding month with the public body in charge of the project, except that the full social security number and home address shall not be included on weekly transmittals. Instead the payrolls shall include an identification number for each employee (e.g., the last four digits of the employee's social security number). The certified payroll shall consist of a complete copy of the payroll records except starting and ending times of work each day may be omitted.

The certified payroll shall be accompanied by a statement signed by the Contractor or subcontractor or an officer, employee, or agent of the contractor or subcontractor which avers that: (i) he or she has examined the certified payroll records required to be submitted by the Act and such records are true and accurate; (ii) the hourly rate paid to each worker is not less than the general prevailing rate of hourly wages required; and (iii) the Contractor or subcontractor is aware that filing a certified payroll that he or she knows to be false is a Class A misdemeanor.
4. **Employees Interviews.** The Contractor and each subcontractor shall permit his/her employees to be interviewed on the job, during working hours, by compliance investigators of the Department or the Department of Labor.

CITY OF AURORA GENERAL SPECIFICATIONS
SECTION 1 - DEFINITION OF TERMS

1.1 ADVERTISEMENT

The word Advertisement shall mean and refer to the official notice as published in the Aurora Beacon News, a daily newspaper published in the City of Aurora, Illinois, inviting bids for the construction of this improvement.

1.2 A.S.T.M.

Wherever the letters A.S.T.M. are herein used, they shall be understood to mean the American Society of Testing Materials.

1.3 ATTORNEY

Wherever the word Attorney is used in these specifications or in the contract, it shall be understood to mean the Corporation Counsel of the City or designee.

1.4 BIDDER

Wherever the word Bidder is used, it shall be understood to mean the individual, firm, or corporation formally submitting a proposal for the work contemplated, or any portion thereof, acting directly or through an authorized representative.

1.5 BOARD

Wherever the word Board or a pronoun in the place of it occurs in these specifications, it shall be interpreted to mean the Board of Local Improvements of the City of Aurora, Illinois, and any of its authorized representatives provided, however, that such persons shall be understood to represent said Board to the extent of the special duties delegated to such representatives.

1.6 CITY CLERK

Wherever the term City Clerk is used herein, it shall be understood to mean the City Clerk of the City of Aurora, Illinois.

1.7 CITY COUNCIL OR COUNCIL

Wherever the term City Council, or Council, appears in these specifications it shall be taken to mean the City Council of the City of Aurora, Illinois.

1.8 CONTRACT

The term Contract shall be understood to mean the agreement covering the performance of the work covered by these general specifications, including the advertisement for bids, instructions to bidders, bid proposal, performance bond, these general specifications, supplemental specifications, special provisions, general and detailed plans for the work, standard specifications referred to in the special provisions, all supplemental agreements entered into and all general provisions pertaining to the work or materials thereof, all of which are collectively referred to as the "Contract Documents".

1.9 CONTRACTOR

Wherever the word Contractor occurs in these specifications, it shall be interpreted to mean the person or persons, firm, or corporation who submits a proposal and thereafter enters into the contract governed by these specifications as party or parties of the second part, and the agents, employees, workmen, heirs, executors,

administrators, successors, or assignees thereof.

1.10 ENGINEER

Wherever the word Engineer is used in these specifications, it shall be interpreted to mean the City Engineer or his designee charged with directing and having charge of a portion of the project limited by the particular duties entrusted to him.

1.11 MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES

The MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES, latest edition, as adopted by the United States Department of Transportation Federal Highway Administration.

1.12 PAYMENT BOND

The term Payment Bond shall be understood to mean the bond executed by the Contractor and his surety guaranteeing the payment of all sums of money due for any labor, materials, apparatus, fixtures, or machinery furnished to such principal for the purpose of performing the contract work.

1.13 PERFORMANCE BOND

The term Performance Bond shall be understood to mean the bond, executed by the Contractor and his surety, guaranteeing complete execution of the contract.

1.14 PLANS

Wherever the word plans is used in these specifications, it shall be understood to mean all drawings, sketches, and detailed plans or reproductions thereof pertaining to the construction involved.

1.15 PROPOSAL

Wherever the word Proposal is used, it shall be taken to mean the written proposal of the bidder on the form furnished for the work contemplated.

1.16 PROPOSAL GUARANTY

The term Proposal Guaranty shall be understood to mean the security designated in the Advertisement for Bids or Notice to Contractors to be furnished by the bidder as a guaranty of good faith to enter into a contract for the work contemplated

1.17 SPECIFICATIONS

Wherever the word Specifications is used it shall be understood to include all directions and requirements contained herein or referred to hereby, together with all special provisions and written agreements made or to be made pertaining to the work involved. All articles referred to in these general specifications when not qualified otherwise than by numbers, shall be understood to be articles from these general specifications.

1.18 STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION

The STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, latest edition, prepared by the Illinois Department of Transportation and adopted by said Department.

1.19 STANDARD SPECIFICATIONS FOR SEWER AND WATER MAIN CONSTRUCTION

The STANDARD SPECIFICATIONS FOR SEWER AND WATER MAIN CONSTRUCTION, latest edition, as adopted by the Illinois Society of Professional Engineers.

1.20 STANDARD SPECIFICATIONS FOR TRAFFIC CONTROL ITEMS

The STANDARD TRAFFIC SIGNAL SPECIFICATIONS, latest edition, as adopted by the Illinois Department of Transportation.

1.21 STATE

Wherever the word State is used herein, it shall mean the State of Illinois.

1.22 SURETY

The word Surety shall be understood to mean the individuals who are, or the corporate body which is bound with and for the Contractor for the acceptable performance of the contract, and for his payment of all debts pertaining to the work.

1.23 WORK

Wherever the word "Work" is used, it shall mean the work including all materials, labor, tools, appliances, equipment, and appurtenance necessary and incidental thereto to perform and complete everything specified or implied in the plans, specifications, and in the contract documents, in full compliance with all the terms and conditions thereof and in a good and workmanlike manner.

SECTION 2
AWARD AND EXECUTION OF CONTRACT

2.1 PUBLIC OPENING OF PROPOSALS

Proposals will be opened and read publicly at the time and place specified in the advertisement, or as soon thereafter as the business of the City Clerk permits. Bidders, their authorized agents, and other interested parties are invited to be present.

2.2 AWARD OF CONTRACT

The decision of the award of the contract will be made as may be decided upon by the Council after bids have been opened and tabulated. The Contract shall be governed by the laws of the State of Illinois. No contract shall provide for arbitration of the parties.

2.3 BONDS AND INSURANCE

The bidder to whom the award of contract is made will be required under this contract to furnish a Performance Bond acceptable to the Engineer in the amount of one hundred percent (100%) of the full contract price, a Payment Bond, Public Liability Insurance, and Workers Compensation Insurance; all of which shall be acceptable to the City of Aurora.

2.4 SUBLETTING OR ASSIGNMENT OF CONTRACT

The Contractor shall not sublet, sell, or assign all, or any portion of the contract, or of the work provided for therein, without the written consent and authorization of the City, and in no case shall such consent relieve said Contractor from either, any, or all of the obligations herein entered into, or change the terms of the obligations hereof.

2.5 FAILURE TO EXECUTE CONTRACT

In the event that said bidder fails or refuses to execute said contract and furnish said bonds within the period of fifteen (15) days after mailing notice of such award or within such additional number of days as the City may determine, then the sum deposited as a proposal guaranty by said bidder on the work so awarded may be retained by the City as liquidated damages and not a forfeiture. It is hereby agreed that said sum is a fair estimate of the amount of damages that the City will sustain in case said bidder fails to enter into the contract and furnish bonds as herein provided, said actual damages being uncertain in amount and difficult to determine in the event of such failure or refusal by the bidder.

2.6 VENUE FOR LEGAL ACTION

The venue for any legal action that may arise from this agreement shall be in Kane County, Illinois.

2.7 WAIVER OF TRIAL BY JURY

The Contractor agrees to waive trial by jury for itself and all of its contracts with sub-Contractors shall contain a provision waiving trial by jury in the event of any legal action which may arise from this agreement with the City of Aurora as a party litigant.

SECTION 3 SCOPE OF THE WORK

3.1 INTENT OF PLANS AND SPECIFICATIONS

The true intent of the plans and these specifications is to provide for the erection and completion in every detail of the work described herein, and it is understood that the Contractor will furnish all labor, materials, equipment, tools, transportation, and necessary supplies, such as may reasonably be required to execute the contract in a satisfactory and workmanlike manner and in accordance with the plans, specifications, and terms of the contract. Both parties must stipulate any deviation from these requirements in writing.

3.2 SPECIAL WORK

Should any construction conditions which are not covered by the plans and these specifications be anticipated or encountered during construction, Supplemental Specifications for such work will be prepared by the Engineer and shall be considered a part of these specifications, the same as though contained fully herein.

3.3 INCREASED OR DECREASED QUANTITIES

The right is reserved, without impairing the contract, to make such increase or decrease in the quantities of the work as may be considered necessary to complete fully and satisfactorily the work included in the contract. The compensation to the Contractor for such changes shall be adjusted as provided herein.

3.4 ALTERATIONS IN PLANS AND SPECIFICATIONS

The City reserves the right to make such changes in the plans and in the character of the work as may be necessary or desirable to ensure completion in the most satisfactory manner, provided such changes do not materially alter the original plans and specifications. Such changes shall not be considered as waiving or invalidating any conditions or provisions of the contract.

3.5 EXTRA WORK

The City reserves the right, without impairing the contract, to order the performance of such work, of a class not contemplated in the proposal as may be considered necessary to complete fully and satisfactorily the work included in the contract. The Contractor shall do such extra work when ordered and authorized in writing by the Engineer, and the Contractor shall be compensated for such extra work on the basis and in the amount as provided herein.

3.6 EASEMENTS, PERMITS, AND REGULATIONS

The Contractor shall keep himself fully informed of all Federal, State, Municipal and local regulations, private contracts, grants, easements, and permits, in any manner affecting the work herein specified and provided for. He shall at all times observe and comply with and cause all his Subcontractors, agents, and employees to observe and comply with each and all of the same. The Contractor does hereby assume any and all liability under the same and shall protect and indemnify the City and its officers and employees against any and all claims or liabilities arising from or based on the violation of, or failure to comply with either or all of the same.

3.7 FINAL CLEANING UP

Upon completion and before final acceptance of the work, the Contractor shall, in addition to the detailed work of grading, restoring ground surfaces, repairing roadways and pavements, and all other work specifically provided for in these specifications, remove all falsework, excess or useless excavated materials, rejected materials, rubbish, temporary buildings, temporary foundations, replace or renew any fences damaged, and restore in an acceptable manner all property, both public and private, which may have been damaged during the prosecution of the work, and shall leave the site of the work in a neat and presentable condition satisfactory to

the Engineer.

SECTION 4 CONTROL OF THE WORK

4.1 AUTHORITY OF THE ENGINEER

The Engineer shall decide any and all questions which may arise as to the quality and acceptability of materials furnished and work performed, and as to the manner of performance and rate of progress of the work, and shall decide all questions which may arise as to the interpretation of the plans and specifications, and all questions as to the acceptable fulfillment of the terms of the contract.

4.2 PLANS AND WORKING DRAWINGS

General drawings, showing such details as are necessary to give a comprehensive idea of the construction contemplated, will be shown in the general plans, but the Contractor shall submit to the Engineer for approval such additional detailed shop drawings or working drawings, together with a detailed structural analysis of all component parts, as may be required for the construction of any part of the work and prior to the approval of such plans, any work done or material ordered shall be at the Contractor's risk.

The contract price shall include the cost of furnishing all working drawings and the Contractor will be allowed no extra compensation for such drawings.

4.3 DEVIATIONS FROM THE PLANS

No deviation from the general plans or the approved working drawings will be permitted without the written order of the Engineer. No allowance shall be made for work done other than is shown on the plans, profiles and drawings, and provided for in the specifications.

4.4 COORDINATION OF SPECIFICATIONS AND PLANS

In the event of any discrepancy between the plans and figures written thereon, the figures are to be considered as correct. In the case of any discrepancy between the plans and the specifications, the Engineer shall determine which are to govern. If there is a discrepancy between the general specifications and the supplemental specifications, the supplemental specifications are to govern.

The Contractor shall take no advantage of any apparent error or omission in the plans or specifications, but the Engineer shall be permitted to make such corrections and interpretations as may be deemed necessary for the fulfillment of the intent of the plans and specifications.

4.5 ORDER OF WORK

The order of sequence of the execution and/or conduct of the work shall be subject to the approval and/or direction of the Engineer, which approval and/or direction shall not in any way relieve the Contractor of any responsibility in connection with the prosecution to completion of the work under contract.

4.6 COOPERATION BY CONTRACTOR

The Contractor shall conduct his operation so as to interfere as little as possible with those of other Contractors, Subcontractors, the public, or adjoining property owners on or near the work site. The Contractor shall at all times during his absence from the work site have a competent superintendent or foreman capable of reading and thoroughly understanding the plans and specifications, as his agent on the work, who shall receive instructions from the Engineer or his authorized representative. The superintendent or foreman shall have full authority to execute the order and/or directions of the Engineer without delay and to promptly supply such materials, tools, plant equipment, and labor as may be required. The superintendent or foreman shall have a copy of the plans and specifications on the job at all time.

4.7 CONSTRUCTION STAKES

Reference lines and grade points for the location, alignment, and elevation of each structure will be determined and established by the Engineer, but the Contractor shall assume full responsibility for the alignment, elevations, and dimensions of each and all parts of the work with reference to the lines, points, and grades as established by the Engineer. For all structures, the Engineer shall furnish the Contractor with centerline and/or center points and such benchmarks or other points as are necessary to lay out the work correctly. The Contractor shall check all lines, points, and grades which may be given by the Engineer supplementary to the centerline, points, and control bench marks aforesaid, and shall be responsible for the accuracy of all measurements for grades and alignment of the work with reference to the centerline and/or points and bench marks established by the Engineer.

The Contractor shall exercise proper care in the preservation of alignment, grade, and reference stakes set for his use, or that of the Engineer. If such stakes are injured, lost, or removed by the Contractor's operations, they shall be reset at his expense.

4.8 INSPECTION

The Engineer or his representative shall be allowed access to all parts of the work at all times and shall be furnished such information and assistance by the Contractor as may be required to make a complete and detailed inspection thereof. Such inspection may include mill, plant, or shop inspection and any material furnished under these specifications is subject to such inspection.

SECTION 5 CONTROL OF MATERIALS

5.1 SPECIFICATIONS FOR MATERIALS

All materials used in this work shall conform in all respects to the specifications therefore as herein set forth. Where a specification for material to be used in this work is not specifically set forth in these specifications, such material shall conform in all respects to the specifications as set forth in the A.S.T.M. Standards and/or Tentative Standards adopted and in effect on the date of receiving bids.

5.2 SUBSTITUTION OF MATERIALS AND EQUIPMENT

Wherever in these specifications or on the plans for this work, materials or equipment are specified by trade names or catalog numbers of certain manufacturers, it is done for the purpose of establishing a standard of quality, durability, and/or efficiency, and not for any purpose of limiting competition. Wherever such definite reference is made in these specifications to any such material or equipment, it is understood that any equivalent material or equipment may be provided, however, that the written approval and acceptance of the Engineer of such equivalent material or equipment must be obtained prior to its purchase and/or incorporation in any part of the work.

5.3 THE METHODS OF TESTING

All tests of materials or equipment used in the work shall be made in accordance with the methods described in these specifications or the method of test prescribed in any specification for material or equipment herein specifically referred to and designated to govern the quality of any material or equipment.

Where a method of test for any material or equipment is not specifically provided for, such material or equipment shall be tested in accordance with the methods prescribed and set forth in the A.S.T.M. Standards and Tentative Standards adopted and in effect on the date of receiving bids.

5.4 DEFECTIVE MATERIALS

All materials not conforming to the requirements of these specifications shall be considered as defective and all such materials, whether in place or not, shall be rejected and shall be removed immediately from the work by the Contractor at his expense unless otherwise permitted by the Engineer. No rejected materials, the defects of which have been subsequently corrected, shall be used until approval has been given. Upon failure on the part of the Contractor to immediately comply with any order of the Engineer relative to the provisions of this section, the Engineer shall have the authority to remove and replace such defective material and to deduct the cost of removal and replacement from any moneys due or which may become due to the Contractor.

SECTION 6 LEGAL RELATIONS AND RESPONSIBILITY TO THE PUBLIC

6.1 COMPLIANCE WITH LAWS AND REGULATIONS

The Contractor shall at all times observe and comply with all Federal, State, Municipal and other local laws, ordinances, regulations, and requirements which in any manner affect the conduct of the work, and with all Federal, State and local laws and policies of non-discrimination, sexual harassment, prevailing wages and others applicable hereto; and all such orders or decrees as exist at the present and which may be enacted later, of bodies or tribunals having jurisdiction or authority over the work, and no plea of misunderstanding or ignorance thereof will be considered. He shall indemnify and save harmless the City and all its officers, agents, employees, and servants against any claim or liability arising from or based on the violation of any such law, ordinance, regulation, requirement, order or decree, whether by himself or his employees.

6.2 PERMITS AND LICENSES

The Contractor shall take out and procure at his own expense all permits and licenses required by Federal, State or local public authorities, and he shall, without extra compensation from the City, pay all fees and charges and give notices required incident to the due and lawful prosecution of the work in relation thereto.

6.3 PATENTED DEVICES, MATERIALS, AND PROCESSES

It is mutually understood and agreed that without exception contract prices are to include all royalties and costs arising in the work. It is the intent that whenever the Contractor is required or desires to use any design, device, material, or process covered by letters of patent or copyright, the right of such use shall be provided for by suitable legal agreement with the patent owner. The Contractor and Surety in all cases shall indemnify and save harmless the City from any and all claims for infringement by reason of the use of any such patent design, device, materials, or process, to be performed or used under the contract, and shall indemnify and save harmless the said City for any costs, expenses, attorney's fees, and damages which it may be obligated to pay, by reason of any such infringement at any time during the prosecution or after the completion of the work.

6.4 BARRICADES, LIGHTS, AND SIGNS

The Contractor shall at his own expense and without further or other order provide, erect, and maintain at all times during the progress or suspension of the work, suitable barricades, fences, signs, or other adequate protection, and shall provide, keep, and maintain such lights, danger signals, and watchmen as may be necessary or as may be ordered by the Engineer to ensure the safety of the public, as well as those engaged in connection with the work. All barricades and obstructions shall be protected at night by signal lights, which shall be suitably placed and which shall be kept burning from sunset to sunrise. Barricades shall be of substantial construction, and shall be painted in such a way as to increase their visibility at night.

The Contractor shall be held responsible for all damage to the work due to failure of barricades, signs, lights, and watchmen to protect it, and whenever evidence of such damage is found prior to acceptance, the Engineer may order such damaged portion immediately removed and replaced by the Contractor without cost to the City if, in his opinion, such action is justified. The Contractor's responsibility for the maintenance of barricades, signs, and lights shall not cease until the project shall have been accepted.

6.5 USE OF EXPLOSIVES

The use of explosives shall be prohibited.

6.6 PROTECTION AND RESTORATION OF PROPERTY

It is understood that in the execution of the work herein provided for there may be interference with and/or damage to trees, shrubbery, crops, fences, railroad tracks, overhead structures such as poles, wires, cables, underground structures such as sewers, gas mains, telephone conduits and cables, water mains, drains, service

connections, wires, pipes, conduits, located along, adjacent to, and/or crossing the locations of the work, and that it may be necessary to relocate or reconstruct certain of such structures, improvements, and installations and/or to make repairs to the same by reasons of doing the work herein provided for, and it is therefore particularly and specifically agreed that the Contractor, except as otherwise herein provided, shall do the work necessary for such relocation, reconstruction, and repair and shall bear and pay all of the cost and expense of such relocation, reconstruction, and/or repair of, and all damage done to any and all such pipe line and other structures, improvements, and installations, including service connections, if any, to adjacent property, existing at the date of the execution of the contract and/or existing, during the period of the work to be done under the contract, which may be interfered with, damaged, and/or necessarily relocated, reconstructed, or repaired in the performance of the work herein provided for, including the restoration and resurfacing of unpaved portions of public streets and alleys, rights-of-way, easements, and private property damaged or disturbed by the work, the same to be restored to as good condition as the same existed at the time of the commencement of any such work or relocation.

It is further agreed that the owners of any structures, improvements, installations, referred to in the preceding paragraph shall have the right to do the work or any part thereof necessary for the relocation, reconstruction, replacement, repair, and other work required by reason of any interference with and/or damage to such structures, improvements, installations, due to the prosecution of the work and upon completion of such work by them done, said owners may render bills to the Contractor for the cost and expense thereof, which bills shall be paid by the Contractor, without extra compensation therefore from the City, upon demand by said owners, or upon demand made by the City upon the Contractor for the payment thereof.

6.7 RESPONSIBILITY FOR DAMAGE CLAIMS

The Contractor agrees to indemnify and save harmless the City of Aurora, their agents, and employees from and against all loss and expenses (including costs and attorneys' fees) by reason of liability imposed by law or claims made upon the City of Aurora for damages because of bodily injury, including death at any time resulting therefrom sustained by any person or persons or on account of damage to property, including loss of use thereof, arising out of or in consequence of the performance of this work, whether such claims or injuries to persons or damage to property be due to the negligence of the Contractor, his Subcontractors or the City of Aurora.

The Contractor shall assume total risk and shall be responsible for any and all damages or losses caused by or in any way resulting from the work and provide all insurance necessary to protect and save harmless the City of Aurora and its employees. Said insurance shall include contractual liability equal to the limits hereinafter set forth.

The Contractor agrees to purchase a policy of insurance, which shall include the City of Aurora as an additional insured or provide separate coverage for the City with an owner's protective policy. All Insurance provided by Contractor, extending to owner as additional insurance, shall be primary and insurance maintained by owner shall be excess and not contributing with Contractor's insurance. The minimum amounts of insurance shall be as follows, except that no restrictions on occurrence limits will be permitted:

Bodily Injury Liability	Property Damage Liability	
<u>Each Occurrence</u>	<u>Each Occurrence</u>	<u>Aggregate</u>
\$3,500,000	\$500,000	\$7,000,000

The coverage and amounts above are minimum requirements and do not establish limits to the Contractor's liability. Other coverage and higher limits may be provided at the Contractor's option and expense.

Owner does not waive its subrogation rights against Contractor and/or any Subcontractor for damages due to losses to owner due to the fault or negligence of the Contractor and/or any Subcontractors during or as a result of the performance of the work.

All such insurance must include an endorsement whereby the insurer agrees to notify the City of Aurora at least

thirty (30) days prior to non-renewal, reduction or cancellation. The Contractor shall cease operations on the project if the insurance is canceled or reduced below the required amount of coverage. All costs for insurance as specified herein will not be paid for separately, but shall be considered as incidental to the contract.

6.8 WORKERS COMPENSATION ACT

The Contractor further agrees to insure his employees and their beneficiaries and to provide the employees and the beneficiaries of any Subcontractor employed from time to time by him on said work, the necessary first-aid, medical, surgical, and hospital services and any compensation provided for in the Workers Compensation Act of the State of Illinois that is or may be in force in the State.

Such insurance shall be placed by said Contractor in a company or association (to be approved by the City and to be accepted by the Council thereof) authorized under the laws of the State of Illinois to insure the liability above specified.

Said Contractor hereby further agrees to indemnify, keep and save harmless said City from all action, proceedings, claims, judgments, awards, and costs, losses, damages, expenses, and attorney's fees which may in any way be brought against said City by reason of any accidental injuries or death suffered by any of his employees or the employees of any Subcontractor employed by him in and about the performance of the work provided for in the contract, and any and all liability resulting thereupon; and said Contractor, in case of any suit, action, or proceeding on account of any or all of the foregoing shall defend the same for and on behalf of said City and indemnify the City therefore and pay the amount of any and all awards and final judgments and/orders rendered and entered therein, together with all loss, costs, damages, attorney's fees, and expenses incurred therein. Said Contractor shall be the sole employer of its employees and workers, and in no way so shall the City be considered a joint employer of same under any circumstance.

6.9 LOCAL BIDDER PREFERENCE

O18-070, amended by O20-029 approved April 28, 2020 defines "Local business" to mean a vendor or contractor who has a valid, verifiable physical business address located within the corporate boundaries of the City of Aurora at least twelve months prior to a bid or proposal opening date, from which the vendor, contractor or consultant operates or performs business on a daily basis, including manufacturing production or distribution. The business must disclose the percentage of workforce in the City of Aurora; be registered with the City of Aurora, if applicable; be subject to City of Aurora taxes (inclusive of sales taxes); be current with property tax payments and sales tax payments; not have any outside cited code violations; not have any outstanding debts to the City of Aurora; have adequately qualified and trained staff to service the bid of interest.

SECTION 7 PROSECUTION AND PROGRESS OF WORK

7.1 SUBLETTING OR ASSIGNMENT OF WORK

If the Contractor sublets the whole or any part of the work to be done under the contract, with or without the written consent of the City, he shall not, under any circumstances, be relieved of his liabilities and obligations. All transactions of the Engineer shall be with the Contractor; Subcontractors shall be recognized only in the capacity of employees or workmen and shall be subject to the same requirements as to character and competence. In case any party or parties, to whom any work under the contract shall have been sublet, shall disregard the directions of the Engineer or his duly authorized representatives, or shall furnish any unsatisfactory work or shall fail or refuse in any way to conform to any of the provisions or conditions of the contract, then in that case, upon the written order of the Engineer, the Contractor shall require said party or parties in default to discontinue work under the contract. Said work shall be corrected or made good and shall be continued and completed by the said Contractor or by such other party or parties as are approved by the Engineer, in the manner and subject to all of the requirements specified in the contract.

7.2 PROSECUTION OF WORK

The Contractor shall begin the work to be performed under the contract no later than ten (10) days after the execution and acceptance of the contract, unless otherwise provided. The work shall be conducted in such a manner and with sufficient materials, equipment and labor as is considered necessary to ensure its completion within the time specified in the contract. The Contractor shall solely be fully responsible for complying with state and local prevailing wage requirements in accordance with its Bidders Certification, and for all wage rate and hour regulations and applications

7.3 GUARANTEE AND MAINTENANCE OF WORK

The Contractor shall guarantee the work to be free from defects of any nature for a period of one year from and after the final acceptance and payment for the work by the City, and the Contractor shall maintain said work and shall make all needed repairs and/or replacements during this one year period which in the judgment of the Council, may be necessary to ensure the delivery of the work to the City in first-class condition and in full conformity with the plans and specifications therefore, at the expiration of the guarantee period.

7.4 PAYMENT

Basis of Payment

Payment of the CONTRACTOR for performance of the CONTRACT shall be made by the OWNER and shall be based on the value of the installation resulting from the CONTRACTOR's operations.

The cost of all WORK incidental to the completion of the project in accordance with the Plans and Specifications, excepting authorized extra WORK, shall be included in the unit and lump sum prices stated in the CONTRACTOR's accepted Proposal. The amount obtained by the summation of the products of the quantities of WORK performed or the respective unit or lump sum prices for several items listed in the proposal shall be payment in full, except for payment for authorized extra WORK, for delivering the completed project to the OWNER in accordance with the Plans and Specifications.

Submission of Bid Breakdown

Within 10 days after the execution of this CONTRACT, the CONTRACTOR must submit to the ENGINEER in duplicate an acceptable breakdown of the lump sums and unit prices bid for items of the CONTRACT, showing the various operations to be performed under the CONTRACT, and the value of each of such operations, the total of such items to equal the total price bid. The CONTRACTOR shall also submit such other information relating to the bid prices as may be required and shall revise the bid breakdown as directed.

Thereafter, the breakdown may be used for checking the CONTRACTOR's applications for partial payments hereunder but shall not be binding upon the OWNER or the ENGINEER for any purpose whatsoever.

Partial Payments

When not otherwise provided for under the Specifications for an item of WORK or a complete project, and if the rate of progress is satisfactory to the ENGINEER, partial payments will be made the CONTRACTOR by the OWNER during progress of construction. The amount of each partial payment shall be limited to ninety (90) percent (unless otherwise provided in the Instructions to Bidders) of the value of the WORK shown in the Engineer's periodic estimate to have been done and installed in place by the CONTRACTOR subsequent to the time of commencing WORK or of making the last preceding partial payment on account of WORK done. An amount greater than ninety (90) percent of the value of a largely completed project may be paid the CONTRACTOR at the option of the OWNER.

The CONTRACTOR's request for payment shall be in the form of an invoice, submitted to the OWNER through the ENGINEER, setting forth amounts due for WORK completed on payment items set forth in the CONTRACTOR's Proposal, and shall be accompanied by:

- (1) CONTRACTOR's Sworn Statement setting forth the Subcontractors and material suppliers, the amount requested for each of the Subcontractors or material suppliers, and the amount of the subcontract or material to be completed.
- (2) Subcontractor or material suppliers waivers of lien for amounts requested on previous payment requests.
- (3) CONTRACTOR's waivers of lien.

The CONTRACTOR's request will be reviewed by the ENGINEER and if the ENGINEER is in agreement with the value of WORK completed, as requested by the CONTRACTOR, and if the request is accompanied by the CONTRACTOR's Sworn Statement, Subcontractor and material suppliers waiver of lien as stated above, and by the CONTRACTOR's waiver of lien, the ENGINEER will recommend payment to the OWNER.

Partial payment made to the CONTRACTOR by the OWNER for WORK performed shall in no way constitute an acknowledgement of the acceptance of the WORK nor in any way prejudice or affect the obligation of the CONTRACTOR, at his expense, to repair, correct, renew or replace any defects or imperfections in the construction of the WORK under CONTRACT and its appurtenances, nor any damage due or attributable to such defect, damage and the CONTRACTOR shall be liable to the OWNER for failure to correct the same as provided herein.

Payment in full or in part may be withheld for reasons which include but are not limited to: (1) the existence of defective work which is not remedied; (2) the existence of third party claims filed or reasonable evidence indicating probable filing of such claims; (3) the failure of the CONTRACTOR to make payments properly to Subcontractors or for labor, materials or equipment; (4) the existence of reasonable evidence that the WORK cannot be completed for the unpaid balance of the contract sum; (5) damage to the OWNER; (6) the existence of reasonable evidence that the WORK will not be completed within the CONTRACT time, and that the unpaid balance will not be adequate to cover actual or liquidated damages for the anticipated delay; or, (7) persistent failure to carry out the work in accordance with the contract documents. If within a reasonable time not to exceed 45 days CONTRACTOR has not remedied any condition for which payment in full has been withheld, then OWNER may make such payments as OWNER deems necessary to remedy such situation from said funds withheld and pay the balance to CONTRACTOR, or if, sums are still due to remedy the situation, CONTRACTOR will remit any balances due to OWNER within 10 days of notice of same.

ACCEPTANCE AND FINAL PAYMENT

Whenever the CONTRACT shall have been completely performed on the part of the CONTRACTOR, and all parts of the WORK have been approved by the ENGINEER and accepted by the OWNER, including the resolution of all matters of dispute, a final estimate showing the value of the WORK will be prepared by the ENGINEER as soon as the necessary measurements and computations can be made, all prior estimates upon which payments have been made being approximate only and subject to corrections in the final payments.

The CONTRACTOR shall submit a final payment request showing the total quantities completed for the entire project and all previous payouts. This payment request shall be accompanied by a sworn affidavit listing all Subcontractors and material suppliers and the total payments to each. Final Waivers of Lien from the Subcontractors and material suppliers as well as the CONTRACTOR shall also be furnished at this time.

A final payment including all amounts of money shown by the final estimate to be due the CONTRACTOR shall be made by the OWNER as soon as practicable after the final acceptance of the WORK, provided the CONTRACTOR has furnished the OWNER satisfactory evidence that all sums of money due for labor, materials, apparatus, fixtures or machinery furnished for the purpose of performing the Contract have been paid or that the person or persons to whom the same may respectively be due have consented to such final payment.



Illinois Department of Transportation

Local Agency Proposal Bid Bond

RETURN WITH BID

Route Various
County Kane
Local Agency City of Aurora
Section _____

PAPER BID BOND

WE _____ as PRINCIPAL,
and _____ as SURETY,

are held jointly, severally and firmly bound unto the above Local Agency (hereafter referred to as "LA") in the penal sum of 5% of the total bid price, or the amount specified in the proposal documents in effect on the date of invitation for bids whichever is the lesser sum. We bind ourselves, our heirs, executors, administrators, successors, and assigns, jointly pay to the LA this sum under the conditions of this instrument.

WHEREAS THE CONDITION OF THE FOREGOING OBLIGATION IS SUCH that, the said PRINCIPAL is submitting a written proposal to the LA acting through its awarding authority for the construction of the work designated as the above section.

THEREFORE if the proposal is accepted and a contract awarded to the PRINCIPAL by the LA for the above designated section and the PRINCIPAL shall within fifteen (15) days after award enter into a formal contract, furnish surety guaranteeing the faithful performance of the work, and furnish evidence of the required insurance coverage, all as provided in the "Standard Specifications for Road and Bridge Construction" and applicable Supplemental Specifications, then this obligation shall become void; otherwise it shall remain in full force and effect.

IN THE EVENT the LA determines the PRINCIPAL has failed to enter into a formal contract in compliance with any requirements set forth in the preceding paragraph, then the LA acting through its awarding authority shall immediately be entitled to recover the full penal sum set out above, together with all court costs, all attorney fees, and any other expense of recovery.

IN TESTIMONY WHEREOF, the said PRINCIPAL and the said SURETY have caused this instrument to be signed by their respective officers this _____ day of _____

Principal

(Company Name)

(Company Name)

By: _____
(Signature and Title)

By: _____
(Signature and Title)

(If PRINCIPLE is a joint venture of two or more contractors, the company names, and authorized signatures of each contractor must be affixed.)

Surety

(Name of Surety)

By: _____
(Signature of Attorney-in-Fact)

STATE OF ILLINOIS,

COUNTY OF _____

I, _____, a Notary Public in and for said county,

do hereby certify that _____

(Insert names of individuals signing on behalf of PRINCIPAL & SURETY)

who are each personally known to me to be the same persons whose names are subscribed to the foregoing instrument on behalf of PRINCIPAL and SURETY, appeared before me this day in person and acknowledged respectively, that they signed and delivered said instruments as their free and voluntary act for the uses and purposes therein set forth.

Given under my hand and notarial seal this _____ day of _____

My commission expires _____

(Notary Public)

ELECTRONIC BID BOND

☐ Electronic bid bond is allowed (box must be checked by LA if electronic bid bond is allowed)

The Principal may submit an electronic bid bond, in lieu of completing the above section of the Proposal Bid Bond Form. By providing an electronic bid bond ID code and signing below, the Principal is ensuring the identified electronic bid bond has been executed and the Principal and Surety are firmly bound unto the LA under the conditions of the bid bond as shown above. (If PRINCIPAL is a joint venture of two or more contractors, an electronic bid bond ID code, company/Bidder name title and date must be affixed for each contractor in the venture.)

Electronic Bid Bond ID Code

(Company/Bidder Name)

(Signature and Title)

Date

PROPOSAL

TO: THE HONORABLE MAYOR AND CITY COUNCIL
CITY OF AURORA
44 EAST DOWNER PLACE
AURORA, ILLINOIS 60507

1. Proposal of GERARD SENGLE WATER CO.
for the improvement known as the **San Souci Water Main Improvements, Bid 21-34.**
2. The plans and specifications for the proposed improvements are those prepared by the City of Aurora Engineering Division and approved by the City Council of Aurora, Illinois.
3. In submitting this proposal, the undersigned declares that the only persons or parties interested in the proposal as principals are those named herein, and that the proposal is made without collusion with any person, firm, or corporation.
4. The undersigned further declares that he has carefully examined the proposals, plans, specifications, form of contract and contract bond, and special provisions, if any, and that he has inspected in detail the site of the proposed work and that he has familiarized himself with all of the local conditions affecting the contract and detailed requirements of construction, and understands that in making this proposal he waives all right to plead any misunderstanding regarding the same.
5. The undersigned further understands and agrees that if the proposal is accepted, he is to furnish and provide all necessary machinery, tools, apparatus and other means of construction and to do all of the work and to furnish all of the materials and labor required.
6. The undersigned declares that he understands that the quantities mentioned are approximate only, and that they are subject to increase or decrease; that he will take in full payment therefore the amount of the summation of the actual quantities, as finally determined, and multiplied by the unit prices shown in the schedule of prices contained herein.
7. The undersigned agrees that the unit prices submitted herewith are for the purpose of obtaining a gross sum and for use in computing the value of extras and deductions; that if there is a discrepancy between the gross sum bid and that resulting from the summation of the quantities multiplied by their respective unit prices, the latter shall apply.
8. The undersigned agrees that if the City decides to extend or shorten the improvement, or otherwise alter it by extras or deductions, including the elimination of any one or more of the items, as provided in the specifications, he will perform the work as altered, increased or decreased, at the contract unit prices without claim for profits lost as a result of any work or items eliminated by the City of Aurora.
9. The undersigned agrees that the Engineer may, at any time during the progress of the work covered by this contract, order other work or materials incidental thereto, and that all such work and materials as do not appear in the proposal or contract as a specific item accompanied by a unit price, and which are not included under the bid price for other items in this contract, shall be performed as extra work, and that he will accept as full compensation therefore the actual cost plus ten percent (10%), the actual cost to be determined as provided for in the specifications.
10. The undersigned further agrees to execute a contract, a contract bond satisfactory to and in the form prescribed by the City in the penal sum of the full amount of the contract, guaranteeing the faithful performance of the work in accordance with the terms of the contract within **fifteen (15)** days after receiving the notice of award of the contract.

11. The undersigned further agrees to begin work not later than **ten (10)** calendar days after the execution or by the date stated within the contract documents and approval of the contract and contract bond, unless otherwise provided, and to prosecute the work in such a manner and with sufficient materials, equipment, and labor as will ensure its completion within the time limit specified herein, it being understood and agreed that the completion within the time limit is an essential part of the contract.
12. The undersigned agrees to complete the work within the time stipulated in the Special Provisions.
13. All work shall be completed to the satisfaction of the Engineer by the above dates unless the Engineer in accordance with the specifications grants additional time. In case of failure to complete the work within the time named herein, or within such extra time as may have been allowed by extensions, the undersigned agrees that the City shall withhold from such sums as may be due him under the terms of the contract the liquidated damages as set forth in the Standard Specifications, which costs shall be considered and treated not as a penalty, but as damages due the Municipality from the undersigned by reason of inconvenience to the public, added cost of engineering and supervision, and other items which have caused an expenditure of public funds resulting from the failure of the undersigned to complete the work within the time specified in the contract.
14. If this proposal is accepted and the undersigned shall fail to execute a contract and contract bond as required herein, it is hereby agreed that the amount of the check or draft or bidder's bond substituted in lieu thereof shall become the property of the City and shall be considered not as a penalty but as payment of liquidated damages due to delay and other causes suffered by the City because of the failure to execute said contract and contract bond, otherwise said check or draft or bidder's bond substituted in lieu thereof shall be returned to the undersigned.
15. Accompanying this proposal is either a **5% Bid Bond** or a proposal guaranty check, complying with the specifications, made payable to the City Treasurer of the City of Aurora. The amount of the check is \$

16. The undersigned submits herewith his schedule of prices covering the work to be performed under this contract, he understands that he must show in the schedule the unit prices for which he proposes to perform each item of work, that the extensions must be made by him, and that if not so done, his proposal may be rejected as irregular or non-responsive.
17. The undersigned agrees to conform to Section 100 of the Standard Specifications and to Article 107.27 of that section indemnifying and saving harmless the City of Aurora and its officers, agents, and employees. The Contractor shall provide insurance with limits as stated in the Article 6.7 of the *City of Aurora - General Specifications*.
18. The City of Aurora reserves the right to reject any or all of the bids and to waive any and all irregularities and technicalities. The City of Aurora shall either award the project or reject the bids within Sixty (60) calendar days after the bid opening. This time frame may be extended upon mutual agreement of the City and the Bidder.
19. The undersigned of this proposal agrees that he or she has examined all sections of this Proposal, Specifications, and Bidding Documents and hereby understands and accepts the provisions for access, or the lack of access, to the construction site and shall claim no compensation other than the prices as bid for this condition of accessibility.
20. The undersigned further agrees that the unit prices submitted herewith are for the complete item constructed, including all labor, equipment, material and other necessary incidental work.
21. The undersigned agrees to indemnifying and saving harmless the City of Aurora, its officers, agents, employees, and servants by filing with the City, prior to the execution of the contract, copies of completed Certificates of Insurance satisfactory to the City, with the City of Aurora named as co-insured; automobile

liability insurance covering owned, non-owned, and hired vehicles with limits of liability as stated in the City of Aurora - General Specifications Article 6.7.

22. No bid shall be considered unless the party offering it shall furnish evidence satisfactory to the City of Aurora that he has been previously engaged in the quality construction of improvements of the same character as the one herein specified, and that he has the necessary facilities, equipment, experience, and ability and pecuniary resources to fulfill the conditions of the contract
23. No contract will be awarded to any bidder where that bidder or any principal or supervisory personnel of the bidder has been personally involved with another business that has been delinquent or unfaithful in any former contract with the City or where that bidder or any supervisory personnel of the bidder has been personally involved with another business that is a defaulter as surety or otherwise upon obligation to the City.
24. The Illinois Freedom of Information Act (FOIA) has been amended and effective January 1, 2010, adds a new provision to Section 7 of the Act which applies to public records in the possession of a party with whom the City of Aurora has contracted. The City of Aurora will have only a very short period of time from receipt of a FOIA request to comply with the request, and there is a significant amount of work required to process a request including collating and reviewing the information. The undersigned acknowledges the requirements of FOIA and agrees to comply with all requests made by the City of Aurora for public records (as that term is defined by Section 2(c) of FOIA) in the undersigned's possession and to provide the requested public records to the City of Aurora within two (2) business days of the request being made by the City of Aurora. The undersigned agrees to indemnify and hold harmless the City of Aurora from all claims, costs, penalty, losses and injuries (including but not limited to, attorney's fees, other professional fees, court costs and/or arbitration or other dispute resolution costs) arising out of or relating to its failure to provide the public records to the City of Aurora under this agreement.
25. The undersigned submits herewith this **Schedule of Prices** covering the work to be performed under this contract:



Schedule of Prices
San Souci Water Main Improvements
Base Bid - Addendum No. 1
Bid 21-34

Route Coach & Surrey Ln, Lake View Dr, Lake View Ct
Route Surrey Ct, Wyckwood Ct, North & Middle Queensbury Ct
County Kane
Local Agency City of Aurora

RETURN WITH BID

(For complete information covering these items, see plans and specifications)

Base Bid - Addendum No. 1					
NO.	ITEM	UNIT	QUANTITY	UNIT COST	AMOUNT
1	Abandon Valve Box	EA	14	100.00	1400.00
2	Abandon Valve Vault	EA	1	300.00	300.00
3	Tree Root Pruning	LF	255	4.00	1020.00
4	Select Granular Trench Backfill	CY	3,940	1.00	3940.00
5	Unsuitable Soil Removal and Replacement	CY	138	26.00	3588.00
6	Exploration Excavation, 8 Ft	LF	225	1.00	225.00
7	Restrained Joint Gasket, 8"	EA	49	65.00	3185.00
8	Zinc Coated DIP WM, CI 52, 8" w/V-bio Polywrap	LF	5,810	100.00	581,000.00
9	8" Water Main Lining	LF	920	113.00	103,960.00
10	8" Water Main Lining - Access Pit	LS	1	23,700.00	23,700.00
11	Additional Ductile Iron Fittings (Lining)	LB	112	1.00	112.00
12	Cut Out Existing 8" Butterfly Valve	EA	1	3000.00	3000.00
13	8" MJ Gate Valve in 48" Vault	EA	12	3200.00	38,400.00
14	8" MJ Gate Valve in 48" Vault (Lining)	EA	1	3200.00	3200.00
15	Line Stop, 8"	EA	1	3450.00	3450.00
16	Fire Hydrant Assembly Removal	EA	20	600.00	12,000.00
17	Fire Hydrant Assembly	EA	18	5400.00	97,200.00
18	Fire Hydrant Assembly (Lining)	EA	2	7000.00	14,000.00
19	Sanitary Service Removal and Replacement, 6" PVC C-900	LF	315	20.00	6300.00
20	Temporary Water Service	LS	1	39,450.00	39,450.00
21	Water Service Reinstatement (Lining)	EA	7	450.00	3150.00
22	1" Dia. Curb Stop & B-box	EA	41	500.00	20,500.00
23	1" Dia. Tap and Corp Stop	EA	41	750.00	30,750.00
24	1" Dia. Tap and Corp Stop & Service Transfer	EA	59	950.00	56,050.00
25	1" Water Service, Trenchless	LF	806	25.00	20,150.00
26	1" Water Service, Open Cut	LF	709	15.00	10,635.00
27	Connect to Existing 8" WM	EA	4	3575.00	14,300.00
28	Water Main Cold Weather Protection	LF	40	25.00	1000.00
29	Water Main Lowering, 8" DIP CL 52	LF	60	150.00	9000.00
30	Temporary Pavement, 2"	SY	286	1.00	286.00
31	Class D Patching, 5" Binder & 1.5" Surface	SY	5,561	38.80	215,766.80
32	Combination PCC Curb and Gutter Removal and Replacement	LF	525	40.00	21,000.00
33	PCC Sidewalk Rem. and Replace, 5"	SF	2,075	8.00	16,600.00
34	Detectable Warnings	SF	10	40.00	400.00
				Page 1 Total =	1,359,017.80




Schedule of Prices
San Souci Water Main Improvements
Base Bid - Addendum No. 1
Bid 21-34

Route	Coach & Surrey Ln, Lake View Dr, Lake View Ct
Route	Surrey Ct, Wyckwood Ct, North & Middle Queensbury Ct
County	Kane
Local Agency	City of Aurora

RETURN WITH BID

(For complete information covering these items, see plans and specifications)

Base Bid - Addendum No. 1					
NO.	ITEM	UNIT	QUANTITY	UNIT COST	AMOUNT
35	PCC Drive Approach Removal & Replacement, 6", Residential	SY	21	100.00	2100.00
36	HMA Drive Approach Removal & Replacement, 2", Residential	SY	62	25.00	1550.00
37	Brick Driveway Approach Removal and Replacement, Residential	SF	22	20.00	440.00
38	Mailbox Removal and Reinstallation	EA	5	50.00	250.00
39	Seeding - Aurora Mix	SY	1,000	10.00	10,000.00
40	Items Ordered by Engineer	Allowance	1	\$190,000.00	\$190,000.00
41	Traffic Control and Protection	LS	1	59,000.00	59,000.00
42	Inlet Protection	EA	27	115.00	3105.00
43	Dewatering Bag	EA	2	150.00	300.00
44	Temporary Staging	CY	300	5.00	1500.00
45	Non-Special Waste Disposal	TON	100	15.00	1500.00
46	Special Waste Disposal	TON	100	15.00	1500.00
				Page 2 Total =	271,245.00
				Page 1 Total =	1,359,017.80
				Bidder's Total Base Proposal for Making Entire Improvements =	1,630,262.80



**Schedule of Prices
San Souci Water Main Improvements
Alternate Bid - Addendum No. 1
Bid 21-34**

Route	Coach & Surrey Ln, Lake View Dr, Lake View Ct
Route	Surrey Ct, Wyckwood Ct, North & Middle Queensbury Ct
County	Kane
Local Agency	City of Aurora

RETURN WITH BID

(For complete information covering these items, see plans and specifications)

Alternate Bid - Addendum No. 1

NO.	ITEM	UNIT	QUANTITY	UNIT COST	AMOUNT
1	Abandon Valve Box	EA	14		
2	Abandon Valve Vault	EA	1		
3	Tree Root Pruning	LF	130		
4	Select Granular Trench Backfill	CY	511		
5	Unsuitable Soil Removal and Replacement	CY	25		
6	Exploration Excavation, 8 Ft	LF	180		
7	Restrained Joint Gasket, 8"	EA	22		
8	Zinc Coated DIP WM, CI 52, 8" w/V-bio Polywrap	LF	740		
9	8" Water Main Lining	LF	6,120		
10	8" Water Main Lining - Access Pit	EA	23		
11	Additional Ductile Iron Fittings (Lining)	LB	560		
12	Cut Out Existing 8" Butterfly Valve	EA	15		
13	8" MJ Gate Valve in 48" Vault	EA	5		
14	8" MJ Gate Valve in 48" Vault (Lining)	EA	3		
15	Line Stop, 8"	EA	1		
16	Fire Hydrant Assembly Removal	EA	10		
17	Fire Hydrant Assembly	EA	3		
18	Fire Hydrant Assembly (Lining)	EA	17		
19	Sanitary Service Removal and Replacement, 6" PVC C-900	LF	80		
20	Temporary Water Service	LS	1		
21	Water Service Reinstatement (Lining)	EA	83		
22	1" Dia. Curb Stop & B-box	EA	9		
23	1" Dia. Tap and Corp Stop	EA	9		
24	1" Dia. Tap and Corp Stop & Service Transfer	EA	15		
25	1" Water Service, Trenchless	LF	30		
26	1" Water Service, Open Cut	LF	258		
27	Connect to Existing 8" WM	EA	4		
28	Water Main Cold Weather Protection	LF	20		
29	Water Main Lowering, 8" DIP CL 52	LF	10		
30	Temporary Pavement, 2"	SY	41		
31	Class D Patching, 5" Binder & 1.5" Surface	SY	688		
32	Combination PCC Curb and Gutter Removal and Replacement	LF	200		
33	PCC Sidewalk Rem. and Replace, 5"	SF	775		
34	Detectable Warnings	SF	10		
Page 1 Total =					



**Schedule of Prices
San Souci Water Main Improvements
Alternate Bid - Addendum No. 1
Bid 21-34**

Route	Coach & Surrey Ln, Lake View Dr, Lake View Ct
Route	Surrey Ct, Wyckwood Ct, North & Middle Queensbury Ct
County	Kane
Local Agency	City of Aurora

RETURN WITH BID

(For complete information covering these items, see plans and specifications)

Alternate Bid - Addendum No. 1					
NO.	ITEM	UNIT	QUANTITY	UNIT COST	AMOUNT
35	PCC Drive Approach Removal & Replacement, 6", Residential	SY	25		
36	HMA Drive Approach Removal & Replacement, 2", Residential	SY	60		
37	Brick Driveway Approach Removal and Replacement, Residential	SF	10		
38	Mailbox Removal and Reinstallation	EA	5		
39	Seeding - Aurora Mix	SY	700		
40	Items Ordered by Engineer	Allowance	1	\$190,000.00	\$190,000.00
41	Traffic Control and Protection	LS	1		
42	Inlet Protection	EA	27		
43	Dewatering Bag	EA	2		
44	Temporary Staging	CY	300		
45	Non-Special Waste Disposal	TON	100		
46	Special Waste Disposal	TON	100		
Page 2 Total =					
Page 1 Total =					
Bidder's Total Alternate Proposal for Making Entire Improvements =					



(If an individual)

Signatures

Signature of Bidder _____

Business Address _____

(If a partnership)

Firm Name _____

Signed by _____

Business Address _____

Insert
Names and
Addresses of
All Partners

(If a corporation)

Corporate Name GERAZI, Serru & Watulo.

Signed By Frank Gerazi

President

Business Address 1785 Azm. TAGE COURT

ADDISON ILLINOIS 60101

President FRANK GERAZI

Secretary JAMES GERAZI

Treasurer FRANK GERAZI

Attest: [Signature]

Secretary

BIDDER'S CERTIFICATION

I/We hereby certify that:

- A. A complete set of bid papers, as intended, has been received, and that I/We will abide by the contents and/or information received and/or contained herein.
- B. I/We have not entered into any collusion or other unethical practices with any person, firm, or employee of the City which would in any way be construed as unethical business practice.
- C. I/We have adopted a written sexual harassment policy which is in accordance with the requirements of Federal, State and local laws, regulations and policies and further certify that I/We are also in compliance with all other equal employment requirements contained in Public Act 87-1257 (effective July 1, 1993) 775 ILCS 5/2-105 (A).
- D. I/We are in compliance with the most current "Prevailing Rate" of wages for laborers, mechanics and other workers as required by the State of Illinois Department of Labor.
- E. I/We operate a drug free environment and drugs are not allowed in the workplace or satellite locations as well as City of Aurora sites in accordance with the Drug Free Workplace Act of January, 1992.
- F. The Bidder is not barred from bidding on the Project, or entering into this contract as a result of a violation of either Section 33E-3 or 33E-4 of the Illinois Criminal Code, or any similar offense of "bid rigging" or "bid rotating" of any state or the United States.
- G. I/We will submit with our bid, for all contracts in excess of \$25,000.00, a certificate indicating participation in apprenticeship and training programs approved and registered with the United States Department of Labor.

☐ Contractor shall check the box indicating that a copy of applicable program certification is attached.

- H. I/We have obtained IDOT prequalification as described in Check Sheet LRS6 in the "Supplemental Specifications and Recurring Special Provisions" in the categories appropriate for the type of work proposed for this project.

☐ Contractor shall check the box indicating that a copy of the IDOT prequalification certification for the appropriate categories is attached.

- I. I/We will abide by all other Federal, State and local codes, rules, regulations, ordinances and statutes.

- J. ~~I/We will abide by the "Illinois Preference Act" which requires contractors to use at least 90% Illinois laborers on all public works projects that receive State funds or funds administered by the State during a period of "excessive unemployment" (Employment of Illinois Workers on Public Works Act, 30 ILCS 570/).~~

COMPANY NAME GERARDI Sewer & Water Co.

ADDRESS 1785 Armitage Court

CITY/STATE/ZIP CODE Aurora Illinois 60101

NAME OF CORPORATE/COMPANY OFFICIAL Frank GERARDI

TITLE PRESIDENT PLEASE TYPE OR PRINT CLEARLY

AUTHORIZED OFFICIAL SIGNATURE [Signature]

DATE 6/8/21

TELEPHONE (630) 519-5143

FAX No. (630) 656-1180


E-MAIL ADDRESS GERARDI.Sewer-Water@cc
Global.NET

Subscribed and Sworn to

Before me this 8th day

of June, 21__

Mary Ann Alfano
Notary Public

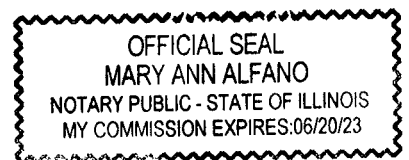

Apprenticeship or Training Program Certification

Return with Bid

All contractors are required to complete the following certification:

- ☐ For this contract proposal or for all groups in this deliver and install proposal.
- ☐ For the following deliver and install groups in this material proposal:

The City of Aurora policy, adopted in accordance with the provisions of the Illinois Highway Code, requires this contract to be awarded to the lowest responsive and responsible bidder. In addition to all other responsibility factors, this contract or deliver and install proposal requires all bidders and all bidders' subcontractors to disclose participation in apprenticeship or training programs that are approved by and registered with the United States Department of Labor's Bureau of Apprenticeship and Training, and applicable to the work of the above indicated proposals or groups. Therefore, all bidders are required to complete the following certification:

- I. Except as provided in paragraph IV below, the undersigned bidder certifies that it is a participant, either as an individual or as part of a group program, in an approved apprenticeship or training program applicable to each type of work or craft that the bidder will perform with its own employees.
- II. The undersigned bidder further certifies for work to be performed by subcontract that each of its subcontractors submitted for approval is, at the time of such bid, participating in an approved, applicable apprenticeship or training program applicable to the work of the subcontract.
- III. The undersigned bidder, by inclusion in the list in the space below, certifies the official name of each program sponsor holding the Certificate of Registration for all of the types of work or crafts in which the bidder is a participant and that will be performed with the bidder's employees. Types of work or craft that will be subcontracted shall be included and listed as subcontract work. The list shall also indicate any type of work or craft job category for which there is no applicable apprenticeship or training program available.

Operating Laborers


- VI. Except for any work identified above, any bidder or subcontractor that shall perform all or part of the work of the contract or deliver and install proposal solely by individual owners, partners or members and not by employees to whom the payment of prevailing rates of wages would be required, check the following box, and identify the owner/operator workforce and positions of ownership. ☐

The requirements of this certification and disclosure are a material part of the contract, and the contractor shall require this certification provision to be included in all approved subcontracts. The bidder is responsible for making a complete report and shall make certain that each type of work or craft job category that will be utilized on the project is accounted for and listed. **The City of Aurora requires a copy of each applicable Certificate of Registration issued by the United States Department of Labor evidencing such participation by the contractor and any or all of its subcontractors be included with the bid in order to qualify to bid on the project.**

Bidder: GERARDI SERVICE WASTE

Address: 1785 ARMITAGE COURT

By:

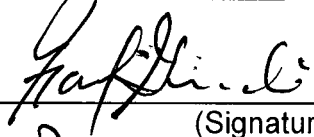
(Signature)

Title:

PRESIDENT

INTERNATIONAL UNION OF OPERATING ENGINEERS

LOCAL UNION NO. 150, 150B, 150A, 150C, 150RA, 150D, 150G, 150M

AFFILIATED WITH THE A.F.L.-C.I.O. AND BUILDING TRADES DEPARTMENT

JAMES M. SWEENEY
PRESIDENT-BUSINESS MANAGER



(708) 482-8800 · FAX (708) 482-7186
6200 JOLIET ROAD
COUNTRYSIDE, IL 60525-3992

June 16, 2021

Gerardi Sewer & Water Co.
4520 N Osage
Norridge, IL 60656

Re: Proof of Compliance with 30 ILCS 500/30-22(6)
Our File No. MI-00321

Dear Sir or Madam:

At the request of Gerardi Sewer & Water Co., I am providing you with evidence of the Company's compliance with the apprenticeship requirements in 30 ILCS 500/30-22(6) of the Illinois Procurement Code. I am submitting this letter along with apprenticeship certificates (Nos. IL012020003 and IL008780173).

As a signatory contractor with the International Union of Operating Engineers, Local 150, AFL-CIO, Gerardi Sewer & Water Co., is required by Collective Bargaining Agreement to participate in an applicable apprenticeship and training program approved by and registered with the United States Department of Labor's Bureau of Apprenticeship and Training. The attached certificates are evidence of compliance with the U.S. Department of Labor's apprenticeship requirements.

Thank you for your cooperation in this matter. If you have any questions or concerns, please do not hesitate to contact me.

Very truly yours,

IUOE, Local 150, AFL-CIO
District 1 dispatch office


Maribel Hernandez

Enclosures: Certificates

The United States Department of Labor

Office of Apprenticeship

Certificate of Registration of Apprenticeship Program

*Operating Engineers Local 150 Apprenticeship Fund
Wilmington, Illinois*

For the Trade — Operating Engineer (Heavy Equipment Technician)

*Registered as part of the National Apprenticeship System
in accordance with the basic standards of apprenticeship
established by the Secretary of Labor*



Hilda F. Solis
Secretary of Labor

Al V. Hall
Administrator, Office of Apprenticeship

May 5, 2002

Date Revised June 21, 2011

Registration No. IL012020003

Executive Director

Thomas Nordeen

16 June 2021

Labor Trustees

James P. Connolly
Martin Flanagan
Joseph V. Healy
Charles V. LoVerde III
William Martin

Mr. Gerardi
Gerardi Sewer & Water, Co.
4520 N. Osage
Norridge, Illinois 60706

Management Trustees

Seth Gudeman
Shane Higgins
Joseph Koppers
Robert G. Krug
David Lorig
William Vignocchi

Dear Mr. Gerardi:

Enclosed you will please find a copy of the Department of Labor certification that you requested recently.

Carol Stream Location

1200 Old Gary Avenue
Carol Stream IL 60188
(630) 653-0006

You may also use this letter as verification Gerardi Sewer & Water, Co. is indeed signatory to the Chicago Laborers District Council and contributes to the Laborers Apprenticeship Fund.

Should you require anything further, please do not hesitate to contact me.

Chicago Location

5700 West Homer Street
Chicago IL 60639

Yours very truly,



Felicita Ruiz
Assistant Office Manager

United States Department of Labor

Office of Apprenticeship Training, Employer and Labor Services
Bureau of Apprenticeship and Training

Certificate of Registration

Chicago and Laborers' J.A.T.C.

Carol Stream, Illinois

For the Trade - Construction Craft Laborer

Registered as part of the National Apprenticeship Program

in accordance with the basic standards of apprenticeship


established by the Secretary of Labor

April 12, 1999

Date REVISED August 13, 2004

11017990001

Registration No.



L. L. Chao

Secretary of Labor

Anthony Swager

Administrator, Apprenticeship Training, Employer and Labor Services

STATE OF ILLINOIS)

County of Kane)

SS.

BIDDER'S TAX CERTIFICATION

(BIDDER'S EXECUTING OFFICER), being first duly sworn on oath, deposes and states that all statements made herein are made on behalf of the Bidder, that this despondent is authorized to make them and that the statements contained herein are true and correct.

Bidder deposes, states and certifies that Bidder is not barred from contracting with any unit of local government in the State of Illinois as result of a delinquency in payment of any tax administered by the Illinois Department of Revenue unless Bidder is contesting, in accordance with the procedures established by the appropriate statute, its liability for the tax or the amount of the tax, all as provided for in accordance with 65 ILCS 5/11-42.1-1.

DATED this 8th day of JUNE, 21

By 
(Signature of Bidder's Executing Officer)

FRANK GERARD;
(Print name of Bidder's Executing Officer)

President
(Title)


ATTEST/WITNESS:

By [Signature]
Title Vice-President

Subscribed and sworn to before me this
8th day of June, 21 .

Mary Ann Adams
Notary Public

(SEAL)

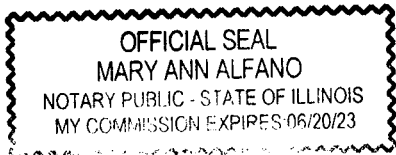

Bid Number 21-34



City of Aurora, IL - Local Vendor Preference Application

The business identified below is requesting to be placed on the City of Aurora, Illinois Local Vendor Preference list, in accordance with ordinance O18-070, amended with ordinance O20-029 approved April 28, 2020.

- 1) Date Submitted: _____
- 2) Name of Business: _____
- 3) Address of Local Office: _____
- 4) City, State, Zip: _____
- 5) Company's Web Address: _____
- 6) Phone: _____ Fax: _____
- 7) County your Local Business is Located In: _____

Submitted By (Signature): _____

Print Name and Title: _____

Email Address: _____

Sec. 2-410.-Prequalification; local bidder.

- (a) If an interested business would like to prequalify as a "local business", such a business shall complete and submit the prequalification application along with supporting documentation, as listed below, and the applicable fee as set by the City Council, to the Finance Department:
 - a. Evidence that the business has established and maintained a physical presence in the City of Aurora, by virtue of the ownership or lease of all or a portion of a building for a period of not less than twelve (12) consecutive months prior to the submission of the prequalification application; and
 - b. Evidence demonstrating that the business is legally authorized to conduct business within the State of Illinois and the City of Aurora, and has a business registered to operate in the City if required; and
 - c. Evidence that the business is not a debtor to the City of Aurora. For purposes of this subparagraph, a debtor is defined as having outstanding fees, water bills, sales tax or restaurant/bar tax payments that are thirty (30) days or more past due, or has outstanding weed or nuisance abatements or liens, has failure to comply tickets or parking tickets that are not in dispute as to their validity and are not being challenged in court or other administrative processes.

Back up documentation for (a) a. and (a) b. must accompany this submittal or application will be rejected.

Please note for (a) c. above the City of Aurora will verify internally that your company does not have any outstanding fees. Your company should make sure that to the best of its knowledge all bills are current.

Return completed application, with all required backup documentation to:

City of Aurora, Attn: Purchasing Division, 44 E. Downer Place, Aurora, IL 60507

Or email to: PurchasingDL@Aurora-IL.org

Do not write below this line: For City of Aurora use ONLY

- (a) a.
- (a) b.
- (a) c.

Date: _____

Approved: _____

Letter Sent: _____

Denied: _____

Initials: _____



RETURN WITH BID

Route	Various
County	Kane
Local Agency	City of Aurora
Section	

WE Gerardi Sewer & Water Co., 1785 W. Armitage Court, Addison, IL 60101 as PRINCIPAL.

are held jointly, severally and firmly bound unto the above Local Agency (hereafter referred to as "LA") in the penal sum of 5% of the total bid price, or for the amount specified in the proposal documents in effect on the date of invitation for bids whichever is the lesser sum. We bind ourselves, our heirs, executors, administrators, successors, and assigns, jointly pay to the LA this sum under the conditions of this instrument.

THEREFORE if the proposal is accepted and a contract awarded to the PRINCIPAL by the LA for the above designated section and the PRINCIPAL shall within fifteen (15) days after award enter into a formal contract, furnish surety guaranteeing the faithful performance of the work, and furnish evidence of the required insurance coverage, all as provided in the "Standard Specifications for Road and Bridge Construction" and applicable Supplemental Specifications, then this obligation shall become void; otherwise it shall remain in full force and effect.

IN TESTIMONY WHEREOF, the said PRINCIPAL and the said SURETY have caused this instrument to be signed by their respective officers this 9th day of June, 2021

(Company Name)

Frank Gerardi, President (Signature and Title)

(Company Name)

(Signature and Title)

Surety

By:

(Name of Surety)

(Signature of Attorney-in-Fact)
Kimberly R. Holmes, Attorney-in-Fact

do hereby certify that Frank Gerardi and Kimberly R. Holmes

(Insert names of individuals signing on behalf of PRINCIPAL & SURETY)

Given under my hand and notarial seal this 9th day of June, 2021

My commission expires 05/15/2024

(Notary Public)

☐ Electronic bid bond is allowed (box must be checked by LA if electronic bid bond is allowed)

The Principal may submit an electronic bid bond, in lieu of completing the above section of the Proposal Bid Bond Form. By providing an electronic bid bond ID code and signing below, the Principal is ensuring the identified electronic bid bond has been executed and the Principal and Surety are firmly bound unto the LA under the conditions of the bid bond as shown above. (If PRINCIPAL is a joint venture of two or more contractors, an electronic bid bond ID code, company/Bidder name title and date must be affixed for each contractor in the venture.)

[illegible]


Electronic Bid Bond ID Code

(Company/Bidder Name)

(Signature and Title)

Date _____

Bid Number 21-34

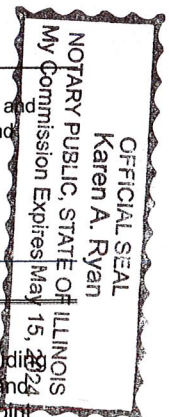

SWISS RE CORPORATE SOLUTIONS

NORTH AMERICAN SPECIALTY INSURANCE COMPANY
WASHINGTON INTERNATIONAL INSURANCE COMPANY

GENERAL POWER OF ATTORNEY

KNOW ALL MEN BY THESE PRESENTS, THAT North American Specialty Insurance Company, a corporation duly organized and existing under laws of the State of New Hampshire, and having its principal office in the City of Kansas City, Missouri, and Washington International Insurance Company, a corporation organized and existing under the laws of the State of New Hampshire and having its principal office in the City of Kansas City, Missouri, each does hereby make, constitute and appoint:

WILLIAM CAHILL, KIMBERLY SAWICKI, ANN MARIE WATERS, KIMBERLY R. HOLMES,

KAREN A. RYAN, RICHARD A. FREEBOURN and RACHEL E. HERNANDEZ

JOINTLY OR SEVERALLY

Its true and lawful Attorney(s)-in-Fact, to make, execute, seal and deliver, for and on its behalf and as its act and deed, bonds or other writings obligatory in the nature of a bond on behalf of each of said Companies, as surety, on contracts of suretyship as are or may be required or permitted by law, regulation, contract or otherwise, provided that no bond or undertaking or contract or suretyship executed under this authority shall exceed the amount of:

FIFTY MILLION (\$50,000,000.00) DOLLARS

This Power of Attorney is granted and is signed by facsimile under and by the authority of the following Resolutions adopted by the Boards of Directors of both North American Specialty Insurance Company and Washington International Insurance Company at meetings duly called and held on the 9th of May, 2012:

"RESOLVED, that any two of the Presidents, any Managing Director, any Senior Vice President, any Vice President, any Assistant Vice President, the Secretary or any Assistant Secretary be, and each or any of them hereby is authorized to execute a Power of Attorney qualifying the attorney named in the given Power of Attorney to execute on behalf of the Company bonds, undertakings and all contracts of surety, and that each or any of them hereby is authorized to attest to the execution of any such Power of Attorney and to attach therein the seal of the Company; and it is

FURTHER RESOLVED, that the signature of such officers and the seal of the Company may be affixed to any such Power of Attorney or to any certificate relating thereto by facsimile, and any such Power of Attorney or certificate bearing such facsimile signatures or facsimile seal shall be binding upon the Company when so affixed and in the future with regard to any bond, undertaking or contract of surety to which it is attached."



By

Steven P. Anderson, Senior Vice President of Washington International Insurance Company
& Senior Vice President of North American Specialty Insurance Company



By

Michael A. Ito, Senior Vice President of Washington International Insurance Company
& Senior Vice President of North American Specialty Insurance Company

IN WITNESS WHEREOF, North American Specialty Insurance Company and Washington International Insurance Company have caused their official seals to be hereunto affixed, and these presents to be signed by their authorized officers this 4TH day of MAY, 2020.

**North American Specialty Insurance Company
Washington International Insurance Company**

State of Illinois
County of Cook

ss:

On this 4TH day of MAY, 2020, before me, a Notary Public personally appeared Steven P. Anderson, Senior Vice President of Washington International Insurance Company and Senior Vice President of North American Specialty Insurance Company and Michael A. Ito, Senior Vice President of Washington International Insurance Company and Senior Vice President of North American Specialty Insurance Company, personally known to me, who being by me duly sworn, acknowledged that they signed the above Power of Attorney as officers of and acknowledged said instrument to be the voluntary act and deed of their respective companies.



M. Kenny, Notary Public

I, Jeffrey Goldberg, the duly elected Assistant Secretary of North American Specialty Insurance Company and Washington International Insurance Company, do hereby certify that the above and foregoing is a true and correct copy of a Power of Attorney given by said North American Specialty Insurance Company and Washington International Insurance Company, which is still in full force and effect.

IN WITNESS WHEREOF, I have set my hand and affixed the seals of the Companies this 9th day of June, 20 21.

Jeffrey Goldberg, Vice President & Assistant Secretary of
Washington International Insurance Company & North American Specialty Insurance Company

**San Souci Water Main Improvements
ADDENDUM NO. 1**

Sincerely,



John D. Hoffmann, P.E.
Engineering Coordinator
City of Aurora Engineering Division

PLEASE ACKNOWLEDGE RECEIPT OF THIS ADDENDUM BY FILLING OUT THE FOLLOWING AND SENDING AN ORIGINAL OR FAX COPY OF THIS SHEET TO THE CITY OF AURORA ENGINEERING DIVISION AT 630/256-3229 OR PREFERRABLY BY E-MAIL AT jhoffmann@aurora.il.us IMMEDIATELY UPON RECIEPT.

COMPANY NAME GERARDI SERVICE WATER CO.

SIGNATURE OF COMPANY REPRESENTATIVE 

Bid 21-34
San Souci Water Main Improvements
Bid opening: June 9, 2021 @ 2:00 P.M.

ADDENDUM NO. 2
Page 1 of 1

TO: All Bidders
FROM: Engineering Division, City of Aurora
DATE: June 7, 2021

THIS ADDENDUM FORMS A PART OF THE BIDDING AND CONTRACT DOCUMENTS.

1. The normal operating pressure of the water main is 61 psi.
2. The CIPP water main liner shall have a minimum modulus of elasticity of 300,000 psi and a minimum tensile strength of 3,000 psi.
3. The CIPP water main liner shall meet the minimum design thickness per ASTM F1216 designs to support all internal pressures and external loading for fully structural design per the project requirements.
4. The liner thicknesses shall be designed based on a partially deteriorated pipe with a safety factor of 2, an ovality of 5%, and a maximum external water head level 2' below grade.

Sincerely,



John D. Hoffmann, P.E.
Engineering Coordinator
City of Aurora Engineering Division

PLEASE ACKNOWLEDGE RECEIPT OF THIS ADDENDUM BY FILLING OUT THE FOLLOWING AND SENDING AN ORIGINAL OR FAX COPY OF THIS SHEET TO THE CITY OF AURORA ENGINEERING DIVISION AT 630/256-3229 OR PREFERRABLY BY E-MAIL AT jhoffmann@aurora.il.us IMMEDIATELY UPON RECEIPT.

COMPANY NAME GERARDI Sewer & Water Co.

SIGNATURE OF COMPANY REPRESENTATIVE 