Fire Access Plan Data Table

Description	Value	Unit
a) Building Height	37'-10.5"	feet
b) Building Square Footage (typical)	146,790	square feet
c) Building fire suppression information including any proposed use of sprinkler systems, fire alarm systems, whether fire extinguishers are needed:		
ESFR		
d) General description of business to be conducted within each building including: will there be rack storage in the building, will there be storage of combustible materials over twelve feet in height, clearance of sprinkler heads and stored materials (18 inch minimum):		
Warehousing		

AURORA LADDER FIRE TRUCK

	feet
Width	: 8.00
Track	: 7.50
Lock to Lock Time	: 6.0
Steering Angle	: 31.9

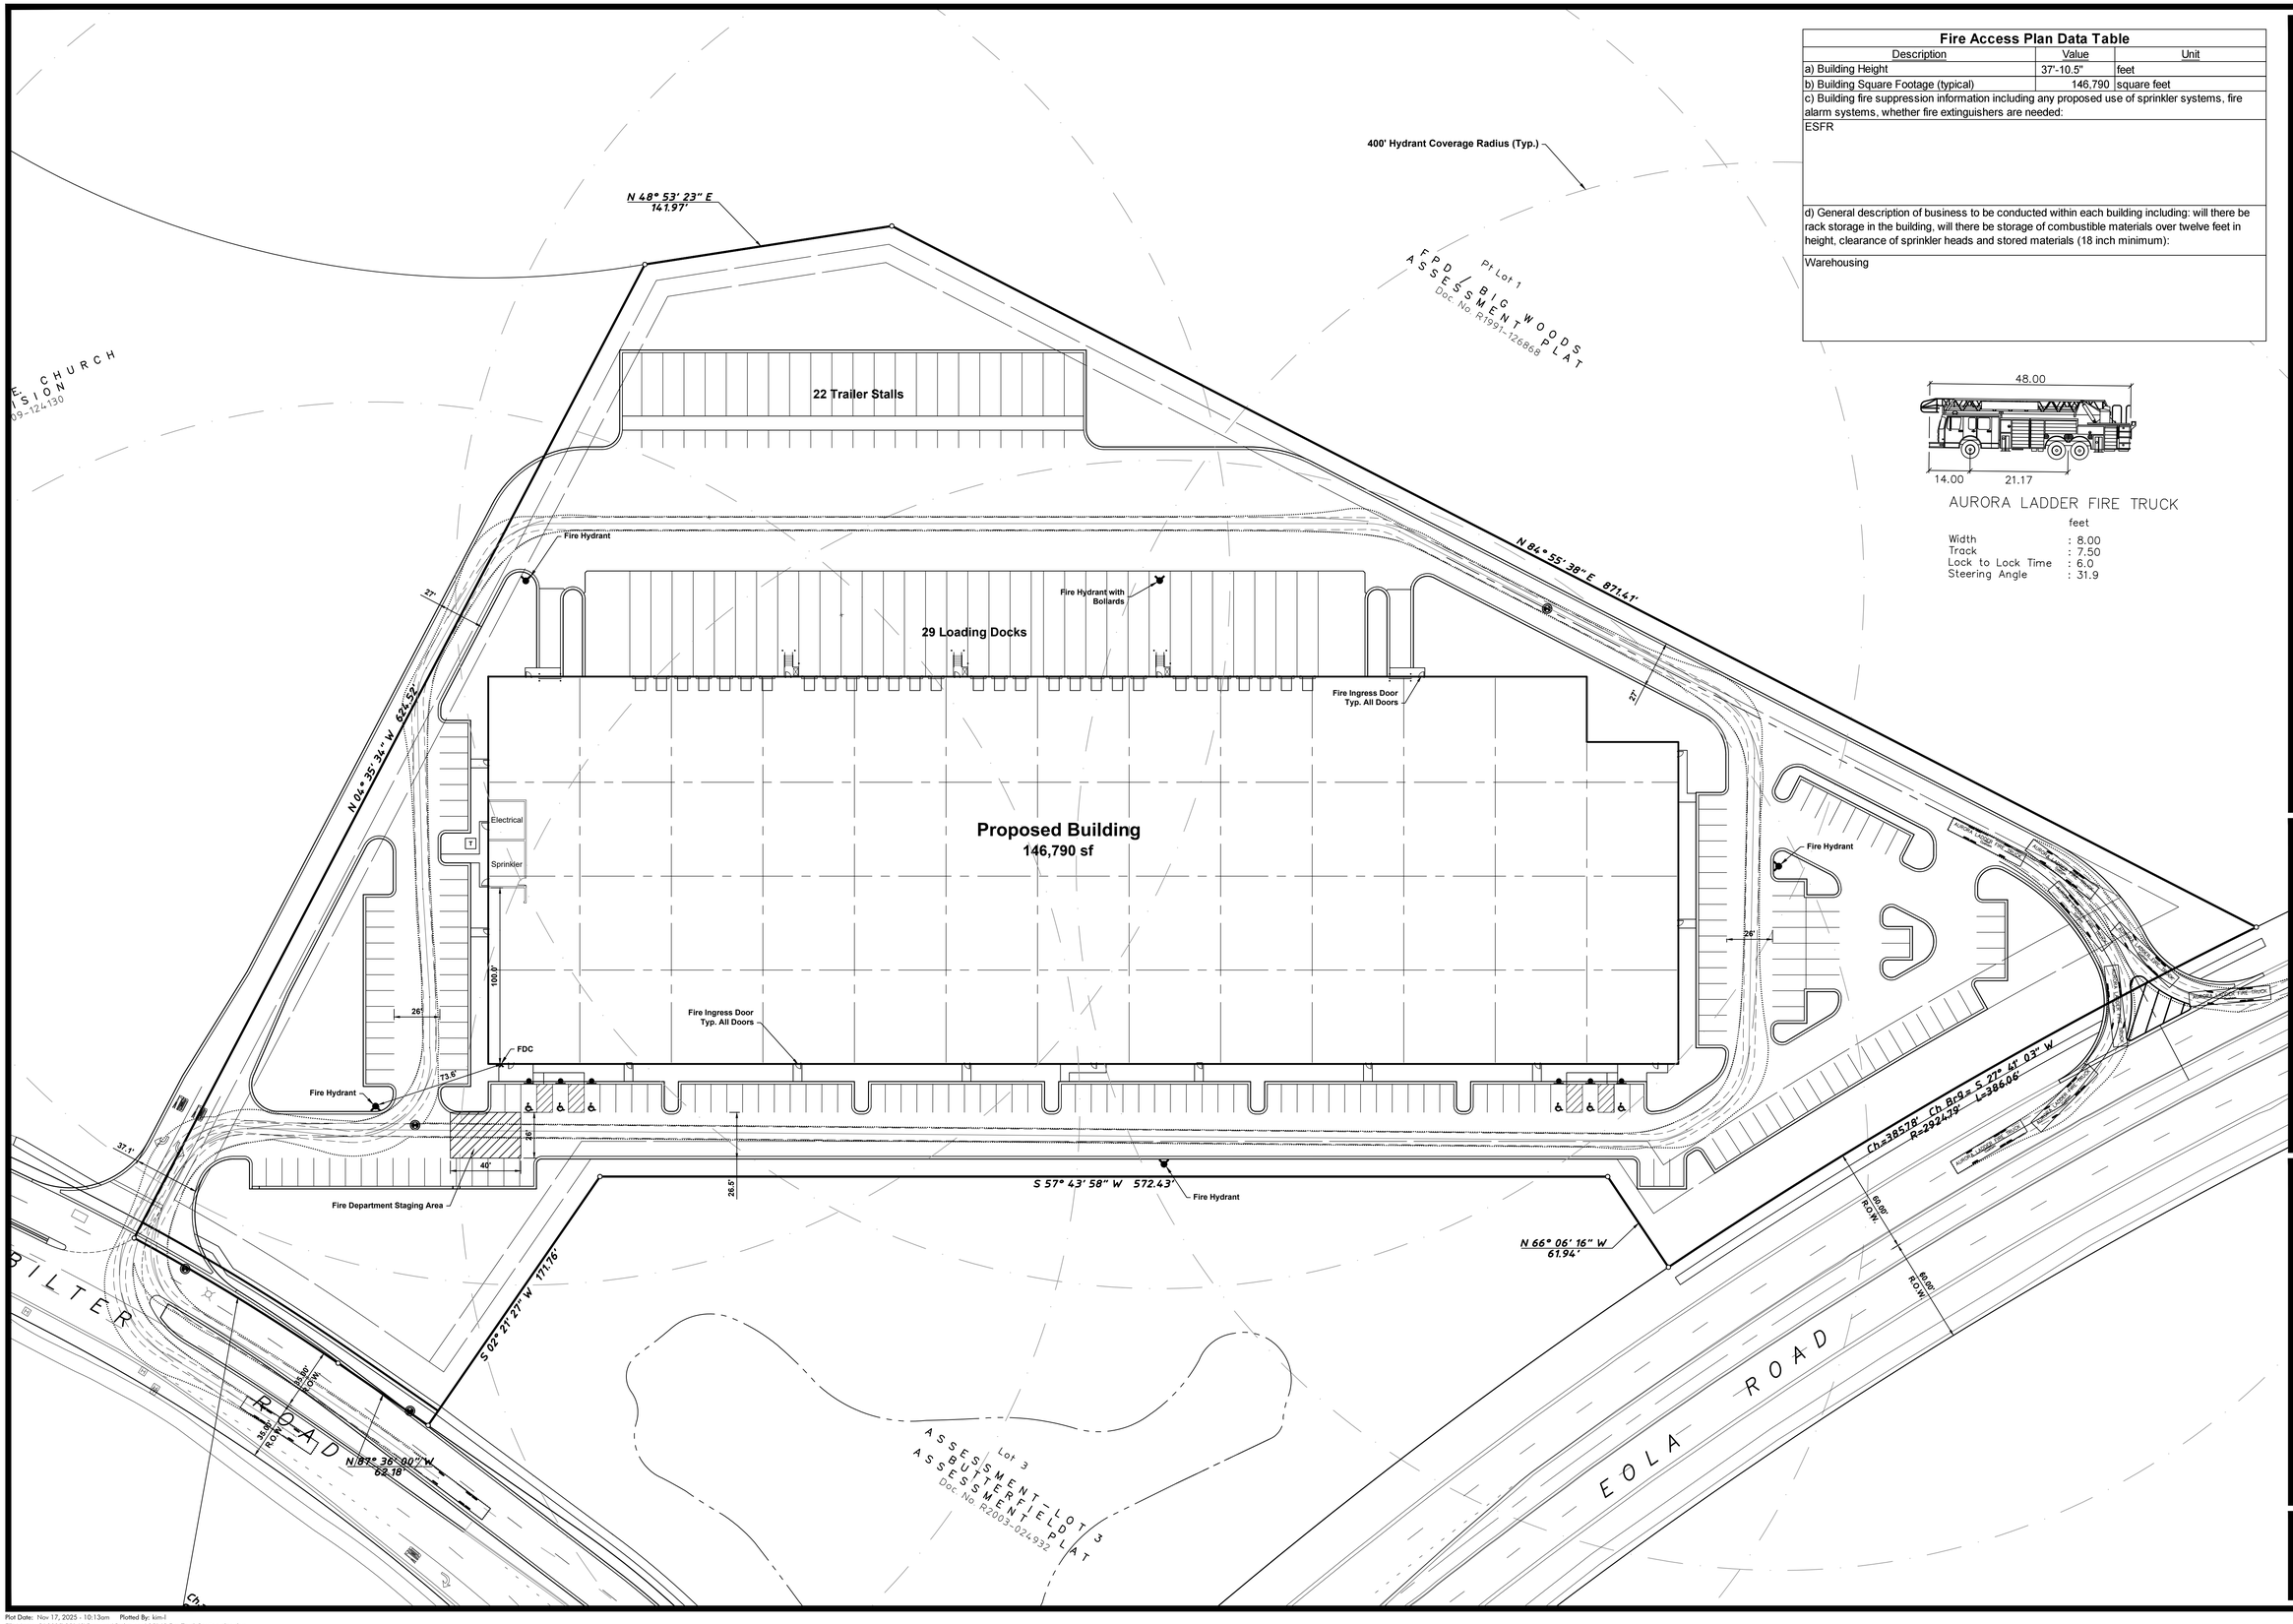

NORTH

20 0 40

Scale: 1" = 40'

No.	Date	
2	11-17-2025	City Review
1	10-10-2025	Client Review

HAEGER ENGINEERING
consulting engineers • land surveyors
100 East State Parkway, Schaumburg, IL 60173 • Tel. 847.394.6600 Fax. 847.394.6608
Illinois Professional Design Firm License No.: 184-003152
www.haegerengineering.com

FIRE ACCESS PLAN

HIGH STREET - 3080 BILTER ROAD
PRELIMINARY ENGINEERING PLANS
AURORA, ILLINOIS

Project Manager:	K M L
Engineer:	K M L
Date:	09-25-2025
Project No.	25169
Sheet	1/1

© 2025 Haeger Engineering, LLC

Plot Date: Nov 17, 2025 - 10:13am Plotted By: kim-l
File Name: P:\2025\25169\Drawings\Preliminary\25169 Fire Truck Routing plan.dwg