

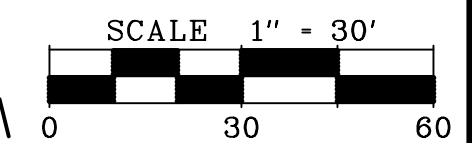
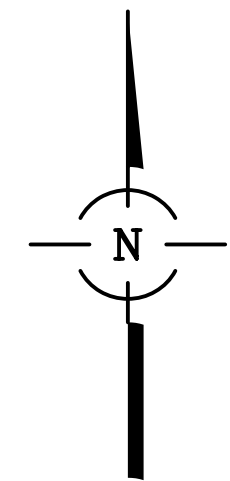


# FIRE ACCESS PLAN FOR MEIJER SUBDIVISION LOT 3

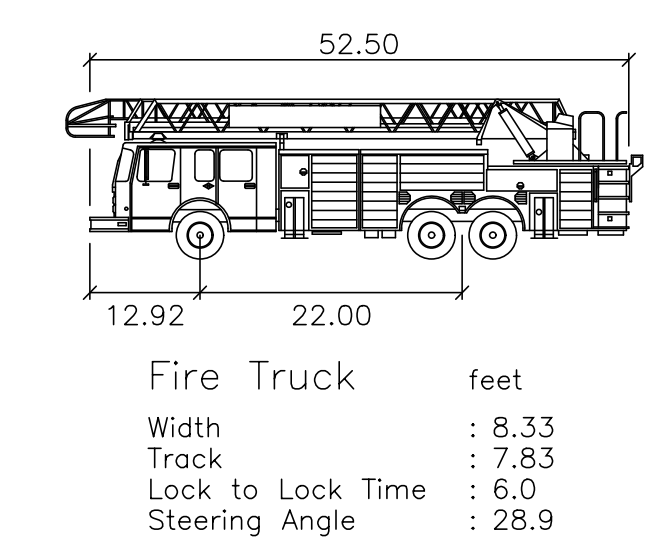

EXISTING  
FIRE HYDRANT

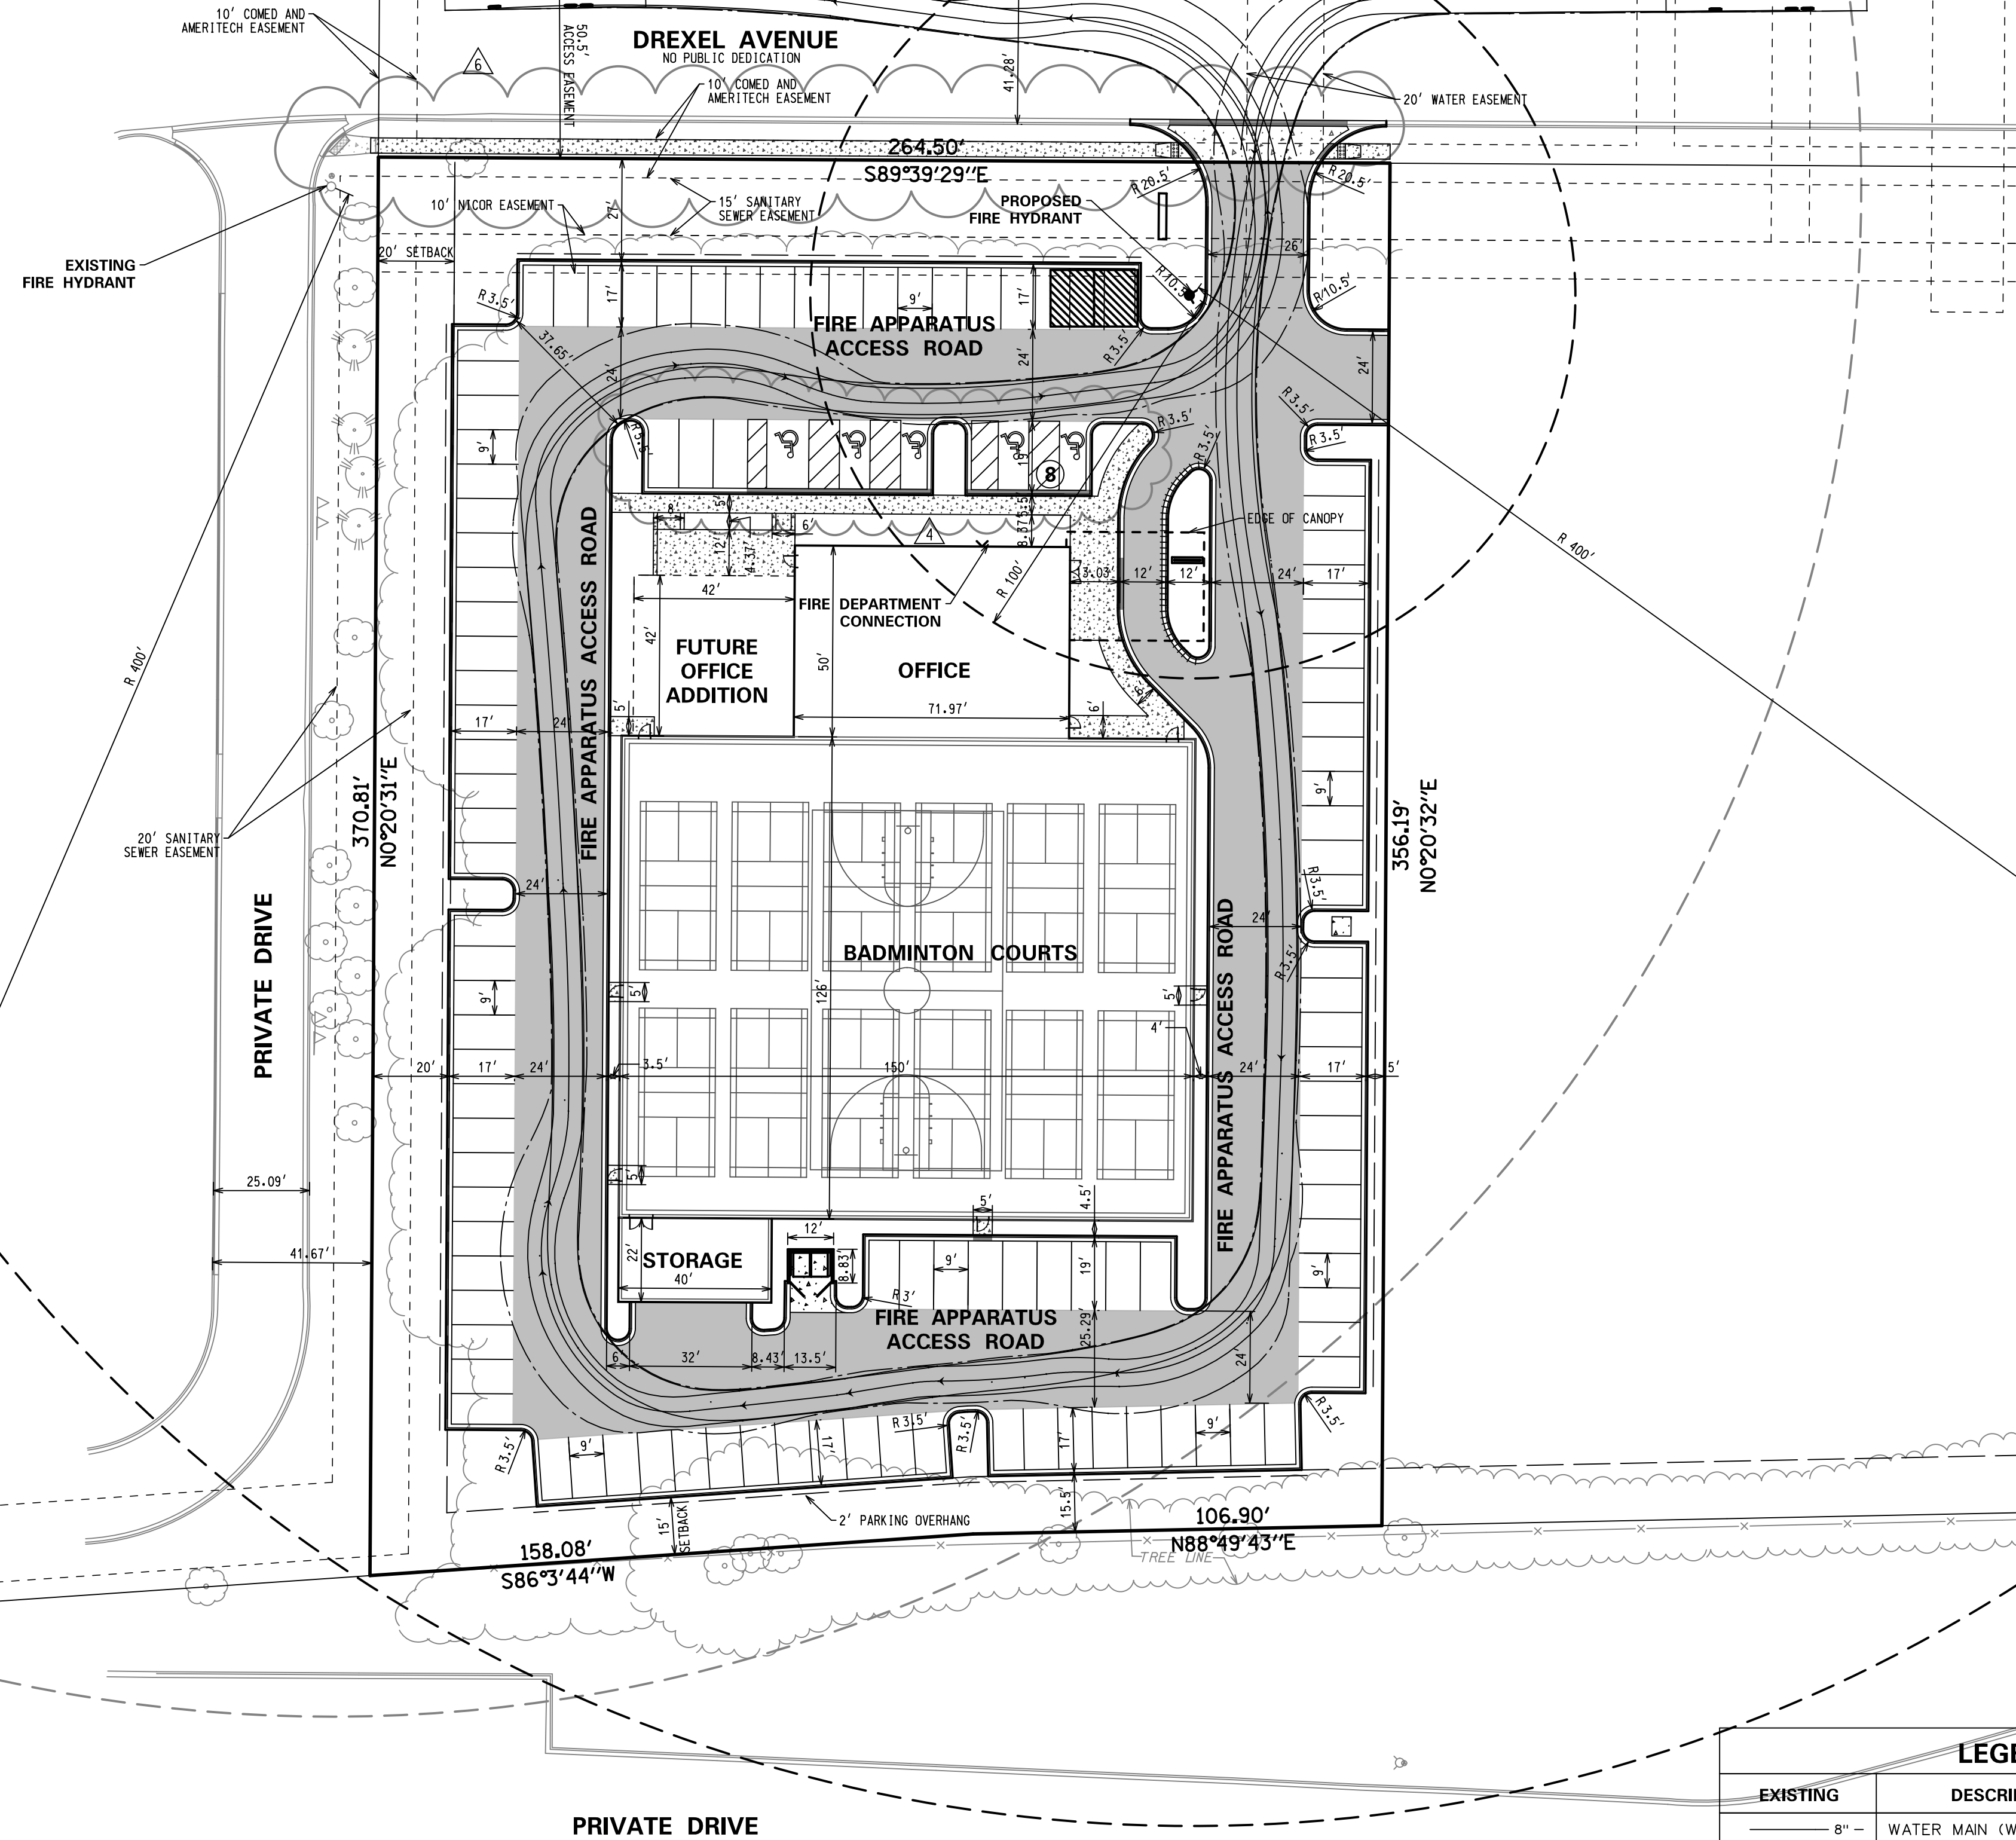

NOTE: ALL DIMENSIONS ARE TO THE FACE OF CURB UNLESS NOTED OTHERWISE

LEGEND		
EXISTING	DESCRIPTION	PROPOSED
— 8" —	WATER MAIN (WITH SIZE)	— 8" —
⊕	FIRE HYDRANT	⊕
—	PRESSURE CONNECTION	⊕
—	PIPE REDUCER	▶
⊕ ⊗	VALVE AND VAULT, VALVE	⊕
	INDICATES STAGING AREA 26'X40'	

FIRE ACCESS PLAN DATA TABLE		
DESCRIPTION	VALUE	UNIT
A) BUILDING HEIGHT	30.00	FEET
B) BUILDING S.F.	22,500	SQUARE FEET

C) BUILDING FIRE SUPPRESSION INFORMATION INCLUDING ANY PROPOSED USE OF SPRINKLER SYSTEMS, FIRE ALARM SYSTEMS, WHETHER FIRE EXTINGUISHERS ARE NEEDED:  
 - CODE COMPLIANT, BUILDING STANDARD SPRINKLER SYSTEM.  
 - FIRE EXTINGUISHER AND ALARM PER CODE.

D) GENERAL DESCRIPTION OF BUSINESS TO BE CONDUCTED WITHIN EACH BUILDING INCLUDING: WILL THERE BE RACK STORAGE IN THE BUILDING, WILL THERE BE STORAGE OF COMBUSTIBLE MATERIALS OVER TWELVE FEET IN HEIGHT, CLEARANCE OF SPRINKLER HEADS AND STORED MATERIALS (18" IN. MIN.):  
 - 22,500 SF OF BADMINTON TRAINING FACILITY AND OFFICE SPACE, WHICH INCLUDES 1,660 SF OF STORAGE, LOCKER ROOM, AND MECHANICAL ROOM AREA.

NO.	DATE	REVISIONS PER COA - ENGINEERING, KOSWCD	REMARKS
6	11/07/17		

NO.	DATE	REVISIONS PER COA - ENGINEERING, KOSWCD	REMARKS
5	10/26/17		FIRE DEPT. REVISIONS - REV. 4
3	10/03/17		PERMIT SUBMITTALS - FOUNDATION - REV. 1
2	09/25/17		REVISED PER CITY REVIEW
1	07/18/17		ISSUED FOR REVIEW

**FIRE ACCESS PLAN**  
**MEIJER SUBDIVISION LOT 3**  
 EGRET BADMINTON CENTER  
 708 N. ROUTE 59, AURORA, IL

**CONSULTING ENGINEERS**  
**SITE DEVELOPMENT ENGINEERS**  
**LAND SURVEYORS**

9575 W. Higgins Road, Suite 700,  
 Rosemont, Illinois 60018  
 Phone: (847) 676-4060 Fax: (847) 676-4065



FILENAME:  
 9848\_fire access plan

DATE:  
 09/15/17

JOB NO.  
 9848

SHEET  
**FE**  
 1 OF 1