
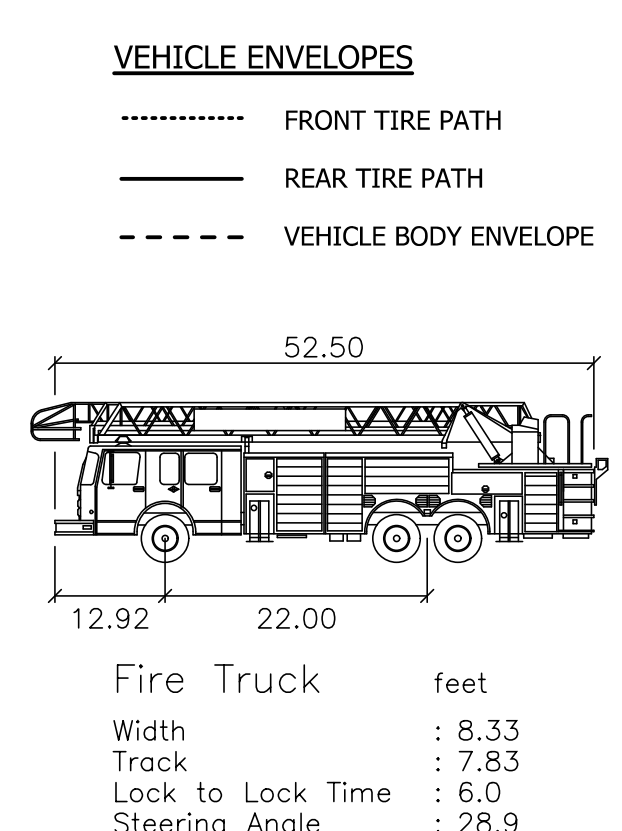
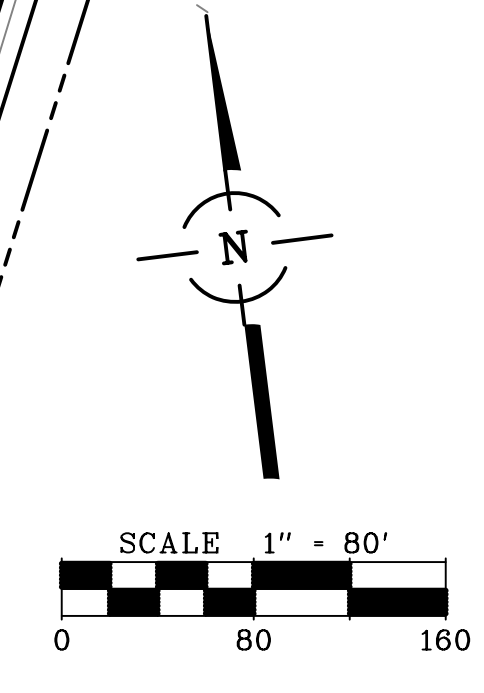


# FIRE ACCESS PLAN FOR ORCHARD INDUSTRIAL SUBDIVISION, LOT 1

PETITIONER:  
 JOHN FACILITARY, LLC  
 650 N. RIVER ROAD, SUITE 4050  
 ROSEMONT, IL 60018

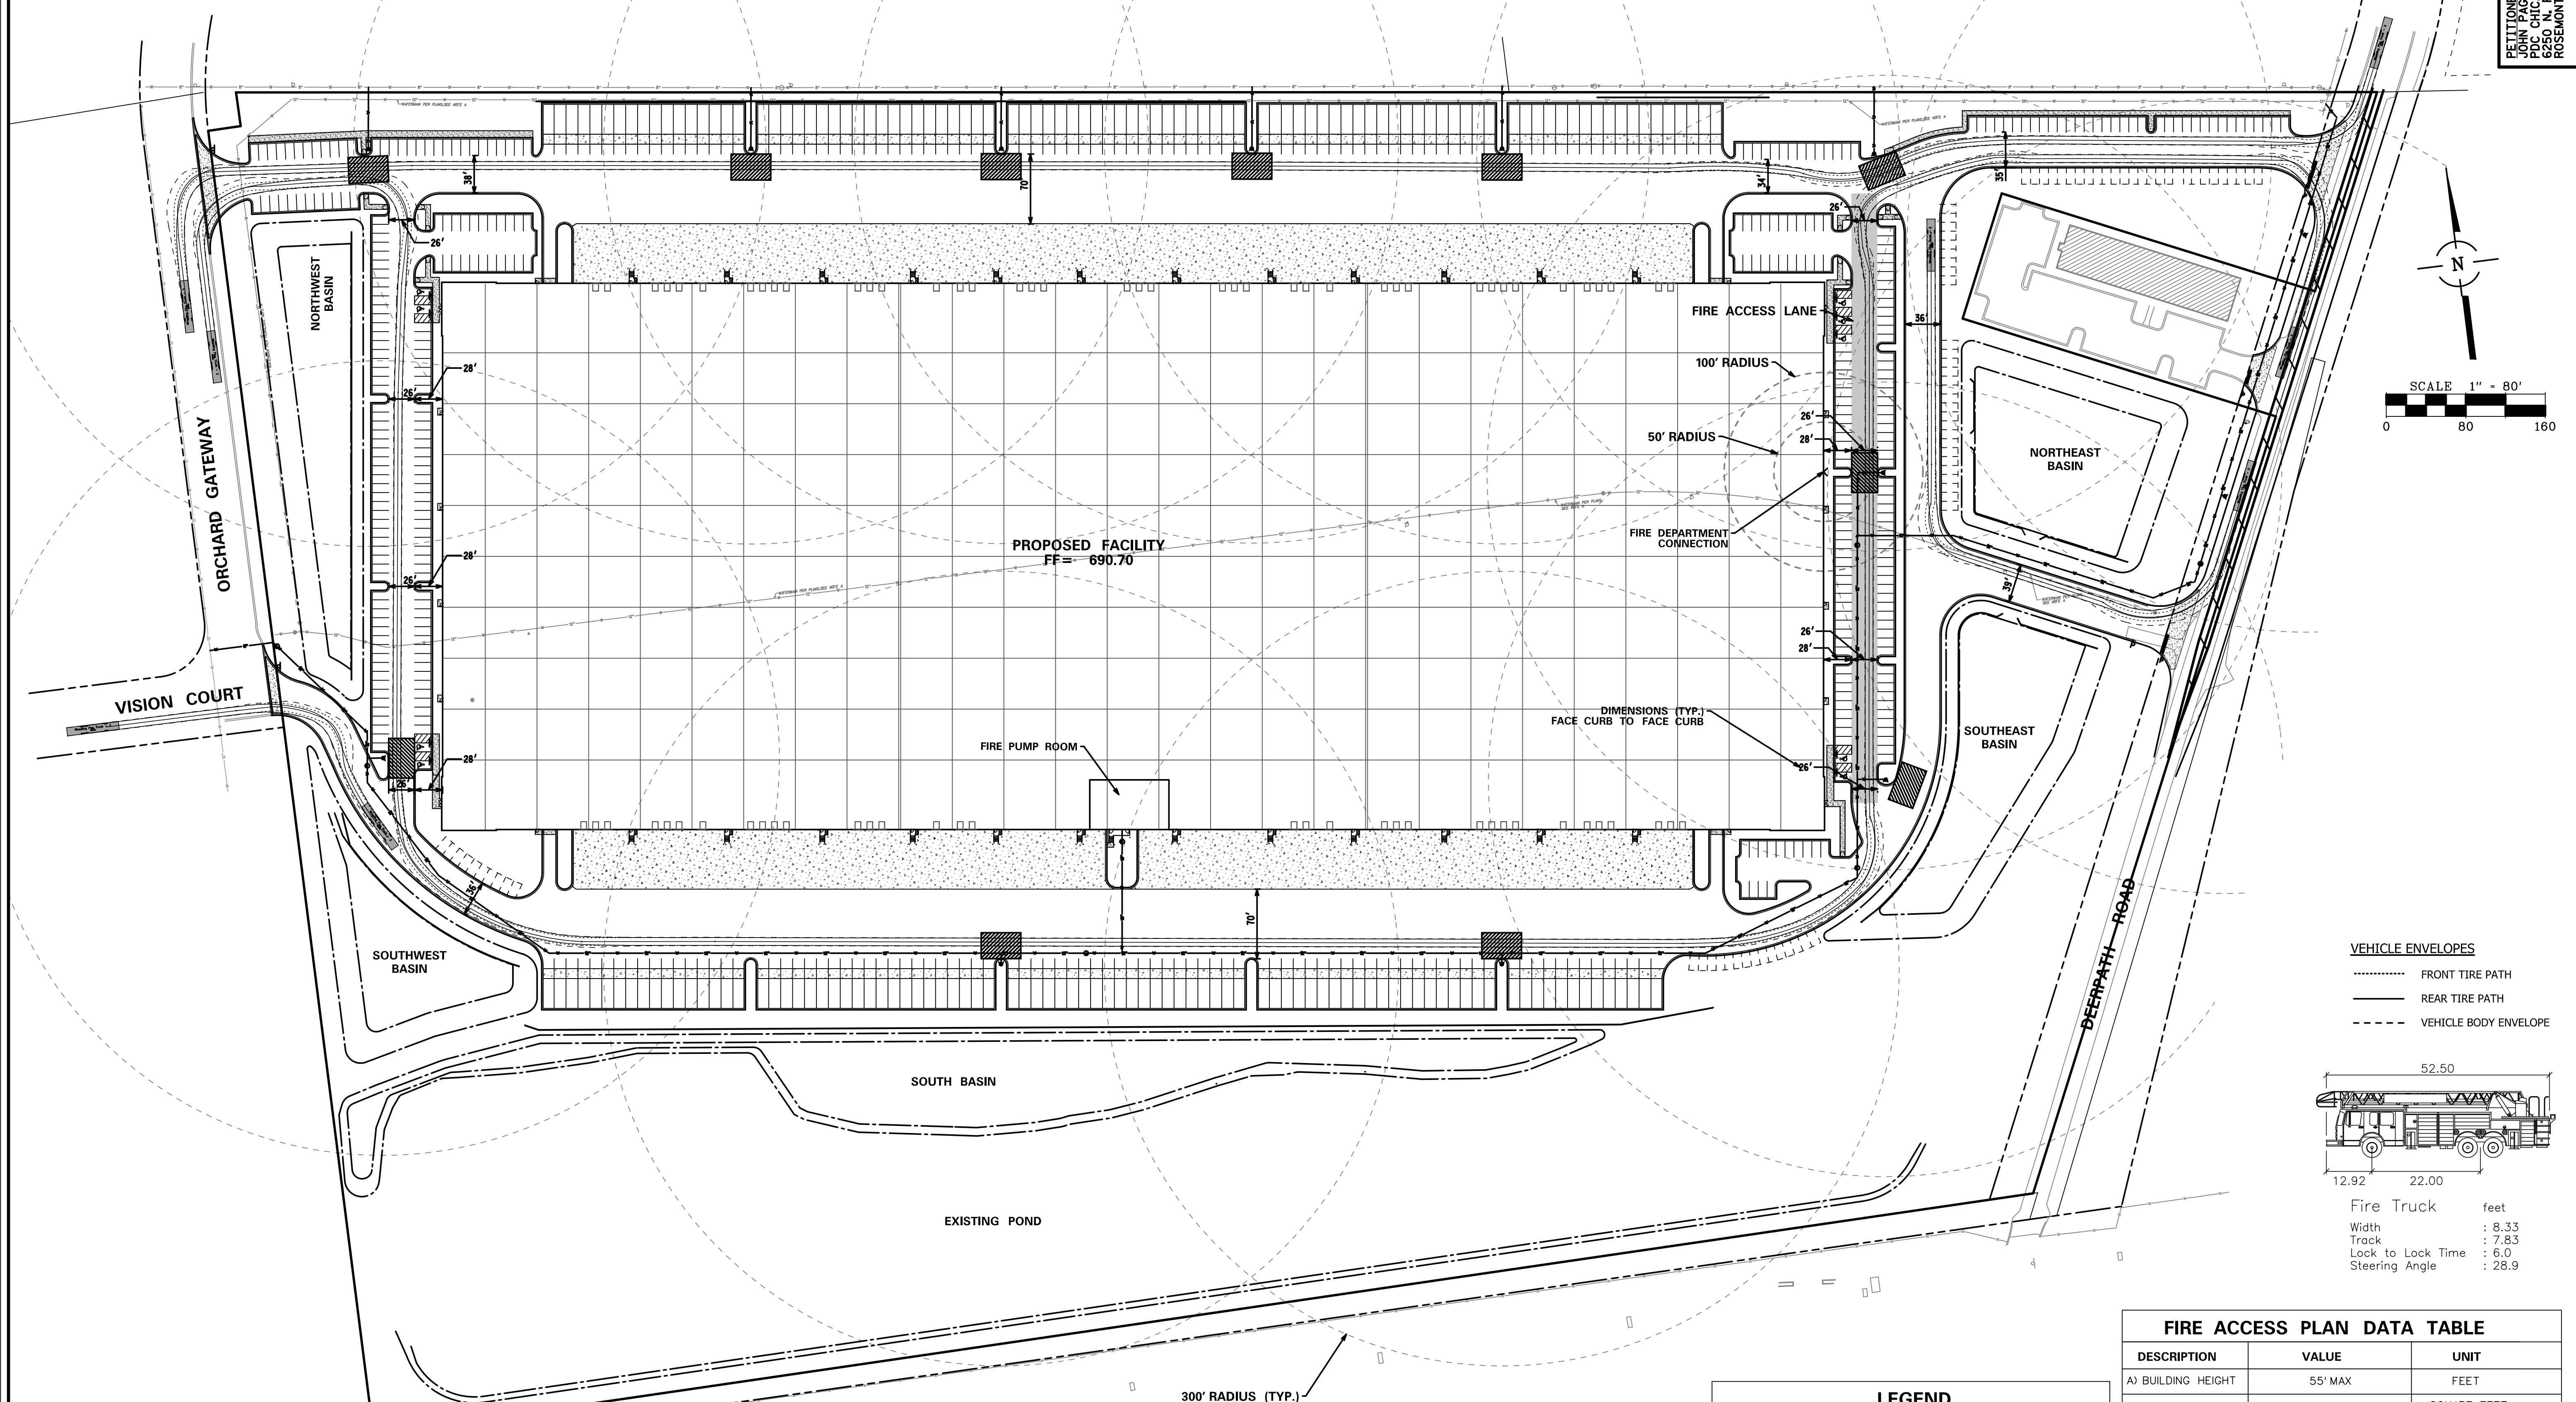

LEGEND		
EXISTING	DESCRIPTION	PROPOSED
— 8" —	WATER MAIN (WITH SIZE)	— 8" —
⊕	FIRE HYDRANT	⊕
—	PRESSURE CONNECTION	⊕
—	PIPE REDUCER	▶
⊕ ⊗	VALVE AND VAULT, VALVE	⊕
▨	INDICATES STAGING AREA 26'X40'	▨

FIRE ACCESS PLAN DATA TABLE		
DESCRIPTION	VALUE	UNIT
A) BUILDING HEIGHT	55' MAX	FEET
B) BUILDING S.F.	764,500	SQUARE FEET
C) BUILDING FIRE SUPPRESSION INFORMATION INCLUDING ANY PROPOSED USE OF SPRINKLER SYSTEMS, FIRE ALARM SYSTEMS, WHETHER FIRE EXTINGUISHERS ARE NEEDED: - CODE COMPLIANT, BUILDING STANDARD SPRINKLER SYSTEM. - FIRE EXTINGUISHER AND ALARM PER CODE.		
D) GENERAL DESCRIPTION OF BUSINESS TO BE CONDUCTED WITHIN EACH BUILDING INCLUDING: WILL THERE BE RACK STORAGE IN THE BUILDING, WILL THERE BE STORAGE OF COMBUSTIBLE MATERIALS OVER TWELVE FEET IN HEIGHT, CLEARANCE OF SPRINKLER HEADS AND STORED MATERIALS (18 IN. MIN.): - 764,500 SF OF INDUSTRIAL FACILITY		

<b>FIRE ACCESS PLAN</b>  <b>ORCHARD ROAD INDUSTRIAL</b> AURORA, ILLINOIS	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;">NO.</td> <td style="width: 20%;">DATE</td> <td style="width: 60%;">REMARKS</td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td>3</td> <td>07/26/18</td> <td>PER CITY</td> </tr> <tr> <td>2</td> <td>07/25/18</td> <td>PER CITY</td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	NO.	DATE	REMARKS				3	07/26/18	PER CITY	2	07/25/18	PER CITY			
NO.	DATE	REMARKS														
3	07/26/18	PER CITY														
2	07/25/18	PER CITY														
<b>CONSULTING ENGINEERS</b> <b>SITE DEVELOPMENT ENGINEERS</b> <b>LAND SURVEYORS</b>	9575 W. Higgins Road, Suite 700, Rosemont, Illinois 60018 Phone: (847) 676-4060 Fax: (847) 676-4065															
	FILENAME: 10087FIRE-ACCESS... DATE: 09/28/18 JOB NO. 10087 SHEET <b>FAP</b> 1 OF 1															