



**OWNER OF RECORD: WEST AURORA SCHOOL DISTRICT #129
80 S. RIVER STREET
AURORA, IL 60506**

FIRE ACCESS PLAN FOR FREEMAN SCHOOL

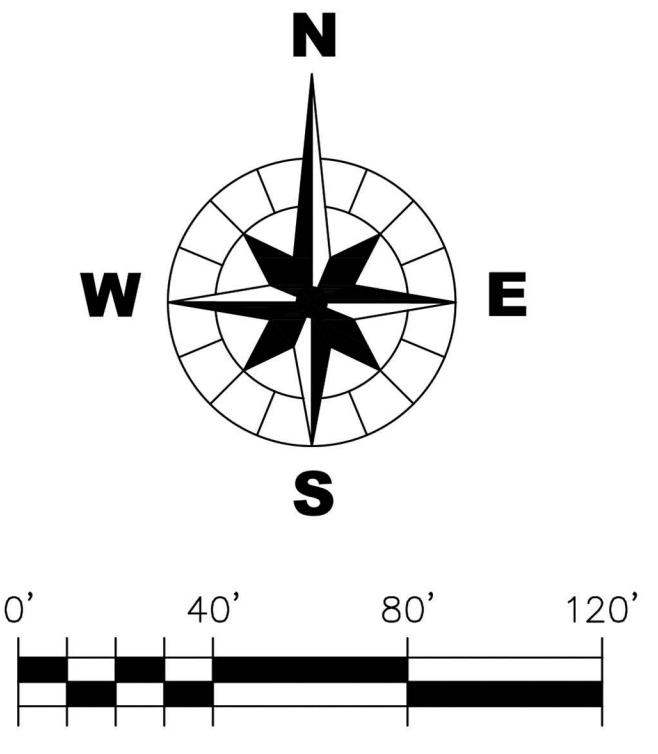

- LEGEND:**
- UE- UNDERGROUND ELECTRIC
 - w- WATER MAIN
 - - - STORM SEWER
 - - - SANITARY MAIN
 - FO- FIBER OPTIC LINE
 - x- FENCE
 - G- GAS LINE
 - FIRE HYDRANT
 - ⊗ WATER VALVE
 - ⊙ WATER VALVE VAULT
 - ⊙ STORM MANHOLE
 - ⊙ SANITARY MANHOLE
 - POWER POLE
 - GROUND LIGHT
 - SIGN
 - ▨ EXISTING BUILDING
 - ▨ PROPOSED BUILDING
 - PROPOSED ASPHALT

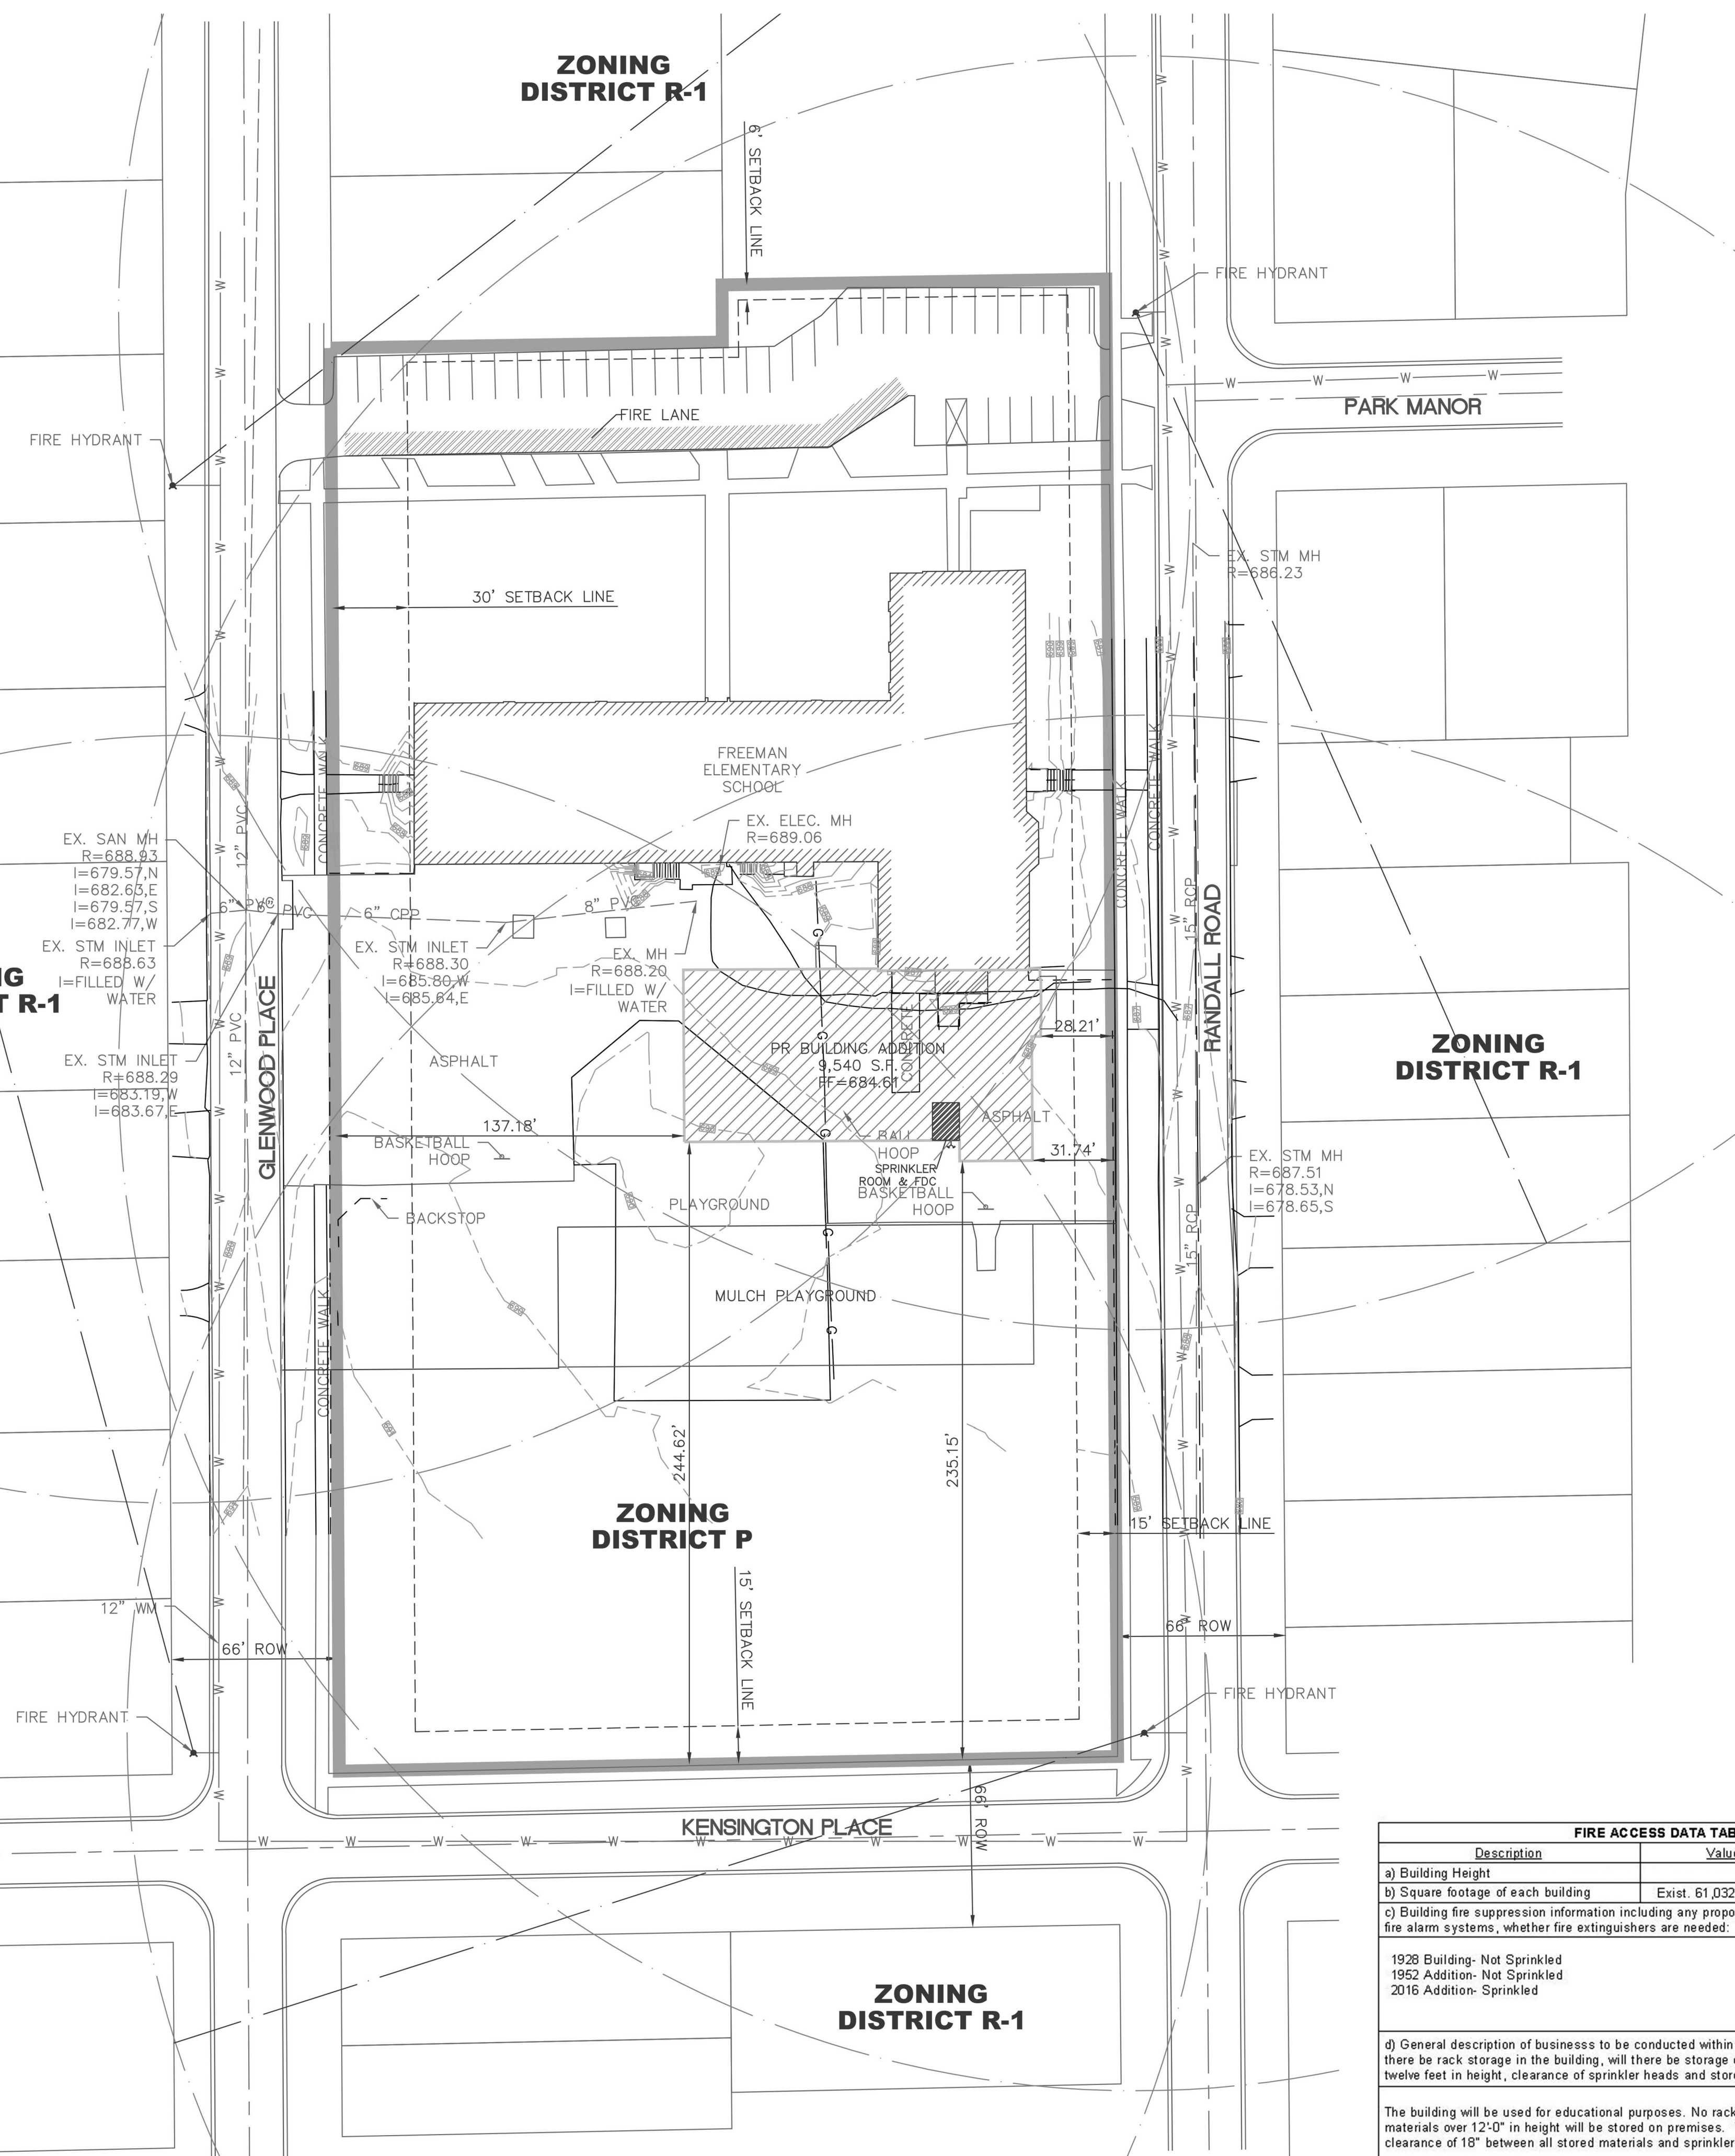

- WEST AURORA SCHOOL DISTRICT #129**
- LEGAL DESCRIPTION FOR NEW BUILDING
BEING A SUBDIVISION OF PART OF THE SOUTH HALF OF SECTION 20, TOWNSHIP 38 NORTH, RANGE 8 EAST OF THE THIRD PRINCIPAL MERIDIAN, IN THE CITY OF AURORA, KANE COUNTY, ILLINOIS.
 - PARCEL NUMBER(S): 15-20-329-002
 - SIZE OF PROJECT AREA: 174,135 S.F. (4.00 AC)
 - CURRENT ZONING: P
 - SQUARE FOOTAGE AND PERCENT SITE COVERAGE WITH BUILDINGS: EXISTING = 24,272 S.F., NEW = 9,540 S.F., TOTAL = 33,862 S.F. (0.78 AC), 19.50% SITE COVERAGE
 - PROPOSED BUILDING SQUARE FOOTAGE TOTAL AREA = 9,590 S.F.
 - SQUARE FOOTAGE AND PERCENT SITE COVERAGE WITH PAVEMENT = 53,715 S.F. (1.23 AC), 30.75% SITE COVERAGE
 - PARKING SPACES PROVIDED = 40
 - SQUARE FOOTAGE AND PERCENT SITE COVERAGE WITH LANDSCAPING = 86,684 S.F. (1.99 AC), 49.75% SITE COVERAGE
 - NUMBER OF BUILDINGS = 1 BUILDING, 2 STORIES
 - NUMBER OF DWELLING UNITS = 0
 - BREAKDOWN OF DWELLING UNIT BEDROOM TYPES = NONE

- NOTES:**
- SITE CONSIDERED TO BE WITHIN LIMITS OF PROJECT
 - SOME STORM SEWER, SANITARY SEWER, AND WATERMAIN WERE APPROXIMATED FROM THE CITY OF AURORA UTILITY ATLAS.

FIRE ACCESS DATA TABLE		
Description	Value	Unit
a) Building Height	37'-0 3/4"	feet
b) Square footage of each building	Exist. 61,032 /New 9,550	square feet
c) Building fire suppression information including any proposed use of sprinkler systems, fire alarm systems, whether fire extinguishers are needed:		
1929 Building- Not Sprinkled		
1952 Addition- Not Sprinkled		
2016 Addition- Sprinkled		
d) General description of business to be conducted within each building including: will there be rack storage in the building, will there be storage of combustible materials over twelve feet in height, clearance of sprinkler heads and stored materials (18 in minimum):		
The building will be used for educational purposes. No rack storage or combustible materials over 12'0" in height will be stored on premises. There is a minimum clearance of 18" between all stored materials and sprinkler heads.		

CLIENT: WEST AURORA SCHOOL DISTRICT #129
80 S. RIVER STREET
AURORA, IL 60506

WILLS BURKE KELSEY ASSOCIATES LTD.
8 East Galena Blvd., Suite 402
Aurora, Illinois 60506
(630) 701-2245

PROJECT NO. 15-0177
DATE: 08-11-2015
DRAWING NO. FP1
SHEET:

TITLE: FREEMAN ELEMENTARY SCHOOL
FIRE ACCESS PLAN

NO. DATE
NATURE OF REVISION
SCALE: 1"=40'
JCL
JSE
JSE
JCL
2-6 FIRE ACCESS PLAN FREEMAN.DWG