

# Fire Access Plan for Unilock Site Improvements




APR --6 2016

**UNILOCK**

**Wight**

Wight & Company  
wightco.com  
2500 North Frontage Road  
Darien, IL 60561  
P 630.969.7000  
F 630.969.7979

S:\Darien\Unilock\01-5455-02 Unilock Site Improvements\DWG\CD\FINAL PLAN.dwg sbenson Apr 01, 2016 10:57:32 am  
Wight © Copyright 2016 All rights reserved. No part of these documents may be reproduced, stored, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written consent of Wight.

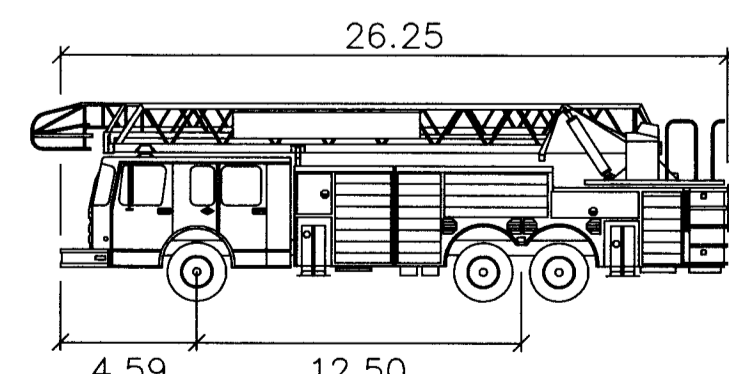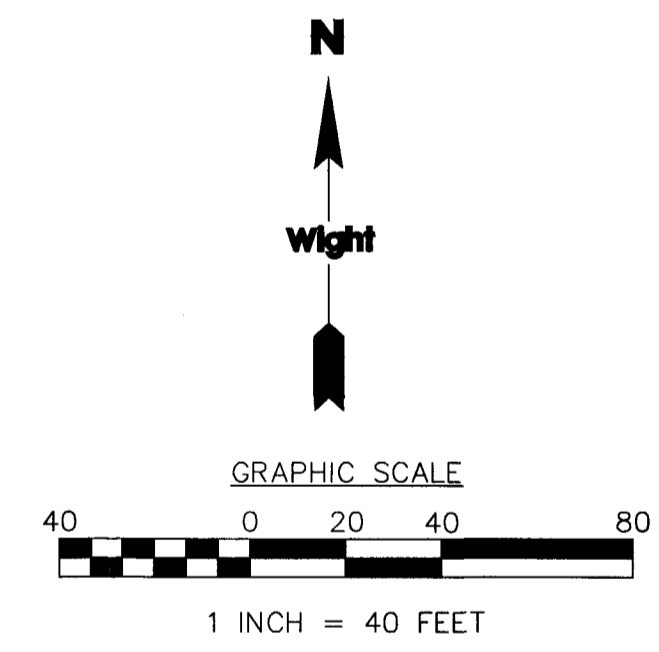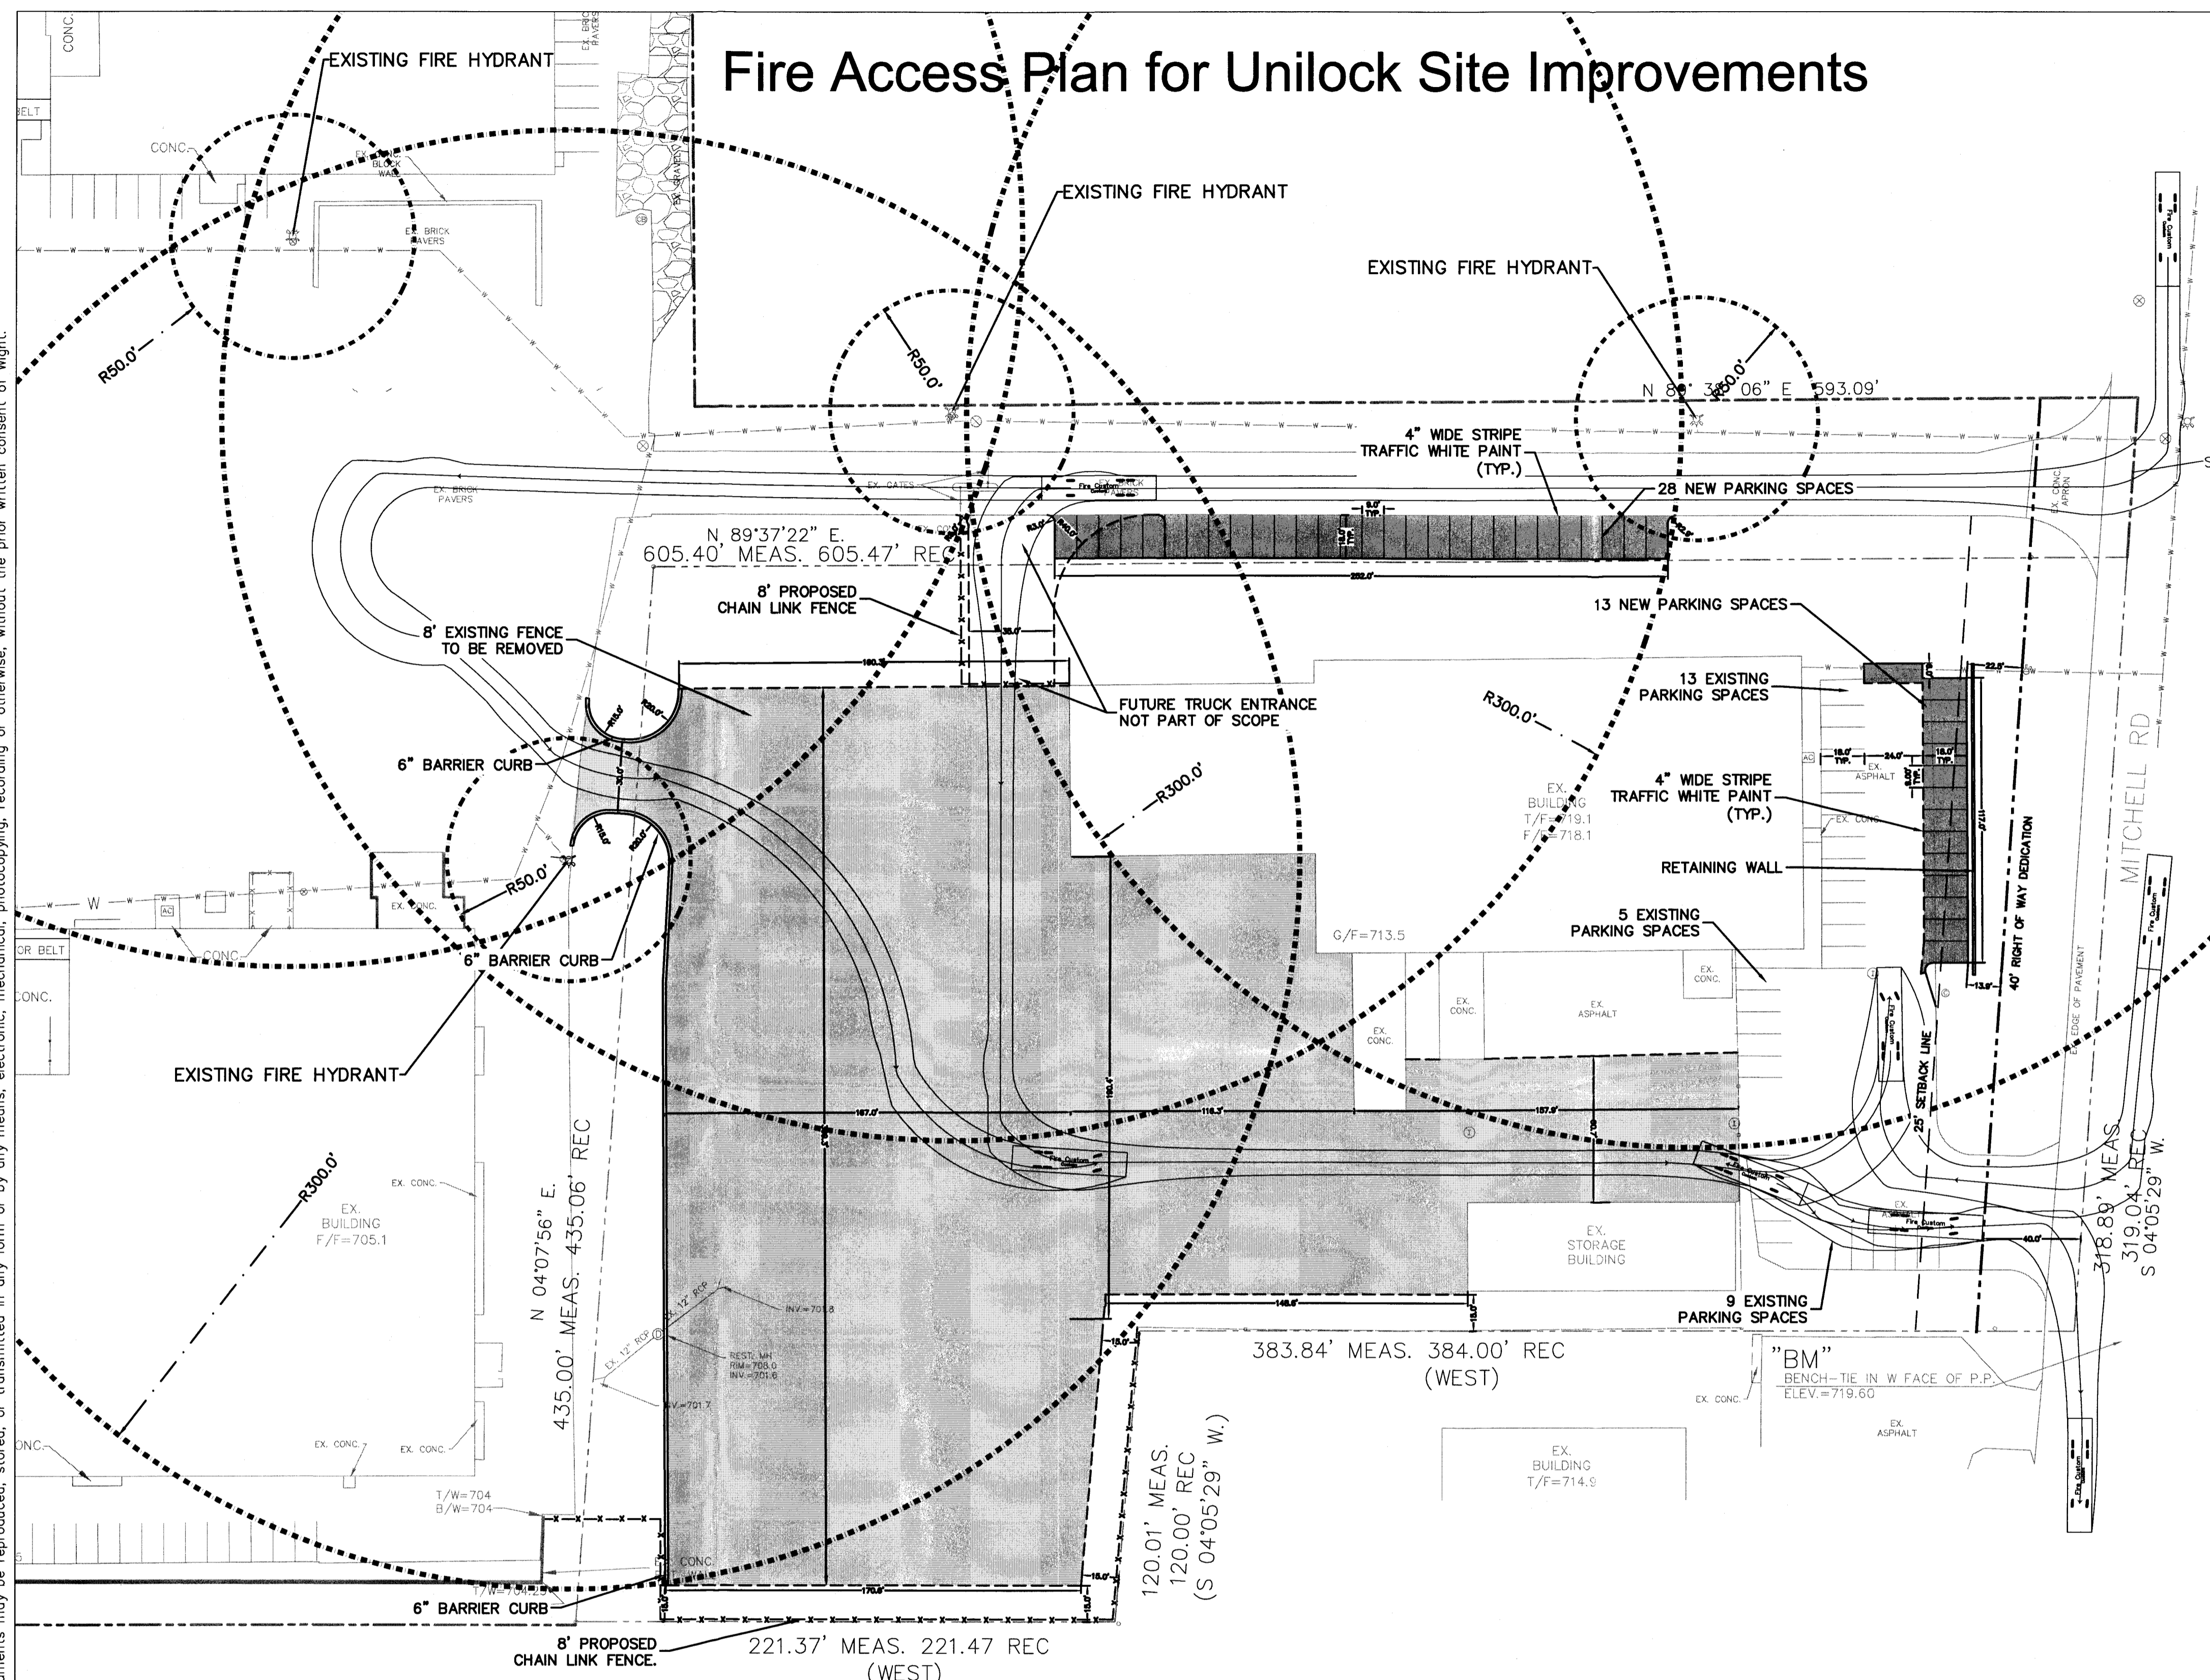

**BRANDWEERAUTO**  
 Width : 7.15  
 Track : 7.15  
 Lock to Lock Time : 6.0  
 Steering Angle : 33.1

Fire Access Plan Data Table		
Description	Value	Unit
a) Building Height	25.00	feet
b) Building Square Footage (typical)	30,000	square feet
c) Building fire suppression information including any proposed use of sprinkler systems, fire alarm systems, whether fire extinguishers are needed:		
Training and storage building has wet and dry systems along with alarm system. Storage building has none.		
d) General description of business to be conducted within each building including: will there be rack storage in the building, will there be storage of combustible materials over twelve feet in height, clearance of sprinkler heads and stored materials (18 inch minimum):		
Business to be conducted in building is storage, training and storage. Training and storage has 3 offices, rack storage and no combustible materials. Building has over 18" clearance.		

REV	DESCRIPTION	DATE
	ISSUED FOR PERMIT	03.02.2016

## UNILOCK SITE IMPROVEMENTS

301 E. SULLIVAN ROAD  
AURORA, IL 60504

## FIRE ACCESS PLAN FOR UNILOCK SITE IMPROVEMENT

Project Number:  
01-5455-02  
Drawn By:  
  
Sheet: