


Fire Access Plan for Early Childhood Center

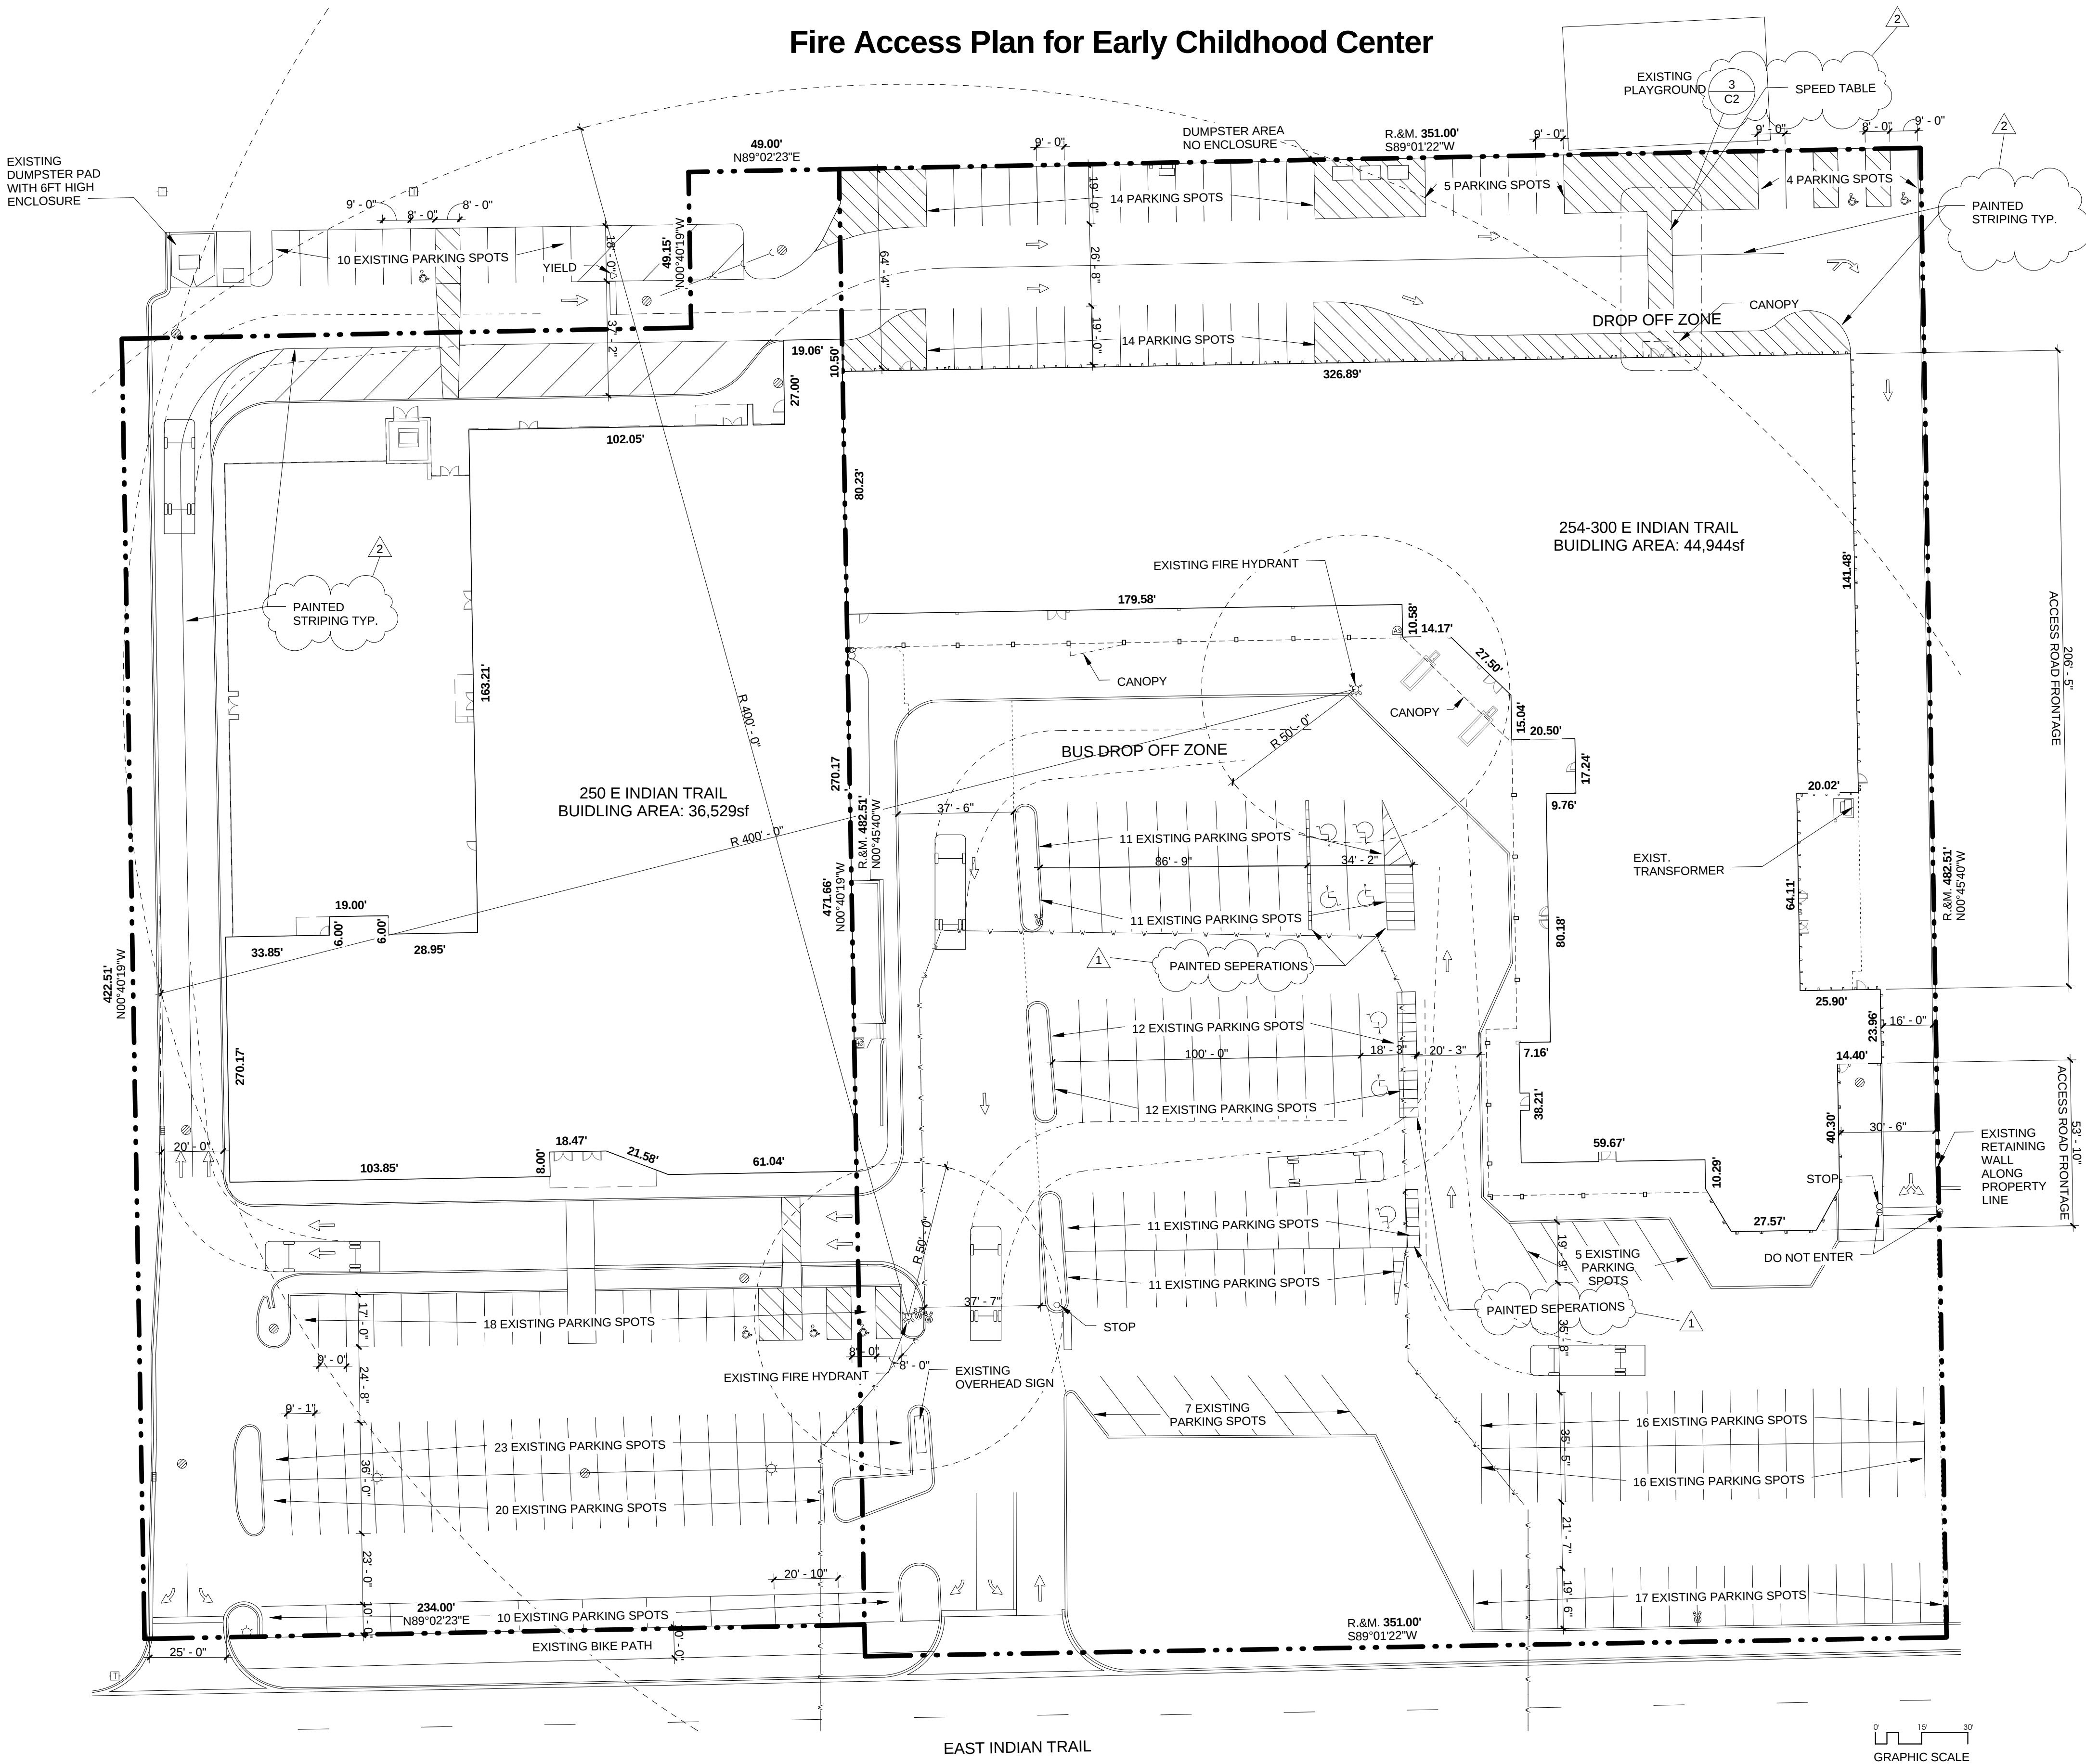


1 FIRE ACCESS PLAN  
1" = 30'-0"


SYMBOL LEGEND

|  |              |                                           |  |                    |
|--|--------------|-------------------------------------------|--|--------------------|
|  | 1 View Name  | PLAN / ELEVATION / DETAIL / SECTION TITLE |  | AUTO SPRINKLER     |
|  | 1/8" = 1'-0" |                                           |  | WATER FIRE HYDRANT |
|  |              |                                           |  | HOSE CONNECTION    |
|  |              |                                           |  | WATER BUFFALO BOX  |

3 ENLARGED PLAN -SPEED TABLE  
1/16" = 1'-0"

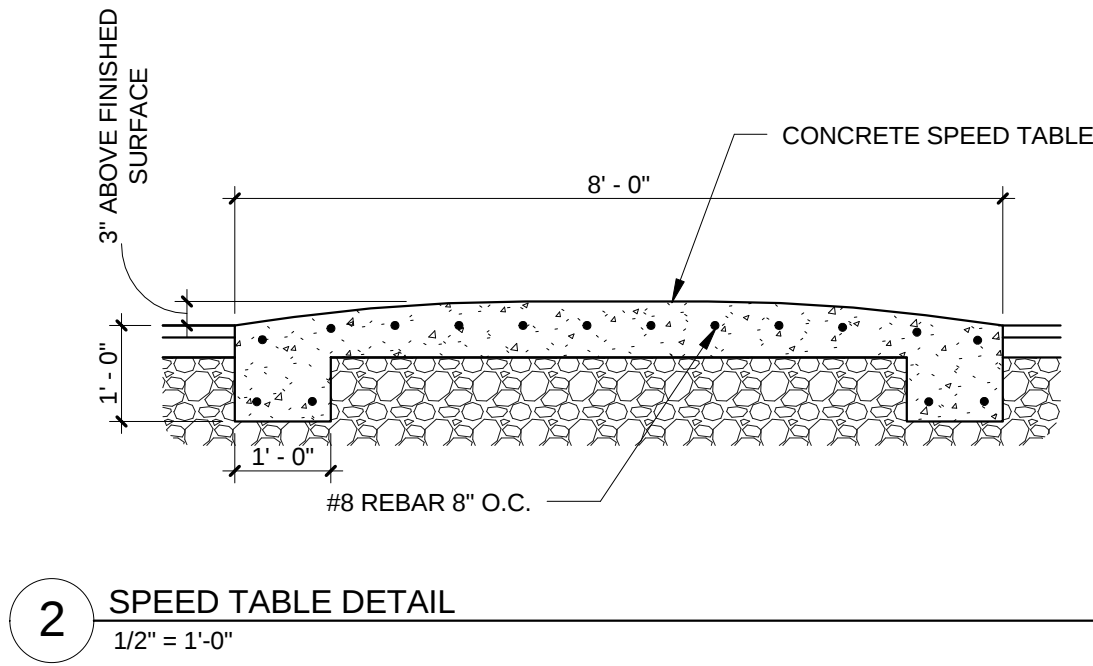

FIRE APPARATUS 90° TURN TEMPLATE

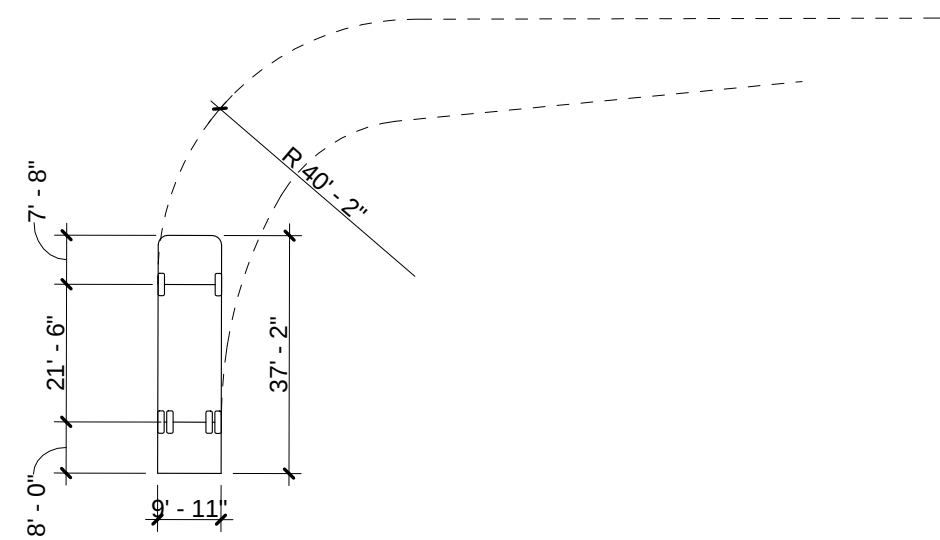

Fire Access Plan Data Table for Early Childhood Center

| Description                                                                                                                                                                                                                                                                  | Value                                                                                                                                                                                                                                                                                                                  | Unit        |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------|
| a) Building Height                                                                                                                                                                                                                                                           | 16.83 and 16.2                                                                                                                                                                                                                                                                                                         | feet        |
| b) Square footage of each building                                                                                                                                                                                                                                           | 36,529 and 44,944                                                                                                                                                                                                                                                                                                      | square feet |
| c) Building fire suppression information including any proposed use of sprinkler systems, fire alarm systems, whether fire extinguishers are needed:                                                                                                                         | At 250 E Indian Trail: Fire Suppression system installed per NFPA-13, local codes, ASTM-A120 standards, regulations, recommendations and rules.<br>At 254-302 E Indian Trail: Fire suppression system in school tenant area, fire alarm system in school tenant area, and fire extinguishers in school tenant area     |             |
| d)General description of business to be conducted within each building including: will there be rack storage in the building, will there be storage of combustible materials over twelve feet in height, clearance of sprinkler heads and stored materials (18 inch minimum) | At 250 E Indian Trail: Current Building Use to remain, Education. No rack storage or storage of combustible materials.<br>At 254-302 East Indian Trail: Early childhood education in proposed tenant area. Existing Office space in 280 space. No rack Storage or storage of combustible materials in entire building. |             |